





Pyles Property
5235 CR 921
Nevada
Collin County

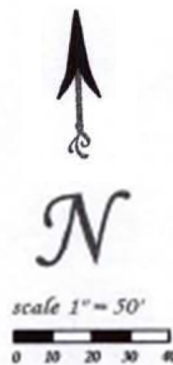

7 RV spaces @ 50 GPD = 350 GPD
350 GPD / 0.1 gal/sq.ft./day = 3500 sq.ft.
3500 sq.ft. / 4 sq.ft. per emitter = 875 emitters
875 emitters x 2 ft. spacing = 1750 linear feet
440 ft. + 440 ft. + 3850 ft. + 380 ft. + 410 ft. = 2050 linear feet

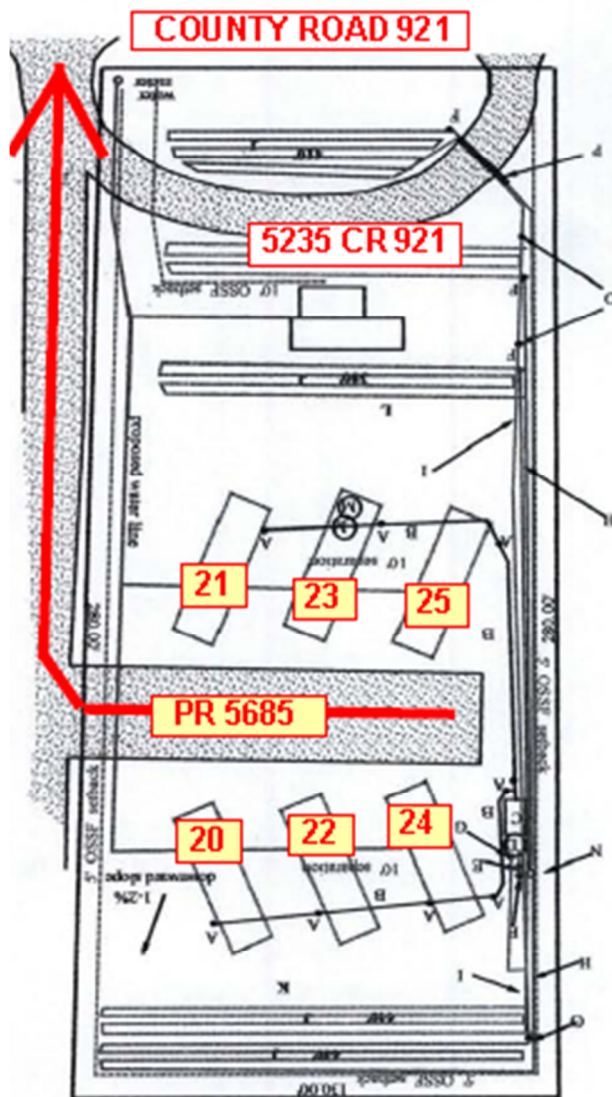

- A = two way clean out
- B = 4" sch 40 pvc
- C = 500 GPD Aerobic Unit
- D = 500 gallon pump tank
- E = 100 micron filter
- F = vacuum breaker valve
- G = continuous flush valve
- H = Supply Line 1" Sch 40 pvc pipe, purple.
- I = Return Line 1" Sch 40 pvc pipe, purple.
- J = Drip Irrigation Field
- K = test hole # 1
- L = test hole #2
- M = Existing ATU to be abandoned.
- N = K-Rain 5 zone mechanical valve
- O = check valve
- P = 3" sch 40 PVC casing.

Frank Powell RS

11 - 02 - 2019

NOTE: There is no flood hazard on property