



Collin County, TX

**INVITATION FOR BID**

**2026-065**

**GENERATOR REPLACEMENT FOR COLLIN COUNTY ADULT DETENTION  
FACILITY (CCADF) CLUSTER 1**

RELEASE DATE: November 17, 2025

RESPONSE DEADLINE: December 18, 2025, 2:00 pm

Please refer to the project timeline in this document for all important deadlines.

## Table Of Contents

001116	Advertisement for Bids
002113	Instructions to Bidders
004113	Pricing Table
004513	Vendor Submissions

### Attachments:

A - LEGAL NOTICE - IFB 2026-065

B - 004313\_Bid\_Bond

D - 004325\_Product\_Substitution\_Request\_Form

E - Construction\_Agreement\_Engineer\_2.12.25

F - Performance\_Bond

G - Payment\_Bond

H - Maintenance\_Bond

I - CIQ\_Form

J - W9

K - 2025.09.24 SPECIFICATION BOOK - Collin County-Cluster 1 Generator

L - 251780 - CC ADC Cluster 1 Generator - Electrical

## 001116 Advertisement for Bids

### 1 SCOPE OF WORK

SCOPE OF WORK INCLUDES all materials, labor, equipment and services to produce or be incorporated in such construction. Contract will be a general contract to purchase and install a new diesel generator and associated work at the Collin County Adult Detention Facility (CCADF), Cluster 1 as described within the project documents. The project includes disconnecting and removing the existing generator and installing and connecting the new generator. Final testing on all equipment for verification of operation at full load is required.

Payment for the contract work shall be made pursuant to the terms of the Contract Documents.

### 2 TIMELINE

Advertisement/Release Project Date:	November 17, 2025
Pre-Bid Meeting Time Slot 1 (Mandatory):	December 2, 2025, 2:30pm Collin County Central Plant - 4600 Community Ave, McKinney TX 75071
Pre-Bid Meeting Time Slot 2 (Mandatory):	December 4, 2025, 11:00am Collin County Central Plant - 4600 Community Ave, McKinney TX 75071
Question and Substitution Request Submission Deadline:	December 9, 2025, 5:00pm
Bid Opening:	December 18, 2025, 2:00pm

### 3 PROBABLE CONSTRUCTION COST

The opinion of probable construction cost for this contract is four hundred thousand dollars (\$400,000.00)

### 4 BID INFORMATION

Collin County uses OpenGov Procurement for the notification and dissemination of all solicitations for commodities and services. The receipt of solicitations through any other company may result in your receipt of incomplete specifications and/or addenda which could ultimately render your bid non-compliant. Collin County accepts no responsibility for the receipt and/or notification of solicitations through any other company.

COLLIN COUNTY APPRECIATES your time and effort in preparing a bid.

Collin County prefers to receive all bids electronically through

<https://procurement.opengov.com/portal/collincountytx>, however the County will accept hard copy bids.

Hard copy paper bid must be in a separate sealed envelope, manually signed in ink by a person having the authority to bind the firm in a contract and marked clearly on the outside as outlined above. Please note that all bids must be received at the designated location by the deadline shown. Bids received after deadline shall be considered void and unacceptable. Collin County is not responsible for lateness of mail, carrier, etc. and time/date stamp clock in the Collin County Purchasing Department shall be the official time of receipt. All bid forms provided in this Invitation for Bid must be completed prior to submission. Failure to complete the forms shall render your bid null and void. We would appreciate you indicating on your "NO BID" response any requirements of this bid request which may have influenced your decision to "NO BID".

BIDS WILL BE publicly opened in the Office of the Purchasing Agent, 2300 Bloomdale Rd, Suite 3160, McKinney, TX 75071, at the date and time indicated above.

No oral, telegraphic, telephonic or facsimile bids will be considered. **Bids submitted via email, CD-ROM, or Flash Drive will not be accepted.** Bids may be submitted in electronic format via OpenGov located at <https://procurement.opengov.com/portal/collincountytx>

## 5 PRE-BID INFORMATION

A MANDATORY PRE-BID MEETING & SITE-WALK will be held by Collin County at Collin County Central Plant - 4600 Community Ave, McKinney TX 75071, on **Tuesday, December 2, 2025 at 2:30 pm and on Thursday, December 4, 2025 at 11:00 am** in order for bidders to ask questions regarding the proposed work. **All Bidders desiring to bid the work must attend ONE of the two meetings, but do not have to attend both (same sites will be viewed at both meetings).** It is the bidder's responsibility to review the site and documents to gain a full understanding of the requirements of the bid.

## 6 BID SECURITY

BID SECURITY: All Bidders must submit, prior to the bid opening time, a Certified Check, Cashier's Check or acceptable Bid Bond payable without recourse to Collin County in the amount of not less than five percent (5%) of the total bid plus alternates as submitted.

1. Bid Bond, certified check or Cashier's Check may be mailed or hand delivered to the Office of the Collin County Purchasing Agent, Collin County Administration Building, 2300 Bloomdale Road, Ste 3160, McKinney, TX 75071 and shall be delivered in an envelope, marked plainly on the outside with the Bid Name and Number.
2. Bidders submitting a bid via OpenGov shall upload a Bid Bond at <https://procurement.opengov.com/portal/collincountytx>

Regardless of delivery method, all Bid Bonds shall be received prior to the bid opening time to be considered. **Failure to submit a copy of bid security prior to bid opening shall be cause for rejection of bid.**

The original Bid Bond shall be received in the Collin County Purchasing Department **no later than** close of business on the third working day after the bid opening. **Late receipt of or failure to submit original Bid Bond shall be cause for rejection of bid.**

## 7 BONDS

Contractor must furnish a performance bond, payment bond and two (2) year maintenance bonds within ten (10) consecutive calendar days following award of contract. The bonds shall be issued by a corporate surety in accordance with all Texas Law, including but not limited to, Chapter 2253 of the Texas Government Code and Chapter 3503 of the Texas Insurance Code, for public works projects.

## 002113 Instructions to Bidders

### 1.01 RELATED DOCUMENTS

1. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Specification Sections, apply to this Section.

### 1.02 DEFINITIONS

1. All definitions set forth in the General Conditions of the Contract for Construction or in other Contract Documents are applicable to these Bidding Documents.
2. Bidding Documents include the Advertisement or Invitation for Bids, Instructions to Bidders, the bid form, other sample bidding and contract forms and the proposed Contract Documents including any Addenda issued prior to receipt of bids.
3. Addenda are written or graphic instruments issued prior to the opening of the Bidding Documents, which modify or interpret the Bidding Documents, including Drawings and Specifications, by additions, deletions, clarifications or corrections. Addenda will become part of the Contract Documents when the Construction Contract is executed.
4. MD Engineering, LLP will be hereafter referred to in the Project Manual as “Engineer” and all correspondence shall be addressed to: MD Engineering, LLP, MD Engineering, LLP, 1255 W. 15th St., Suite 300, Plano, TX 75075.
5. “Luis Palma” will be hereinafter referred to in this Project Manual as “Project Manager”.
6. “Collin County” will be hereafter referred to in this Project Manual as “Owner”.
7. A Bid is a complete and properly signed submittal to do the Work for designated portion thereof for the sums stipulated therein, submitted in accordance with the Bidding Documents.
8. The Base Bid is the sum stated in the Bid for which the Bidder offers to perform the Work described in the Bidding Documents as the base, to which work may be added or from which work may be deleted for sums stated in Alternate Bids.
9. An Alternate Bid (or Alternate) is an amount stated in the Bid to be added to or deducted from the amount of the Base Bid in the corresponding change in the Work, as described in the Bidding Documents or in the proposed Contract Documents.
10. A Unit Price is an amount stated in the Bid as a price per unit of measurement for materials or service as described in the Bidding Documents or in the proposed Contract Documents.
11. A Bidder is a person or entity who submits a Bid.

12. A Sub-Bidder is a person or entity who submits a bid to a Bidder for materials or labor for a portion of the work.
13. A Contractor is a person or entity who is determined to be the lowest responsible and responsive bidder to whom Owner (on the basis of Owner's evaluation as hereinafter provided) makes an award.
14. The Bid Requirements and Other General Conditions, as provided under the Division of the North Central Texas Council of Governments Standard Specifications for Public Works Construction will be applicable to this project, unless noted otherwise in the Contract Documents

### 1.03 EXAMINATION OF DOCUMENTS AND SITE

1. Each bidder, by making his/her Bid, represents that he/she has read and understands the Bidding Documents.
2. Each Bidder, by making his/her Bid, represents that he/she has visited the site, performed investigations and verifications as he/she deems necessary, and familiarized himself/herself with the local conditions under which the Work is to be performed and will be responsible for any and all errors in his/her bid resulting from his/her failure to do so.
3. The location and elevations of the various utilities and pipe work included within the scope of the work are offered as a general guide only, without guarantee as to accuracy. The Contractor shall verify and investigate to his/her own satisfaction the location and elevation of all utilities, pipe work, and the like and shall adequately inform himself/herself of their relation to the work before submitting a bid.
4. Before submitting a bid each bidder will, at bidder's own expense, make or obtain any additional examinations, investigations, explorations, tests and studies and obtain any additional information (surface, subsurface, and underground facilities) at or contiguous to the site, or otherwise which may affect cost, progress, performance or furnishing of the work and which bidder deems necessary to determine its bid for performing and furnishing the work in accordance with the time, price and other terms and conditions of the Contract Documents. Bidder will rely solely on its own site investigation and assumes the risk of any site conditions not discovered that may result in additional costs and all errors in the bid.
5. On request in advance, Owner will provide each bidder access to the site to conduct explorations and tests as each bidder deems necessary for submission of a bid. Bidder shall fill all holes, clean up and restore the site to its former condition upon completion of such explorations.
6. The lands upon which the work is to be performed, right-of way and easement for access thereto and other lands designated for use by Contractor in performing the work are identified in the Contract.
7. Each bidder by making his/her bid represents that his/her bid is based upon the materials, systems, and equipment required by the Bidding Documents without exception.

## 1.04 BIDDING DOCUMENTS

1. Complete sets of Bidding Documents shall be used in preparing bids; neither County, nor Engineer assume any responsibility for errors or misinterpretations resulting from use of incomplete sets of Bidding Documents.
2. County or the Engineer, in making copies of the Bidding Documents available on the above terms, do so only for the purpose of obtaining Bids on the Work and do not confer a license or grant for any other use.

## 1.05 BIDDING PROCEDURES

1. All bids shall be prepared on the forms provided by the Engineer and submitted in accordance with the Instruction to Bidders. The Engineer or owner will furnish bidders with bid forms which will provide for the following bid items. Bidders shall provide all requested information. Prices bid/proposed shall only be considered if they are provided in the appropriate space(s) on the Collin County bid form(s). For consideration of any exception including any additions or deductions to the bid/proposal prices offered please see "Exceptions" in Section 004513 Vendor Submissions. Extraneous numbers, prices, comments, etc. or bidder/offeror generated documents appearing elsewhere on the bid or as an additional attachment shall be deemed to have no effect on the prices offered in the designated locations.
  - i. A single contract price for each bid item as detailed and described in these specifications.
  - ii. Acknowledgment of Addenda.
  - iii. Number of consecutive calendar days to complete project.
  - iv. Alternate bids.
  - v. Unit prices.
2. A bid (electronic or hard copy) is invalid if it has not been deposited at the designed location prior to the time and date for receipt of bids indicated in the Advertisement or Invitation For Bid, or prior to any extension thereof issued to the bidders. Bids received in County Purchasing Department after submission deadline shall be returned unopened and will be considered void and unacceptable. Owner is not responsible for lateness of mail, carrier, etc. and time/date stamp clock in County Purchasing Department shall be the official time of receipt.
3. Unless otherwise provided in any supplement to these Instructions to Bidders, no bidder shall modify, withdraw or cancel his/her bid or any part thereof for ninety (90) consecutive calendar days after the time designated for the receipt of bids in the Advertisement or Invitation For Bid.
4. Bids shall not contain any recapitulation of the Work to be done.

5. The Bidder shall make no additional stipulations on the Bid Form nor limit or qualify his/her bid in any other manner. Bids so qualified will be subject to disqualification.
6. Collin County is by statute exempt from the State Sales Tax and Federal Excise Tax; therefore, the prices submitted shall not include taxes.

## 1.06 DISCREPANCIES AND AMBIGUITIES

Any interpretations, corrections and/or changes to an Invitation for Bid and related Specifications or extensions to the opening/receipt date will be made by addenda to the respective document by the Collin County Purchasing Department. Questions and/or clarification requests must be submitted no later than the date specified in the solicitation. Those received at a later date may not be addressed prior to the public opening. Sole authority to authorize addenda shall be vested in Collin County Purchasing Agent as entrusted by the Collin County Commissioners Court. Addenda may be transmitted electronically via Collin County OpenGov, by facsimile, E-mail transmission or mailed via the US Postal Service.

1. Addenda will be transmitted to all that are known to have received a copy of the IFB and related Specifications. However, it shall be the sole responsibility of the Bidder to verify issuance/non-issuance of addenda and to check all avenues of document availability (i.e. OpenGov Procurement at <https://procurement.opengov.com/portal/collincountytx>, telephoning Purchasing Department directly, etc.) prior to opening/receipt date and time to insure Bidder's receipt of any addenda issued. Bidder shall acknowledge receipt of all addenda.

## 1.07 SUBSTITUTIONS

1. Each bidder represents that his/her bid is based upon the materials and equipment described in the Bidding Documents.
2. No substitution will be considered unless written request has been submitted to the Engineer for approval by the date specified in the solicitation. Submit substitution request forms to [shayes@co.collin.tx.us](mailto:shayes@co.collin.tx.us).
3. If the Engineer and Owner approves a proposed substitution, such approval will be set forth in an Addendum.

## 1.08 QUALIFICATION OF BIDDERS

1. Within seven (7) consecutive calendar days following bid opening, the apparent low bidder shall submit with a properly executed Contractor's Qualification Statement as evidence to establish bidder's financial responsibility, experience and possession of such equipment as may be needed to prosecute the work in an expeditious, safe and satisfactory manner. Submission of a bid is confirmation that Bidder accepts this requirement and is willing to provide the requested information unconditionally

and understands the County may not, by law, sign an NDA to obtain this information. This Statement shall include:

- i. List of current projects.
  - ii. List of projects completed within the past five years.
  - iii. Experience of key individuals of the organization.
  - iv. Trade and Bank references.
  - v. Recent financial statements to confirm that the bidder has suitable financial status to meet obligations incidental to performing the work. Audited financial statements are not required; unaudited financial statements will be accepted. If bidder's firm does, however, have audited statements, please include a copy with your bid.
    - a. Financial Statements to include a complete Balance Sheet and Income Statement
    - b. Must provide statements for two consecutive fiscal years, preferably the two most recent available
    - c. Both statements must reflect the same reporting periods, i.e. January to December or October to September. Partial years will not accepted
  - vi. A statement of cost for each major item of Work included in the Bid.
  - vii. A designation of the Work to be performed by the Bidder with his/her own forces.
  - viii. A list of names of the Subcontractors or other persons or organizations (including those who are to furnish materials or equipment fabricated to a special design) proposed for each portion of the Work. The Bidder will be required to establish to the satisfaction of the Engineer and Owner the reliability and responsibility of the proposed Subcontractors. Prior to the award of the Contract, the Engineer will notify the Bidder in writing if either the County or the Engineer, after due investigation, has reasonable and substantial objection to any person or organization on such lists. If Owner or Engineer has a reasonable and substantial objection to any person or organization on such list, and refuses in writing to accept such person or organization, the Bidder may, at his/her option, withdraw his/her Bid without forfeiture of Bid Security or provide an acceptable substitute. Subcontractors and other persons and organizations proposed by the Bidder and accepted by Owner and Engineer must be used on the Work for which they were proposed and accepted, and shall not be changed except with the written approval of Owner and the Engineer.
2. Bidders may be disqualified and their bids not considered for any of the following specific reasons:
- i. Reason for believing collusion exists among bidders.
  - ii. The bidder being interested in any litigation against Owner.

- iii. The bidder being in arrears on any existing contract or having defaulted on a previous contract.
  - iv. Lack of competency as revealed by the financial statement, experience and equipment, questionnaires, or qualification statement.
  - v. Uncompleted work which in the judgment of Owner will prevent or hinder the prompt completion of additional work if awarded.
3. Minimum Standards For Responsible Prospective Bidders: A prospective Bidder must meet the following minimum requirements. Collin County may request representation and other information sufficient to determine Bidder's ability to meet these minimum standards listed below.
- i. Have adequate financial resources, or the ability to obtain such resources as required;
  - ii. be able to comply with the required or proposed delivery/ completion schedule;
  - iii. have a satisfactory record of performance;
  - iv. have a satisfactory record of integrity and ethics; and
  - v. be otherwise qualified and eligible to receive an award.
4. In determining to whom to award the contract, the Owner may consider;
- i. the purchase price;
  - ii. the reputation of the bidder/contractor/vendor and of the bidder/contractor/vendor's goods or services;
  - iii. the quality of the bidder/contractor/vendor's goods or services;
  - iv. the extent to which the goods or services meet the Owner's needs;
  - v. the bidder/contractor/vendor's past relationship with the Owner;
  - vi. the total long-term cost to the Owner to acquire the bidder/contractor/vendor's goods or services; and
  - vii. any other relevant factors specifically listed in the Instruction to Bidders.

## 1.09 PREPARATION OF BID

1. Bidder shall submit his/her bid on the forms furnished by the Engineer. All blank spaces in forms shall be correctly filled in and the bidder shall state the prices, written in words and in figures. Where there is discrepancy between the price written in words and the price written in figures, the price written in words shall govern. If bid is submitted by an individual, his/her name must be signed by him/her or his/her duly authorized agency. If the bid is submitted by a firm, association or partnership, the name and address of each member must be given, and the bid must be signed by an official or duly

authorized agent. Powers of attorney authorizing agents or others to sign bids must be properly certified and must be in writing and submitted with the bid.

2. Bidder shall bear any/all costs associated with its preparation of any bid, proposal or submittal.
3. Public Information Act: Collin County is governed by the Texas Public Information Act, Chapter 552 of the Texas Government Code. All information submitted by prospective bidders during the bidding process is subject to release under the Act.
4. The Bidder shall comply with Commissioners Court Order No. 2004-167-03-11, County Logo Policy.

## 1.10 BID SECURITY

1. Each bid must be accompanied by Bid Security (in accordance with instructions set forth in section 001116-Advertisement For Bids) made payable to Owner in an amount of five percent (5%) of the bidder's maximum bid price and in the form of a Cashier's Check or a Bid Bond, duly executed by bidder as principal and having as surety thereon, a corporate surety authorized and admitted to do business in the State of Texas and licensed to issue such bond, as a guarantee that the bidder will enter into a Contract and execute required Performance, Payment, and two (2) year Maintenance Bonds within ten (10) consecutive calendar days of Collin County Commissioners Court award of Contract.
2. The Bid Security of the contractor will be retained until such bidder has executed the Contract Agreement and furnished the required Contract Security, whereupon, the Bid Security will be returned. If the contractor fails to execute and deliver the Agreement and furnish the required Contract Security within ten (10) consecutive calendar days of Collin County Commissioners Court award of Contract, Owner may annul the award of contract and the Bid Security of that bidder will be forfeited. The Bid Security of the other bidders whom Owner believes to have a reasonable chance of receiving the award may be retained by Owner until the earlier of the seventh (7th) consecutive calendar day after the effective date of the Agreement or the ninety-fifth (95th) consecutive calendar day after the bid opening, whereupon, the Bid Security furnished by such bidders will be returned. Bid Security with bids which are not competitive will be returned within seven (7) consecutive calendar days after the contract award.
3. Should the bidder to whom the Contract is awarded refuse or neglect to execute and file the contract and bonds within ten (10) consecutive calendar days of Collin County Commissioners Court award of Contract, Owner may annul award of Contract and the Bid Security filed with the bid shall become the property of Owner, not as a penalty, but as liquidated damages. Owner reserves the right to award canceled Contract to next responsible, lowest and best bidder as it deems to be in the best interest of the County.
4. Owner will have the right to retain the bid security of all bidders until either:

- i. the Contract has been executed and the bonds have been furnished, or
- ii. the specified time has elapsed so that bids may be withdrawn, or
- iii. all bids have been rejected.

## **1.11 PERFORMANCE BOND, LABOR & MATERIAL PAYMENT BOND, MAINTENANCE BOND**

1. The Contractor shall post with Owner, not later than ten (10) consecutive calendar days of Collin County Commissioners Court award of Contract, a Performance Bond in the amount of one hundred percent (100%) of the total contract price in such form as is satisfactory to Owner, in compliance with Chapter 2253 of the Texas Government Code and all other applicable Texas Law, and on the form specified in the Contract Documents. This bond shall be executed by a corporate surety company duly authorized and admitted to do business in the State of Texas and licensed to issue such a bond in the State of Texas. The Contractor shall notify its corporate surety of any Contract changes.
2. The Contractor shall post with Owner, not later than ten (10) consecutive calendar days of Collin County Commissioners Court award of Contract, a Payment Bond in the amount of one hundred percent (100%) of the total contract price in such form as is satisfactory to Owner, in compliance with Chapter 2253 of the Texas Government Code and all other applicable Texas Law, and on the form specified in the Contract Documents. This bond shall be executed by a corporate surety company duly authorized and admitted to do business in the State of Texas and licensed to issue such a bond in the State of Texas. The Contractor shall notify its corporate surety of any Contract changes.
3. The Contractor shall post with Owner, not later than ten (10) consecutive calendar days of Collin County Commissioners Court award of Contract, a two (2) year Maintenance Bond in the amount of ten percent (10%) of the total contract price in such form as is satisfactory to Owner, in compliance with Chapter 2253 of the Texas Government Code and all other applicable Texas Law, and on the form specified in the Contract Documents. This bond shall be executed by a corporate surety company duly authorized and admitted to do business in the State of Texas and licensed to issue such a bond in the State of Texas. The Contractor shall notify its corporate surety of any Contract changes.
4. The Contractor must demonstrate to Owner that it can secure the required performance and payment bonds, issued by a corporate surety company authorized and admitted to do business in the State of Texas and licensed to issue such a bond in the State of Texas. Contractor must also demonstrate that the bond is not in excess of ten percent (10%) of the corporate surety company's capital and surplus. To the extent the amount of the bond exceeds ten percent (10%) of the corporate surety company's capital and surplus, such bond will not be accepted unless bidder provides written certification that the corporate surety company has reinsured the portion of the risk that exceeds ten percent (10%) of the corporate surety company's capital and surplus with one or more insurers who

are duly authorized, accredited or trusted to do business in the State of Texas. The amount reinsured by any reinsurer must not exceed ten percent (10%) of the reinsurer's capital and surplus.

5. The Contractor must file with the performance bond and payment bond, all documents and information necessary to establish that the agent signing the bond is authorized to write the bond in the amount requested, and if applicable, that reinsurance requirements, have been met, including limits and ratings or other evidence of company solvency.
6. If the corporate surety company on any bond furnished by Contractor to Owner is declared bankrupt or becomes insolvent or such corporate surety company's right to do business in the State of Texas is revoked, the Contractor shall within five (5) consecutive calendar days thereafter substitute another bond and corporate surety company, both of which shall be acceptable to Owner.

## 1.12 FILING BID

1. All Bids, proposals, or submittals submitted in hard copy paper form shall be submitted in a sealed envelope, plainly marked on the outside with the Invitation for Bid (IFB) number and name. A hard copy paper form bid, proposal, or submittal shall be manually signed in ink by a person having the authority to bind the firm in a contract. Submittals, bids or proposals shall be mailed or hand delivered to the Collin County Purchasing Department.
2. No oral, telegraphic or telephonic submittals will be accepted. Bids, proposals, or submittals may be submitted in electronic format via Collin County OpenGov at <https://procurement.opengov.com/portal/collincountytx>.
3. All Bids, submittals or proposals submitted electronically via OpenGov Procurement at <https://procurement.opengov.com/portal/collincountytx> shall remain locked until official date and time of opening as stated in the Special Terms and Conditions of the IFB.
4. For hard copy paper form bids, proposals, or submittals, any alterations made prior to opening date and time must be initialed by the signer of the bid, proposal, or submittal, guaranteeing authenticity. Bids, proposals, or submittals cannot be altered or amended after submission deadline.
5. No bid, proposal, or submittal will be considered unless it is filed with the Owner Purchasing Department within the time limit for receiving bids as stated in the Advertisement for Bids or IFB. Each hard copy paper bid shall be in a sealed envelope plainly marked with the word "BID", and the name and bid number of the project as designated in the Advertisement for Bids or IFB.

## 1.13 MODIFICATION AND WITHDRAWAL OF BID

1. No bid, proposal, or submittal may be withdrawn or modified after the bid opening except where the award of the contract has been delayed beyond ninety (90) consecutive calendar days after date of bid

opening or as per Texas Local Government Code, Title 8, Chapter 262, Subchapter C., Section 262.0305. Modifications after Award.

## 1.14 IRREGULAR BID

1. It is understood that Collin County, Texas reserves the right to accept or reject any and/or all Bids, proposals, or submittals for any or all products and/or services covered in an Invitation For Bid (IFB) and to waive informalities or defects in submittals or to accept such submittals as it shall deem to be in the best interest of Collin County.

## 1.15 REJECTION OF BID

1. The bidder acknowledges the right of Owner to reject any or all bids and to waive any informality or irregularity in any bid received. In addition, the bidder recognizes the right of Owner to reject a bid if the bidder failed to furnish any required Bid Security, or to submit the data required by the Bidding Documents, or if the bid is in any way incomplete or irregular.

## 1.16 METHOD OF AWARD

1. In evaluating bids, Owner will consider whether or not the bids comply with the prescribed requirements, base prices, any alternates, unit pricing, completion time, bidder's qualifications, bidder's proposed subcontractors, suppliers, etc., and other data as may be requested in the Bid Documents.
2. Owner may conduct such investigations as Owner deems necessary to assist in the evaluation of any bid and to establish the responsibility, qualifications and financial ability of bidder, proposed subcontractors, suppliers and other persons and organizations to perform and furnish the Work in accordance with the Bidding Documents to Owner's satisfaction within the prescribed time.
3. If the contract is to be awarded, it will be awarded to the lowest and best responsible bidder whose evaluation, by Owner, indicates to be in the best interests of the project. If no alternates are selected by Owner, the Owner may award the contract to a responsible bidder who submits the lowest and best bid.
4. Evaluation of Alternatives: Any and/or all or none of the alternates may be considered in evaluation. Owner may award Contract on base bid plus any and/or all or none of the alternates.
5. Owner anticipates award within ninety (90) consecutive calendar days after bid opening.
6. The bid, when properly accepted by the County, shall constitute a Contract equally binding between the contractor and Owner. No different or additional terms will become part of this Contract with the exception of a written Change Order, signed by both parties.

7. No oral statement of any person shall modify or otherwise change, or affect the terms, conditions or specifications stated in the resulting contract. All change orders to the contract will be made in writing by Collin County Purchasing Agent.

## 1.17 EXECUTION OF CONTRACT

1. The person or persons, partnership, company, firm, association or corporation to whom a contract is awarded shall within ten (10) consecutive calendar days after such award, sign the necessary contract agreements and submit the required bonds entering into the required Contract with Owner. No contract shall be binding on Owner until it has been executed by Owner or his/her duly authorized representative, and delivered to the Contractor.

## 1.18 FAILURE TO EXECUTE CONTRACT

1. The failure of the Bidder to execute the required bonds or to sign the required Contract within ten (10) consecutive calendar days after the Contract is awarded, shall be considered by Owner as abandonment of his/her Bid, and Owner may annul the award, at the Owner's sole discretion.

## 1.19 PURCHASE ORDER

1. A purchase order(s) shall be generated by Owner to the contractor. The purchase order number **must** appear on all itemized invoices. Collin County will not be responsible for any orders placed or delivered without a valid purchase order number.

## 1.20 NOTICE TO PROCEED

1. Upon the execution and delivery of Bonds, Executed Contract by Contractor, progress schedule, proof of insurance, and all other documents required prior to commencing work herein, Owner will issue a written Notice to Proceed to the Contractor requesting that he/she proceed with construction, and the Contractor shall commence work within ten (10) consecutive calendar days after the date of Notice to Proceed.

## 1.21 PAYMENT PROCEDURES

1. Contractor shall submit Applications for Payment in accordance with the Contract, and payments shall be made in accordance with the Contract Documents.
2. Final Payment: Upon final completion and acceptance of the work, Owner shall pay the remainder of the contract price as recommended by Engineer, in accordance with Texas Government Code, Title 10, Subtitle F., Chapter 2251. Contractor(s) is required to pay subcontractors within ten (10) days after the contractor has received payment from the County.

3. The Contractor understands, acknowledges and agrees that if the Contractor subcontracts with a third party for services and/or material, the primary Contractor (awardee) accepts responsibility for full and prompt payment to the third party. Any dispute between the primary Contractor and the third party, including any payment dispute, will be promptly remedied by the Contractor. Failure to promptly render a remedy or to make prompt payment to the third party (subcontractor) may result in the withholding of funds from the primary Contractor by Collin County for any payments owed to the third party.

## 1.22 AFFIDAVIT OF BILLS PAID

1. Prior to final acceptance of this project by Owner, the Contractor shall execute an affidavit that all bills for labor, materials, and incidentals incurred in the project construction have been paid in full, and that there are no claims pending.

## 1.23 EXEMPTION FROM STATE OF TEXAS AND LOCAL SALES TAX ON MATERIALS

1. Owner qualifies for exemption from State and Local Sales Tax pursuant to the provisions of Chapter 151, Section 151.309 of the Texas Limited Sales, Excise and Use Tax Act. The Contractor performing this Contract may purchase all materials, supplies, equipment consumed in the performance of this Contract by issuing to his/her suppliers an exemption certificate in lieu of the tax.

## 1.24 CONFLICT OF INTEREST

1. No public official shall have interest, direct or indirect, in this contract, in accordance with Texas Local Government Code Title 5, Subtitle C, Chapter 171.

## 1.25 ETHICS

The bidder/contractor shall comply with Commissioners Court Order No. 96-680-10-28, Establishment of Guidelines & Restrictions Regarding the Acceptance of Gifts by County Officials & County employees.

## 1.26 BID COMPLIANCE

1. Bid must comply with all federal, state, county and local laws concerning this type of project and the fulfillment of all ADA (Americans With Disabilities Act) requirements.
2. Design, strength, quality of materials and workmanship must conform to the highest standards of manufacturing and engineering practice.
3. All products must be new and unused, unless otherwise specified, in first-class condition and of current manufacture.

## 1.27 DRUG FREE

1. All bidders shall provide any and all notices as may be required under the Drug-Free Work Place Act of 1988, 41 U.S.C. 701, and Collin County Commissioners Court Order No. 90-455-06-11, to its employees and all sub-contractors to insure that Owner maintains a drug-free work place. The use, possession or being under the influence of drugs and/or alcohol while working on this bid project or while on County property is prohibited and may result in removal of an individual from the project and/or immediate termination of contract. The County reserves the right to review drug testing records of any personnel involved in this bid project. The County may require, at contractor's expense, drug testing of contractor's personnel if no drug testing records exists or if such test results are older than six (6) months.
2. Substances and cut-off levels are as follows:

SUBSTANCE	MAXIMUM LEVEL
Amphetamines	1000 NG/ML
Barbiturates	300 NG/ML
Benzodiazepines	300 NG/ML
Cocaine Metabolite	300 NG/ML
Opiates	300 NG/ML
Phencyclidine (PCP)	25 NG/ML
THC (Marijuana) Metabolite	100 NG/ML
Methadone, Urinary	300 NG/ML
Methaquaone, Urine	300 NG/ML
Propoxyphene	300 NG/ML

## 1.28 INDEMNIFICATION

1. To the fullest extent permitted by law, the CONTRACTOR and his sureties shall indemnify, defend and hold harmless the OWNER and all of its, past, present and future, officers, agents and employees from all suits, cause of action, claims, liabilities, losses, fines, penalties, liens, demands, obligations, actions,

proceedings, of any kind, character, name and description brought or arising, on account of any injuries or damages received or sustained by any person, destruction or damage to any property on account of, in whole or part, the operations of the CONTRACTOR, his agents, employees or subcontractors; or on account of any negligent act or fault of the CONTRACTOR, his agents, employees or subcontractors in the execution of said Contract; failing to comply with any law, ordinance, regulation, rule or order of any governmental or regulatory body including those dealing with health, safety, welfare or the environment; on account of the failure of the CONTRACTOR to provide the necessary barricades, warning lights or signs; and shall be required to pay any judgment, with cost, which may be obtained against the OWNER growing out of such injury or damage. In no event shall OWNER be liable to CONTRACTOR for indirect or consequential damages or loss of income or profit irrespective of the cause, fault or reason for same. CONTRACTOR'S duty to indemnify herein shall not be limited by any limitation on the type or amount of damages payable by or for CONTRACTOR or any Subcontractor under workman's compensation acts, disability benefit acts or any other employee benefit acts.

In addition, the CONTRACTOR likewise covenants and agrees to, and does hereby, indemnify and hold harmless the OWNER from and against any and all injuries, loss or damages to property of the OWNER during the performance of any of the terms and conditions of this Contract, arising out of or in connection with or resulting from, in whole or in part, any and all alleged acts or omissions of officers, agents, servants, employees, contractors, subcontractors, licenses or invitees of the CONTRACTOR.

The rights and responsibilities provided in this indemnification provision shall survive the termination or completion of this Contract.

## 1.29 CONSTRUCTION SCHEDULE

1. The time for completion is set forth herein and will be included in the Contract. All work shall be completed within the consecutive calendar day count shown in the Contractor's bid. The calendar day count shall commence ten (10) consecutive calendar days after the date of the Notice to Proceed.
2. Prior to the issuance of the Notice to Proceed by Owner, the Contractor shall submit a detailed progress and schedule chart to Owner for review. This chart will be used to assure completion of the job within the number of consecutive calendar days stated in bid documents.

## 1.30 DELAYS AND EXTENSIONS OF TIME

1. If the Contractor is delayed at any time in the commencement or progress of the Work by an act or neglect of the Owner or Engineer, or of an employee of either, or of a separate contractor employed by the Owner, or by changes ordered in the Work, or by labor disputes, fire, unusual delay in deliveries, unavoidable casualties or other causes beyond the Contractor's control, or by delay authorized by the Owner pending mediation and arbitration, or by other causes which the Engineer determines may

justify delay, then the Contract Time shall be extended by Change Order for such reasonable time as the Engineer may determine.

2. If adverse weather conditions are the basis for a Claim for additional time, such Claim shall be documented by data substantiating that weather conditions were abnormal for the period of time and could not have been reasonably anticipated, and that the weather conditions had an adverse effect on the scheduled construction.
3. Contractor's sole remedy for any delays in the project, which are not the fault of the Contractor, shall be an equitable extension of time to perform the work, required by the Contract. In no event shall the Contractor be entitled to make a claim for delay, impact or acceleration damages against the Owner.

### 1.31 DAMAGES

Should the contractor fail to complete the project within the specified completion schedule the sum of Five hundred dollars (\$500.00) per calendar day will be deducted from the moneys due the contractor for the work. This sum shall not be considered as a penalty, but rather as reasonable liquidated damages, since it would be impracticable or extremely difficult to fix the actual damages. An extension of time may be allowed for delays beyond the control of the contractor at the discretion of Owner.

### 1.32 TERMINATION

This contract shall remain in effect until any of the following occurs:

1. completion of project;
2. acceptance of work ordered; or
3. termination by either party pursuant to the terms of the Contract with a thirty (30) days written notice prior to cancellation that must state therein the reasons for such cancellation.
4. breach of the contract by the Contractor for failure
  - i. to meet completion schedules, or
  - ii. otherwise perform in accordance with these specifications.

Breach of contract or default authorizes the County to purchase elsewhere and charge the full increase in cost and handling to the defaulting Contractor.

### 1.33 PATENTS - COPYRIGHTS

1. The contractor agrees to protect Owner from any claims involving infringements of patents and/or copyrights. In no event shall Owner be liable to a contractor for any/all suits arising on the grounds of patent(s) or copyright(s) infringement.

### 1.34 VENUE; GOVERNING LAW

1. This contract will be governed by the laws of the State of Texas. Should any portion of this contract be in conflict with the laws of the State of Texas, the State laws shall invalidate only that portion. The remaining portion of the contract shall remain in effect. This contract is performable in Collin County, Texas.

### 1.35 ASSIGNMENT

1. The contractor shall not sell, assign, transfer or convey this contract, in whole or in part, without the prior written approval from Collin County Commissioners Court.

### 1.36 SILENCE OF SPECIFICATION

1. The apparent silence of any part of the specification as to any detail or to the apparent omission from it of a detailed description concerning any point, shall be regarded as meaning that only the best commercial practices are to prevail. All interpretations of the specification shall be made on the basis of this statement.

### 1.37 PROVISION CONCERNING ESCALATOR CLAUSES

1. Bid(s) containing any condition which provides for changes in the stated bid prices due to increase or decrease in the costs of materials, labor, or other items required for this project, will be rejected and returned to the bidder without being considered.

### 1.38 ESTIMATES OF QUANTITIES

1. The quantities listed in the Bid Form will be considered as approximate and will be used for the comparison of bids. Payments will be made to the Contractor only for the actual quantities of work performed or materials furnished in accordance with the contract. The quantity of work to be done and the materials may be increased or decreased as provided for in the Contract Documents.

### 1.39 TREE PROTECTION OUTSIDE LIMITS OF WORK

1. The Contractor will be required to obtain written authorization from Owner for the removal of any tree three inches (3") in diameter or greater for any area outside the limits of the street right-of-way or slope easement. It is the intent of Owner to preserve as much as possible the natural condition of the floodplains.

### 1.40 EXCAVATION/TRENCH SAFETY

1. TRENCH SAFETY

- i. The CONTRACTOR shall be responsible for complying with state laws and federal regulations relating to trench safety, including those which may be enacted during the performance under this contract. The CONTRACTOR shall be responsible for selecting an appropriate method of providing trench safety after due consideration of the job conditions, location of utilities, pavement conditions and other relevant factors. Slope-back methods which may result in unnecessary displacement of utilities and/or destruction of pavement may not be used without permission from the OWNER. The CONTRACTOR shall be responsible for providing to the OWNER an acceptable trench safety plan signed and sealed by a Professional Engineer qualified to do such work and registered in Texas. Devices used to provide trench safety such as trench shields and shoring systems will be likewise certified by professional Engineers registered in the State of Texas or by a professional Engineer registered in the state of manufacture of the shield.

## 2. PAYMENT FOR TRENCH SAFETY

- i. Payment for trench safety shall be by the lineal feet of trench exceeding a depth of five (5) ft. Excavation for slope-back methods shall be subsidiary to the trench safety pay item including replacement and recompaction. Excess excavation for other trench safety methods is also subsidiary to the trench safety pay item. Costs relating to the preparation of the trench safety plan including geotechnical investigation, testing and report preparation fees are all subsidiary to the pay item for trench safety. Should trench safety measures be required during contract performance where no pay item has been provided, then the CONTRACTOR shall immediately notify the OWNER and, if directed to do so, provide trench safety under the provisions of the contract. Should the OWNER fail to authorize the work, then the CONTRACTOR shall proceed under the provisions of the Contract. Trench safety requirements are mandatory and may not be waived.

## 3. PAYMENT FOR SPECIAL SHORING

- i. Payment for special shoring, if any, shall be based on the square feet of shoring used.

4. The Contractor must be made aware that on construction projects in which trench excavation will exceed a depth of five feet (5'), the uniform set of general conditions must require that the bid documents and the contract include detailed plans and specifications for adequate safety systems that meet Occupational Safety and Health Administration standards that will be in effect during the period of construction of the project. The Contractor shall provide a separate pay item for trench excavation safety in accordance with the Texas Health & Safety Code Chapter 756. The Contractor shall verify that these plans and specifications include a pay item for these same trench excavation safety systems, in accordance with Texas Government Code, Title 10, Section 2166.303, Uniform Trench Safety Conditions. The contractor shall insure that drainage from adjacent properties is not blocked by his/her excavations. Measurement and payment for excavation/trench safety systems will not be made directly, but considered subsidiary to the work.

5. The Contractor shall be responsible for obtaining and paying for all surveys and testing, including geotechnical surveys and testing, necessary to insure it can comply with all laws regarding adequate trench excavation safety.

#### 1.41 CONSTRUCTION STAKING

1. Engineer will provide the Contractor with primary horizontal and vertical control to consist of one construction baseline and two benchmarks.
2. The Contractor shall take all necessary precautions to preserve any and/or all markings and staking. Payment for costs of restaking shall be the responsibility of the Contractor.

#### 1.42 PERMITS

1. Contractor shall be responsible for obtaining all necessary permits.

#### 1.43 MATERIALS TESTING

1. Owner will be responsible for all materials testing.

#### 1.44 STORM WATER PROTECTION

1. The Contractor shall perform, track, participate, implement, and comply with storm water pollution prevention minimum control measures, protocols, and best management practices (BMP) and ensure that water quality standards are not violated in accordance with all regulations and policies as they apply to the Texas Pollutant Discharge Elimination System general permits. Applicable permits include:
  - 1) Texas Construction General Permit (TXR150000).
2. Contractors will obtain permit coverage for construction activities disturbing over one acre of land (total acreage is cumulative across all portions of the project). BMPs include, but are not limited to:
  - i. Preparing and implementing a site-specific Storm Water Pollution Prevention Plan (SWPPP) as outlined in the permit and prior to any soil disturbance.
  - ii. Installing and managing erosion and sediment control.
  - iii. Make available, upon request, permit associated documentation.
  - iv. Practicing spill prevention and good housekeeping.
  - v. Meeting the requirements of the MS4 permit.
3. In addition to the requirements of the Construction General permit (TXR150000), the MS4 permits lists prohibited discharges which will be enforced at the County construction sites whether the operator is the County or a contractor. The following discharges are prohibited:

- i. Wastewater from washout of concrete and wastewater from water well drilling operations, unless managed by an appropriate control;
- ii. Wastewater from washout and cleanout of stucco, paint, from release oils, and other construction materials;
- iii. Fuels, oils, or other pollutants used in vehicle and equipment operation and maintenance;
- iv. Soaps or solvents used in vehicle and equipment washing; and,
- v. Discharges from dewatering activities, including discharges from dewatering of trenches and excavations, unless managed by appropriate BMPs.

## 1.45 WAGE SCALE

1. In accordance with Texas Government Code, Title 10, Section 2258, Prevailing Wage Rates, the general prevailing wage rate has been determined for this locality for the craft or type of workman needed to execute work of a similar character of the project listed herein. The Contractor shall pay the prevailing wage rate in this locality to all his/her employees and subcontractors performing work on this project, and in no event shall the Contractor pay less than the rate shown in the following schedule.
2. Wage Determination: <https://sam.gov/wage-determination/TX20250239/3>
3. Except for work on legal holidays, the “General Prevailing Rate of Per Diem Wage” for the various crafts or type of workers or mechanics is the product of (a) the number of hours worked per day, except for overtime hours, times (b) the above respective rate per hour.
4. For legal holidays, the “General Prevailing Rate of Per Diem Wage” for the various crafts or type of workers or mechanics is the product of (a) one and one-half times the above respective rate per hour, times (b) the number of hours worked on the legal holiday.
5. For overtime work, the “General Prevailing Rate of Per Diem Wage” for the various crafts or type of workers or mechanics is the product of (a) one and one-half times the above respective rate per hour, times (b) Under the provisions of Texas Government Code, Title 10, Section 2258, Prevailing Wage Rates, the contractor or subcontractor of the contractor shall forfeit as a penalty to the entity on whose behalf the contract is made or awarded, sixty dollars (\$60.00) for each calendar day, or portion thereof, that the worker is paid less than the wage rates stipulated in the contract.
6. If the construction project involves the expenditure of Federal funds in excess of \$2,000, the minimum wages to be paid various classes of laborers and mechanics will be based upon the wages that will be determined by the Secretary of Labor to be prevailing for the corresponding classes of laborers and mechanics employed on the project of a character similar to the contract work.

## 1.46 CONTRACT ADMINISTRATOR

1. Collin County Purchasing Department shall serve as Contract Administrator or shall supervise agents designated by Collin County.

#### 1.47 WARRANTIES

1. All warranties shall be stated as required in the Uniform Commercial Code.

#### 1.48 UNIFORM COMMERCIAL CODE

1. The Contractor and Collin County agree that both parties have all rights, duties, and remedies available as stated in the Uniform Commercial Code.

#### 1.49 ADVERTISEMENT OF CONTRACT

1. Contractor shall not fraudulently advertise, publish or otherwise make reference to the existence of a contract between Collin County and Contractor for purposes of solicitation. As exception, Contractor may refer to Collin County as an evaluating reference for purposes of establishing a contract with other entities.

#### 1.50 DIAGNOSTIC TOOLS

1. Contractor shall provide Collin County with diagnostic access tools at no additional cost to Collin County, for all Electrical and Mechanical systems, components, etc., procured through this contract.

#### 1.51 CRIMINAL HISTORY BACKGROUND CHECK

1. If required, ALL individuals may be subject to a criminal history background check performed by Collin County prior to access being granted to Collin County facilities. Upon request, Vendor/Contractor/Provider shall provide list of individuals to Collin County Purchasing Department within five (5) working days.

#### 1.52 IMMIGRATION AND REFORM ACT OF 1986

1. Vendors/Contractors/Providers must be in compliance with the Immigration and Reform Act of 1986 and all employees specific to this solicitation must be legally eligible to work in the United States of America.

#### 1.53 CERTIFICATION OF ELIGIBILITY

1. This provision applies if the anticipated Contract exceeds \$100,000.00 and as it relates to the expenditure of federal grant funds. By submitting a bid or proposal in response to this solicitation, the Bidder/Quoter/Offeror certifies that at the time of submission, he/she is not on the Federal Government's list of suspended, ineligible, or debarred contractors. In the event of placement on the list between the time of bid/proposal submission and time of award, the Bidder/Quoter/Offeror will

notify the Collin County Purchasing Agent. Failure to do so may result in terminating this contract for default.

## 1.54 NOTICE TO CONTRACTORS (IF APPLICABLE)

1. The Collin County Detention Facility houses persons who have been charged with and/or convicted of serious criminal offenses. When entering the Detention Facility, you could:
  - i. hear obscene or graphic language;
  - ii. view partially clothed male inmates;
  - iii. be subjected to verbal abuse or taunting;
  - iv. risk physical altercations or physical contact, which could be minimal or possibly serious;
  - v. be exposed to communicable or infectious diseases;
  - vi. be temporarily detained or prevented from immediately leaving the Detention Facility in the case of an emergency or “lockdown; and
  - vii. subjected to a search of your person or property.

While the Collin County Sheriff’s Office takes every reasonable precaution to protect the safety of visitors to the Detention Facility, because of the inherently dangerous nature of a Detention Facility and the type of the persons incarcerated therein, please be advised that the possibility of such situations exist and you should carefully consider such risks when entering the Detention Facility. By entering the Collin County Detention Facility, you acknowledge that you are aware of such potential risks and willingly and knowingly choose to enter the Collin County Detention Facility.

## 1.55 E-Verify

1. Contractors doing business with OWNER agree to comply with Federal Executive Order 13465 E-Verify. It is OWNER’s intention and duty to comply and support the Immigration and Nationality Act (INA) which includes provisions addressing employment eligibility, employment verification and non-discrimination. According to the INA, contractors/employers may hire only persons who may legally work in the United States. Subsequently, contractors and subcontractors doing business with OWNER must confirm their enrollment in the E-Verify system which verifies employment eligibility through completion and checking of I-9 forms. OWNER reserves the right to audit contractors’ process to verify enrollment compliance.

## 1.56 INSURANCE REQUIREMENTS

1. CONTRACTOR’S INSURANCE

- i. Everything that follows under insurance requirements is applicable to all subcontractors. Contractor will have discretion to determine coverage limits for its subcontractors for the required insurances.
- ii. Before commencing work, the CONTRACTOR shall be required to furnish the Collin County Purchasing Agent with certified copies of all insurance certificate(s) required by Texas Law, and the coverages required herein, indicating the coverage is to remain in force throughout the term of this Contract. CONTRACTOR shall also be required to furnish the Collin County Purchasing Agent with certified copies of subcontractor's insurance certificates required by the Texas Department of Insurance, Division of Workers' Compensation, section 406.096(b), and coverages required herein in section 4.2. Without limiting any of the other obligations or liabilities of the CONTRACTOR, during the term of the Contract the CONTRACTOR and each subcontractor at their own expense shall purchase and maintain the herein stipulated minimum insurance with companies duly approved to do business in the State of Texas and satisfactory to the OWNER. Certificates required of each policy for the CONTRACTOR and each subcontractor shall be delivered to the OWNER before any work is started, along with a written statement from the issuing company stating that said policy shall not be canceled, nonrenewed or materially changed without 30 days advance written notice being given to the OWNER.
- iii. In addition to any coverage required by Texas Law, the CONTRACTOR shall provide the following coverages at not less than the specified amounts:
  - a. Workers Compensation insurance required by Texas Law at statutory limits, including employer's liability coverage of not less than \$1,000,000. In addition to these, the CONTRACTOR must comply with all the requirements of the Texas Department of Insurance, Division of Workers' Compensation; section 406.096(b); (Note: If you have questions concerning these requirements, you are instructed to contact the DWC.)
    - i. By signing this contract or providing or causing to be provided a certificate of coverage, the CONTRACTOR is representing to the OWNER that all employees of the CONTRACTOR and its subcontractors who will provide services on the Project will be covered by workers compensation coverage for the duration of the Project, that the coverage will be based on proper reporting of classification codes and payroll amounts, and that all coverage agreements will be filed with the appropriate insurance carrier or, in the case of a self-insured, with the commission's Division of Self-Insurance Regulation. Providing false or misleading information may subject the CONTRACTOR to administrative penalties, criminal penalties, civil penalties, or other civil actions.
    - ii. The CONTRACTOR'S failure to comply with any of these provisions is a breach of Contract by the Contractor which entitles the OWNER to declare the Contract void if the CONTRACTOR

does not remedy the breach within ten (10) days after receipt of notice of breach from the OWNER.

- b. Broad form commercial general liability insurance, including independent contractor's liability, completed operations and contractual liability, written on an occurrence form, covering, but not limited to, the liability assumed under the indemnification provisions of this contract, fully insuring CONTRACTOR'S and its subcontractors liability for injury to or death of OWNER'S employees and third parties, extended to include personal injury liability coverage with damage to property, with minimum limits as set forth below:
  - i. General Aggregate \$2,000,000
  - ii. Products — Components/Operations Aggregate \$2,000,000
  - iii. Personal and Advertising Injury \$ 1,000,000
  - iv. Each Occurrence \$ 2,000,000
  - v. Contractor's Pollution Liability \$1,000,000/\$3,000,000 (Occurrence Form)
  - vi. The policy shall include coverage extended to apply to completed operations, asbestos hazards (if this project involves work with asbestos) and XCU (explosion, collapse and underground) hazards. The completed operations coverage must be maintained for a minimum of one year after final completion and acceptance of the work, with evidence of same filed with OWNER.
- c. Comprehensive automobile and truck liability insurance, covering owned, hired and non-owned vehicles, with a combined bodily injury and property damage minimum limit of \$1,000,000 per occurrence; or separate limits of \$1,000,000 for bodily injury (per person), \$1,000,000 for bodily injury (per accident) and \$1,000,000 for property damage. Such insurance shall include coverage for loading and unloading hazards.
- d. OWNER'S PROTECTIVE LIABILITY INSURANCE
  - i. CONTRACTOR shall obtain, pay for and maintain at all times during the prosecution of the work under this contract an OWNER'S protective liability insurance policy naming the OWNER as insured for property damage and bodily injury, which may arise in the prosecution of the Work or CONTRACTOR'S operations under this Contract. Coverage shall be on an "occurrence" basis, and the policy shall be issued by the same insurance company that carries the CONTRACTOR'S liability insurance with a combined bodily injury and property damage minimum limit of \$1,000,000 per occurrence and \$2,000,000 aggregate. Owner's Protective Liability Insurance required by Contractor only is acceptable.
- e. "UMBRELLA" LIABILITY INSURANCE

- i. CONTRACTOR shall obtain, pay for and maintain umbrella liability insurance (over Workers Comp, Auto, and General Liability) during the contract term, insuring CONTRACTOR for an amount of not less than \$2,000,000 per occurrence/\$2,000,000 aggregate limit combined limit for bodily injury and property damage that follows from and applies in excess of the primary liability coverages required hereinabove. The policy shall provide “drop down” coverage where underlying primary insurance coverage limits are insufficient or exhausted. OWNER shall be named as an additional insured. Contractor can adjust to lower limits on umbrella liability insurance for its subcontractors.
- f. RAILROAD PROTECTIVE INSURANCE
  - i. When required in the Special Provisions, CONTRACTOR shall obtain, maintain and present evidence of railroad protective insurance (RPI). The policy shall be in the name of the railroad company having jurisdiction over the right-of-way involved. The minimum limit of coverage shall meet the specifications provided by the railroad company. The OWNER shall specify the amount of RPI necessary.
  - g. BUILDER’S RISK
    - i. CONTRACTOR shall obtain, pay for, and maintain builders risk insurance during the contract term, insuring CONTRACTOR for an amount of not less than the total contract amount.
- iv. POLICY ENDORSEMENTS AND SPECIAL CONDITIONS
  - a. Each insurance policy to be furnished by CONTRACTOR shall include the following conditions by endorsement to the policy:
    - i. each policy shall name the OWNER as an additional insured as to all applicable coverage
    - ii. each policy shall require that 30 days prior to the cancellation, nonrenewal or any material change in coverage, a notice thereof shall be given to OWNER by certified mail;
    - iii. the term “OWNER” shall include all past, present or future, authorities, boards, bureaus, commissions, divisions, departments and offices of the OWNER and individual members, elected official, officers, employees and agents thereof in their official capacities and/or while acting on behalf of the OWNER;
    - iv. the policy phrase “other insurance” shall not apply to the OWNER where the OWNER is an additional insured on the policy;
    - v. all provisions of the contract concerning liability, duty and standard of care together with the indemnification provision, shall be underwritten by contractual liability coverage sufficient to include such obligations within applicable policies;

- vi. each policy shall contain a waiver of subrogation in favor of OWNER, and its, past, present and future, officials, employees, and volunteers; and
  - vii. each certificate of insurance shall reference the Project and Contract number, contain all the endorsement required herein, and require a notice to the OWNER of cancellation.
- b. Insurance furnished by the CONTRACTOR shall be in accordance with the following requirements:
- i. any policy submitted shall not be subject to limitations, conditions or restrictions deemed inconsistent with the intent of the insurance requirements to be fulfilled by the CONTRACTOR. The OWNER'S decision thereon shall be final;
  - ii. all policies are to be written through companies duly licensed to transact that class of insurance in the State of Texas with a financial ratings of A+ VII or better as assigned by BEST Rating Company or equivalent; and
  - iii. Surplus lines insurance carriers will be acceptable when surplus lines companies meet all financial requirements and be licensed in their home state. Collin County will take an extra step if a bid comes in to include coverage from a surplus lines carrier to verify if that company is approved by TDI to do business in the state of Texas. Please verify with TDI at the phone number list in below link if your or your proposed surplus lines company is approved before you submit your bid.  
<https://www.tdi.texas.gov/pubs/consumer/cb015.html>; and (d) All liability policies required herein shall be written with an "occurrence" basis coverage trigger.
- c. CONTRACTOR agrees to the following:
- i. CONTRACTOR hereby waives subrogation rights for loss or damage to the extent same are covered by insurance. Insurers shall have no right of recovery or subrogation against the OWNER, it being the intention that the insurance policies shall protect all parties to the Contract and be primary coverage for all losses covered by the policies;
  - ii. Companies issuing the insurance policies and CONTRACTOR shall have no recourse against the OWNER for payment of any premiums or assessments for any deductibles, as all such premiums and deductibles are the sole responsibility and risk of the CONTRACTOR;
  - iii. Approval, disapproval or failure to act by the OWNER regarding any insurance supplied by the CONTRACTOR (or any subcontractors) shall not relieve the CONTRACTOR of full responsibility or liability for damages and accidents as set forth in the Contract Documents. Neither shall the bankruptcy, insolvency or denial of liability by the insurance company exonerate the CONTRACTOR from liability; and

- iv. No special payments shall be made for any insurance that the CONTRACTOR and subcontractors are required to carry; all are included in the Contract Price and the Contract unit prices. Any of such insurance policies required under this section may be written in combination with any of the others, where legally permitted, but none of the specified limits may be lowered thereby.

## 1.57 BUSINESS WITH A FOREIGN ENTITY

1. Vendors/Contractors/Providers must be in compliance with the provisions of Section 2252.152 and Section 2252.153 of the Texas Government Code which states, in part, contracts with companies engaged in business with Iran, Sudan, or Foreign Terrorist Organizations are prohibited. A governmental entity may not enter into a contract with a company that is listed on the Comptroller of the State of Texas website identified under Section 806.051, Section 807.051 or Section 2253.253 which do business with Iran, Sudan or any Foreign Terrorist Organization. This Act is effective September 1, 2017.

## 1.58 FORCE MAJEURE

1. No party shall be liable or responsible to the other party, nor be deemed to have defaulted under or breached this Agreement, for any failure or delay in fulfilling or performing any term of this Agreement, when and to the extent such failure or delay is caused by or results from acts beyond the affected party's reasonable control, including, without limitation: acts of God; flood, fire or explosion; war, invasion, riot or other civil unrest; actions, embargoes or blockades in effect on or after the date of this Agreement; or national or regional emergency (each of the foregoing, a "Force Majeure Event"). A party whose performance is affected by a Force Majeure Event shall give notice to the other party, stating the period of time the occurrence is expected to continue and shall use diligent efforts to end the failure or delay and minimize the effects of such Force Majeure Event.

## 004113 Pricing Table

Line Items

### SECTION 1: COLLIN COUNTY ADULT DETENTION FACILITY - CLUSTER 1 GENERATOR REPLACEMENT AND INSTALLATION

Line Item	Description	Quantity	Unit of Measure	Unit Cost	Total
1.1	Total Material Costs for Adult Detention Facility - Cluster 1 Generator Replacement	1	Lump Sum		
1.2	Total Labor Costs for Adult Detention Facility - Cluster 1 Generator Replacement	1	Lump Sum		
<b>TOTAL</b>					

## 004513 Vendor Submissions

### 1. OpenGov Notice\*

Collin County exclusively uses OpenGov Procurement for the notification and dissemination of all solicitations. The receipt of solicitations through any other means may result in your receipt of incomplete specifications and/or addendums which could ultimately render your bid/proposal non-compliant. Collin County accepts no responsibility for the receipt and/or notification of solicitations through any other means. Please initial.

\*Response required

### 2. Contact Information\*

List the contact name, email address and phone number of the main person(s) Collin County should contact in reference to this solicitation. Contact(s) shall be duly authorized by the company, corporation, firm, partnership or individual to respond to any questions, clarification, and or offers in response to this solicitation.

\*Response required

### 3. Exceptions\*

If you take any exceptions to the specifications, bid lines, sample contracts, other attachments, or any other part of this solicitation as written, you must submit the exception/s as a Question via the public portal before the Question Cutoff Date for County consideration. The County will review and publish a response via OpenGov. If you would like to offer any substitutions, please review the Instruction to Bidders Document 002113, Section 1.07 and submit by separate attachment. Please initial.

\*Response required

### 4. Calendar Days Bid\*

Please state the consecutive calendar days bid from notice to proceed through completion of project.

\*Response required

### 5. Insurance Acknowledgement\*

I understand that the insurance requirements of this solicitation are required and are included in the submitted pricing. The Contractor shall furnish certificates of insurance for both the Contractor and any subcontractor to the Purchasing department if awarded all or a portion of the resulting contract. Please initial.

\*Response required

### 6. Bid Bond Acknowledgement\*

I understand that accompanying this bid, is a certified check, cashier's check or Bid Bond in the amount of five percent (5%) of the total amount bid. Bidders submitting a bid via OpenGov Procurement shall upload a Bid Bond at <https://procurement.opengov.com/portal/collincountytx>. Regardless of delivery method, all Bid Bonds shall be received prior to the bid opening time to be considered.

I understand that the **original** Bid Bond shall be received in the Collin County Purchasing Department no later than close of business on the third working day after the bid opening. **Late receipt of original Bid Bond shall be cause for rejection of bid.** Please initial.

\*Response required

## 7. Bid Bond

### Part 1 (Scanned and Upload)

Cashier's check, certified check, or bid bond payable to the order of the Collin County, TX, of not less **five percent (5%)** of the bid in said amount, payable to the Collin County, TX and signed by the bidder as well as a corporate surety, shall accompany the bid

**Please scan and upload a copy of your bid bond/cashier's check.**

or

### Part 2 (Mail or Hand Deliver)

Bidder must also MAIL or hand deliver bid guarantee with a postmarked date no later than 2:00 pm on Thursday, December 18, 2025 addressed to:

**Collin County Purchasing**  
4600 Community Ave, **Ste. 3160**  
McKinney, TX 75071

Please have the following listed clearly on the outside of the envelope:

1. Bidder Name,
2. Bid Bond" for Generator Replacement for Collin County Adult Detention Facility (CCADF) Cluster 1
3. Contract Number 2026-065
4. Date/time of the bid opening
5. "DO NOT OPEN WITH REGULAR MAIL"

**\*\*\*The Bid shall include the bid bond both uploaded into OpenGov Procurement and hard copy original mailed or hand delivered to the purchasing office no later than the close of business on the third working day after the bid opening, otherwise the bid will be deemed non-responsive.\*\*\***

## 8. Bonding Requirement Acknowledgement\*

I understand that the bonding requirements of this solicitation are required and are included in the submitted pricing. A bond certificate (payment, performance, and/or maintenance) as stated in the specification document shall be submitted to the Purchasing department if I am awarded all or a portion of the resulting contract. Please initial.

\*Response required

## 9. Technology Security Breach Acknowledgement\*

When VENDOR experiences a data breach or unauthorized access to the Collin County Data, VENDOR will immediately notify the End-User Department Director, the Chief Information Officer (CIO), and the Purchasing Agent. Within two weeks of such breach, a detailed notification is required and shall include the nature of the breach, the data comprised, the involving parties, mitigation efforts, and corrective actions to be taken by VENDOR. Unless Collin County or any of their affiliates is directly responsible for such breach, VENDOR shall be solely responsible for all expenses related to any data breach or unauthorized access to the Collin County data and shall be by liable for all damages, fines, to include litigation cost. Except as set forth above, Collin County shall not be responsible for any expense associated with data breaches or unauthorized access while the Collin County Data is residing in VENDOR cloud services.

Yes

No

\*Response required

## 10. Subcontractors\*

State the business name of all subcontractors and the type of work they will be performing under this contract. If you are fully qualified to self-perform the entire contract, please respond with "Not Applicable-Self Perform".

\*Response required

## 11. Reference No. 1\*

List a company or governmental agency, other than Collin County, where these same/like products/services, as stated herein, have been provided. Texas references are preferred. Include the following: Company/Entity, Contact, Address, City/State/Zip, Phone, and E-Mail. It is the responsibility of the Bidder/Proposer to ensure submitted references will be responsive to the County's requests. The County reserves the right to contact references other than those listed, and to consider any information acquired from all references during the evaluation process.

\*Response required

## 12. Reference No. 2\*

List a company or governmental agency, other than Collin County, where these same/like products/services, as stated herein, have been provided. Texas references are preferred. Include the following: Company/Entity, Contact, Address, City/State/Zip, Phone, and E-Mail. It is the responsibility of the Bidder/Proposer to ensure submitted references will be responsive to the County's requests. The County reserves the right to contact references other than those listed, and to consider any information acquired from all references during the evaluation process.

\*Response required

### 13. Reference No. 3\*

List a company or governmental agency, other than Collin County, where these same/like products/services, as stated herein, have been provided. Texas references are preferred. Include the following: Company/Entity, Contact, Address, City/State/Zip, Phone, and E-Mail. It is the responsibility of the Bidder/Proposer to ensure submitted references will be responsive to the County's requests. The County reserves the right to contact references other than those listed, and to consider any information acquired from all references during the evaluation process.

\*Response required

### 14. Preferential Treatment\*

The County of Collin, as a governmental agency of the State of Texas, may not award a contract to a nonresident bidder unless the nonresident's bid is lower than the lowest bid submitted by a responsible Texas resident bidder by the same amount that a Texas resident bidder would be required to underbid a nonresident bidder to obtain a comparable contract in the state in which the nonresident's principal place of business is located or a state in which the nonresident is a resident manufacturer. (Texas Government Code, Title 10, Subtitle F., Chapter 2252, Subchapter A.).

1. Is your principal place of business in the State of Texas?
2. If your principal place of business is not in Texas, in which State is your principal place of business?
3. If your principal place of business is not in Texas, does your state favor resident bidders (bidders in your state) by some dollar increment or percentage?
4. If your state favors resident bidders, state by what dollar amount or percentage.

\*Response required

### 15. Debarment Certification\*

I certify that neither my company nor an owner or principal of my company has been debarred, suspended or otherwise made ineligible for participation in Federal Assistance programs under Executive Order 12549, "Debarment and Suspension," as described in the Federal Register and Rules and Regulations. Please initial.

\*Response required

### 16. Immigration and Reform Act\*

I declare and affirm that my company is in compliance with the Immigration and Reform Act of 1986 and all employees are legally eligible to work in the United States of America. I further understand and acknowledge that any non-compliance with the Immigration and Reform Act of 1986 at any time during the term of this contract will render the contract voidable by Collin County. Please initial.

\*Response required

## 17. Information Regarding Conflicts of Interest

During the 79th Legislative Session, House Bill 914 was signed into law effective September 1, 2015, which added Chapter 176 to the Texas Local Government Code. Recent changes have been made to Chapter 176 pursuant to HB23, which passed the

84th Legislative Session. Chapter 176 mandates the public disclosure of certain information concerning persons doing business or seeking to do business with Collin County, including family, business, and financial relationships such persons may have with Collin County officers or employees involved in the planning, recommending, selecting and contracting of a vendor for this procurement.

For a copy of Form CIQ and CIS: <https://www.ethics.state.tx.us/forms/conflict/>

The vendor acknowledges by doing business or seeking to do business with Collin County that they have been notified of the requirements under Chapter 176 of the Texas Local Government Code and that they are solely responsible for complying with the terms and conditions therein. Furthermore, any individual or business entity seeking to do business with Collin County who does not comply with this practice may risk award consideration of any County contract.

For a listing of current Collin County Officers: <https://www.collincountytx.gov/Contact/county-officials>

At the time of this solicitation being released, the following are known to be involved in the planning, recommending, selecting, and/or contracting for the attached procurement:

Department:

Luis Palma - Facilities Director

Advisors:

Michael Smith, P.E., LEED AP

MD Engineering

1225 W 15th Street

Suite 300

Plano, TX 75075

Purchasing:

Michelle Charnoski, NIGP-CPP, CPPB – Purchasing Agent

Marci Chrismon, CPPB – Assistant Purchasing Agent

Susan Hayes - Senior Buyer

Commissioners Court:

Chris Hill – County Judge

Susan Fletcher – Commissioner Precinct No. 1

Cheryl Williams – Commissioner Precinct No. 2

Darrell Hale – Commissioner Precinct No. 3

Duncan Webb – Commissioner Precinct No. 4

Please complete and upload.

### 18. Confirmation of Conflict of Interest\*

I have read the conflict of interest information above and will file the CIQ form if a conflict exists.

Please confirm

\*Response required

### 19. Disclosure of Certain Relationships\*

Chapter 176 of the Texas Local Government Code requires that any vendor considering doing business with a local government entity disclose the vendor's affiliation or business relationship that might cause a conflict of interest with a local government entity. Subchapter 6 of the code requires a vendor to file a conflict of interest questionnaire (CIQ) if a conflict exists. By law this questionnaire must be filed with the records administrator of Collin County no later than the 7th business day after the date the vendor becomes aware of an event that requires the statement to be filed. A vendor commits an offense if the vendor knowingly violates the code. An offense under this section is a misdemeanor. By submitting a response to this request, the vendor represents that it is in compliance with the requirements of Chapter 176 of the Texas Local Government Code. Please send completed forms to the Collin County County Clerk's Office located at 2300 Bloomdale Rd., Suite 2104, McKinney, TX 75071. Please initial.

\*Response required

### 20. Anti-Collusion Statement\*

Bidder certifies that its Bid/Proposal is made without prior understanding, agreement, or connection with any corporation, firm, or person submitting a Bid/Proposal for the same materials, services, supplies, or equipment and is in all respects fair and without collusion or fraud. No premiums, rebates or gratuities permitted; either with, prior to, or after any delivery of material or provision of services. Any such violation may result in Agreement cancellation, return of materials or discontinuation of services and the possible removal from bidders list. Please initial.

\*Response required

## 21. Disclosure of Interested Parties\*

Section 2252.908 of the Texas Government Code requires a business entity entering into certain contracts with a governmental entity to file with the governmental entity a disclosure of interested parties at the time the business entity submits the signed contract to the governmental entity. Section 2252.908 requires the disclosure form (Form 1295) to be signed by the authorized agent of the contracting business entity, acknowledging that the disclosure is made under oath and under penalty of perjury. Section 2252.908 applies only to a contract that requires an action or vote by the governing body of the governmental entity before the contract may be signed or has a value of at least \$1 million. Section 2252.908 provides definitions of certain terms occurring in the section. Section 2252.908 applies only to a contract entered into on or after January 1, 2016. Please initial.

\*Response required

## 22. Notification Survey\*

In order to better serve our offerors, the Collin County Purchasing Department is conducting the following survey. We appreciate your time and effort expended to submit your bid. Should you have any questions or require more information please call (972) 548-4165. How did you receive notice of this request?

- OpenGov Notification
- Plano Star Courier
- Plan Room
- Collin County Website
- Other

\*Response required

## 23. Critical Infrastructure Affirmation\*

Pursuant to section 2275.0102 of the Texas Government Code, Respondent certifies that neither it nor its parent company, nor any affiliate of Respondent or its parent company, is: (1) majority owned or controlled by citizens or governmental entities of China, Iran, North Korea, Russia, or any other country designated by the Governor under Government Code Section 2275.0103, or (2) headquartered in any of those countries. Please initial.

\*Response required

## 24. Energy Company Boycotts\*

Pursuant to Section 2276.002 of the Texas Government Code, should the contract have a value of \$100,000 or more and the company employs 10 or more full-time employees, Respondent represents and warrants that: (1) it does not, and will not for the duration of the contract, boycott energy companies, and (2) will not boycott energy companies during the term of the contract. If circumstances relevant to this provision change during the course of the contract, Respondent shall promptly notify Agency. Please initial.

\*Response required

## 25. Firearm Entities and Trade Associations Discrimination\*

Pursuant to section 2274.002 of the Texas Government Code, should the contract have a value of \$100,000 or more and the company employs 10 or more full-time employees, Respondent verifies that: (1) it does not have a practice, policy, guidance, or directive that discriminates against a firearm entity or firearm trade association and (2) will not discriminate during the term of the contract against a firearm entity or firearm trade association. If circumstances relevant to this provision change during the course of the contract, Respondent shall promptly notify Agency. Please initial.

\*Response required

## 26. Construction Acknowledgement\*

Bidder, declares that the only person or parties interested in this bid are those principals named herein, that his/her bid is made without collusion with any other person, firm or corporation, that he/she has carefully examined the Contract Documents including the Advertisement for Bids, Instruction to Bidders, Construction Agreement, Specifications and the Drawings, therein referred to and has carefully examined the locations, conditions and classes of materials for the proposed work, and agrees that he/she will provide all the necessary labor, machinery, tools, equipment, apparatus and other items incidental to construction and will do all the work and furnish all the materials called for in the Contract Documents in the manner prescribed therein. Bidder hereby declares that he/she has visited the site of the Work and has carefully examined the Contract Documents pertaining to the Work covered by the above Bid, and he/she further agrees to commence work within ten (10) consecutive calendar days after date of written Notice to Proceed and to substantially complete the work on which he/she has bid within the number of days specified subject to such extensions of time allowed by Specifications. Bidder certifies that the bid prices contained in this bid have been carefully checked and are submitted as correct and final. The prices have been shown in words and figures for each item listed in this bid and it is understood that in the event of a discrepancy, the words shall govern. Please initial.

\*Response required

**004313 BID BOND**

STATE OF TEXAS §  
COUNTY OF COLLIN §

**KNOW ALL MEN BY THESE PRESENTS:**

**THAT** \_\_\_\_\_, a corporation organized and existing under the laws of the State of \_\_\_\_\_, and fully authorized to transact business in the State of Texas, whose address is \_\_\_\_\_ of the City of \_\_\_\_\_ County of \_\_\_\_\_, and State of \_\_\_\_\_, (hereinafter referred to as "Principal"), and \_\_\_\_\_ (hereinafter referred to as "Surety", a corporation organized under the laws of the State of \_\_\_\_\_ and authorized under the laws of the State of Texas to act as surety on bonds for principals, are held and firmly bound unto \_\_\_\_\_ (hereinafter referred to as "Owner") and unto all persons, firms and corporations who may furnish materials for or perform labor upon the buildings, structures or improvements referred to in the attached Contract, in the penal sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_) in lawful money of the United States, for the payment whereof, the said Principal and Surety bind themselves, and their heirs, administrators, executors, successors, and assigns, jointly and severally, firmly by these presents:

**SIGNED, SEALED and DATED** this \_\_\_\_\_ day of \_\_\_\_\_ 202\_\_\_\_\_.

**WHEREAS**, the Principal is herewith submitting its proposal for \_\_\_\_\_.

The condition of the above obligations are such that if the aforesaid Principal shall be awarded the Contract, the said Principal will, within the time required, enter into a Contract and give Bonds, if required, for the faithful performance of the Contract and the prompt payment for labor and materials in the prosecution thereof, then this obligation shall be null and void; otherwise the Principal and Surety will pay unto the OWNER the full penal sum hereof, as liquidated damages, it being difficult and impractical to determine accurately the actual amount of damages occurring to OWNER by reason of Principal's failure to execute said Contract and Bonds.

PROVIDED FURTHER, that if any legal action be filed on this Bond, venue shall lie in \_\_\_\_\_ County, Texas.

The Resident Agent of the Surety for delivery of notice and service of process is:  
Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
Phone Number: \_\_\_\_\_

**WITNESS**

\_\_\_\_\_

**PRINCIPAL**

\_\_\_\_\_  
Printed/Typed Name \_\_\_\_\_  
Title: \_\_\_\_\_  
Company: \_\_\_\_\_  
\_\_\_\_\_  
Address: \_\_\_\_\_  
\_\_\_\_\_

**WITNESS**

\_\_\_\_\_

**SURETY**

\_\_\_\_\_  
Printed/Typed Name \_\_\_\_\_  
Title: \_\_\_\_\_  
Company: \_\_\_\_\_  
\_\_\_\_\_  
Address: \_\_\_\_\_  
\_\_\_\_\_

**NOTE: CERTIFIED COPY OF POWER-OF-ATTORNEY SHOULD BE ATTACHED HERETO.**

**Revised 11/2008**

**SECTION 004325 - PRODUCT SUBSTITUTION REQUEST FORM**

(Must be submitted by date specified in solicitation)

Bidder: \_\_\_\_\_

Project No: \_\_\_\_\_

Project: \_\_\_\_\_

Section: \_\_\_\_\_

Article/ Paragraph: \_\_\_\_\_

Proposed Substitution: \_\_\_\_\_

Manufacturer: \_\_\_\_\_ Address: \_\_\_\_\_

Telephone: \_\_\_\_\_ Proposed Model No.: \_\_\_\_\_

Attached data includes product description, specifications, drawings, photographs, and performance and test data adequate for evaluation of the request; applicable portions of the data are clearly identified.

Attached data also includes a description of changes to the Contract Documents that the proposed substitution will require for its installation.

The undersigned warrants and represents:

- Proposed substitution has been fully investigated and determined to be equal or superior in all respects to specified product.
- Same warranty will be furnished for proposed substitution as for specified product.
- Same maintenance service and source of replacement parts, as applicable, is available.
- Proposed substitution will have no adverse effect on other trades and will not affect or delay progress schedule.
- Proposed substitution does not affect dimensions and functional clearances.
- Payment will be made for changes to building design, including A/E design, detailing, and construction costs caused by substitution.

Submitted By: \_\_\_\_\_

Signed: \_\_\_\_\_

Firm: \_\_\_\_\_

Address: \_\_\_\_\_

Phone: \_\_\_\_\_

**REVIEW & ACTION (Initial)**

\_\_\_\_\_ Substitution approved - Make submittals in accordance with Project Manual requirements.

\_\_\_\_\_ Substitution approved as noted - Make submittals in accordance with Project Manual requirements.

\_\_\_\_\_ Substitution rejected - Use specified materials.

\_\_\_\_\_ Substitution Request received too late - Use specified materials.

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

Supporting Data Attached: \_\_\_ Drawings \_\_\_ Product Data \_\_\_ Samples \_\_\_ Tests \_\_\_ Reports \_\_\_ Other

END OF REQUEST FORM

## CONSTRUCTION AGREEMENT

THIS CONSTRUCTION AGREEMENT is made and entered into by and between \_\_\_\_\_, a \_\_\_\_\_ corporation (hereinafter referred to as “Contractor”), and COLLIN COUNTY, TEXAS, a political subdivision of the State of Texas (hereinafter referred to as “County” or “OWNER”), to be effective from and after the date hereinafter provided.

For and in consideration of the covenants and agreements contained herein, and for the mutual benefits to be obtained hereby, the parties hereto agree as follows:

### CONTRACT SUM

The County shall pay the Contractor in current funds for the performance of the work, subject to additions and deductions by Change orders as provided in the Contract Documents. The contract sum shall be the amount of \_\_\_\_\_ (\$ \_\_\_\_\_).

### EFFECTIVE DATE

This Construction Agreement, having been previously approved by the Commissioners’ Court of Collin County, Texas, shall be effective upon the date of delivery and execution by Contractor, provided the County executes the same within five (5) consecutive calendar days after said delivery and execution by Contractor.

## I. CONTRACT GENERAL PROVISIONS

### 1.1 DEFINITIONS

Words which have well-known technical or construction industry meanings shall have their commonly understood meanings in the Contract Documents, unless a different meaning is stated in the Contract Documents. The following words and expressions, or pronouns used in their place, shall wherever they appear in this contract be construed as follows, unless a different meaning is clear from the context:

**Addendum, Bulletin or Letter of Clarification:** Any additional contract provisions, or change, revisions or clarification of the Contract Documents issued in writing by the OWNER, to prospective bidders prior to the receipt of bids.

**Contract or Contract Documents:** The written agreement covering the performance of the work. The Contract and Contract Documents include this written Construction Agreement between OWNER and CONTRACTOR, Advertisement for Bids, Instructions to Bidders, Requests for Proposal, all Addenda, the Specifications, including the general and supplemental special and technical conditions, Drawings, provisions, plans or working drawings — and any supplemental changes or agreements pertaining to the Work or materials therefor; and bonds and any additional documents incorporated by reference in the above.

**CONTRACTOR:** The person, persons, partnership, firm, corporation, association or organization, or any combination thereof, entering into the contract for the execution of the work, acting directly or through a duly authorized representative.

**Other CONTRACTORS:** Any contractor, other than the CONTRACTOR or his subcontractors, who has a direct contact with the OWNER for work on or adjacent to the site of the work.

**Contract Work or Work:** Everything expressly or impliedly required to be furnished and done by the CONTRACTOR by the Contract Documents.

**Engineer:** The term “Engineer” means the Engineer or his duly authorized representative. The Engineer shall be understood to be the Engineer of the OWNER, and nothing contained in the Contract Documents shall create any contractual or agency relationship between the Engineer and the CONTRACTOR.

**Extra Work:** Work other than that which is expressly or impliedly required by the Contract Documents at the time of the execution of the contract.

**Change Order:** A written order to the CONTRACTOR authorizing and directing an addition, deletion or revision in the work within the general scope of the Contract Documents, or authorizing an adjustment in the Contract Price or the Contract time.

**Contract Price:** The total amount of money payable to the CONTRACTOR under the terms and conditions of the Contract Documents. When used in such context, it may also mean the unit price of an item of work under the Contract terms.

**OWNER’S Representative:** The Engineer or other duly authorized assistant, agent, engineer, inspector or superintendent acting within the scope of their particular duties.

**Drawings or Contract Drawings:** Those drawings that are the graphic and pictorial portions of the Contract Documents showing the design, location and dimensions of the Work, including but not limited to, the plans, elevations, sections, details, schedules, diagrams, any bulletin, or any detailed drawing furnished by the OWNER, pertaining or supplemental thereto.

**Specifications:** Those portions of the Contract Documents that specify the requirements for materials, equipment, systems, standards and workmanship for performance of the Work, and related services.

**Inspector:** Any representative of the OWNER designated to inspect the work.

**Materialman or Supplier:** Any subcontractor contracting with the CONTRACTOR, or any of his subcontractors, to fabricate or deliver or who actually fabricates or delivers materials, supplies or equipment to be consumed or incorporated into the Work.

**Notice:** Written notice effective the date of the postmark thereon, or if hand delivered, effective the date of hand delivery.

**OWNER:** COLLIN COUNTY, TEXAS, a political subdivision of the State of Texas. The term OWNER means the OWNER or its authorized representative.

**Payment Bond:** A bond in the amount of the Contract executed by a corporate surety in accordance with all Texas Law, including but not limited to, Chapter 2253 of the Texas Government Code and Chapter 3503 of the Texas Insurance Code, for public works projects as security furnished by the CONTRACTOR and his sureties solely for the protection of payment bond beneficiaries supplying labor and materials in the prosecution of the Contract Work.

**Performance Bond:** A bond in the amount of the Contract executed by a corporate surety in accordance with all Texas Law, including but not limited to, Chapter 2253 of the Texas Government Code and Chapter 3503 of the Texas Insurance Code, for public works projects as security furnished by the CONTRACTOR and his sureties solely for the protection of the Owner, conditioned on the faithful performance of the Contract Work in accordance with the plans, specification, and Contract Documents.

**Maintenance Bond:** A bond executed by a corporate surety for 10% of the Contract Price that complies with all Texas Laws, including but not limited to, Chapter 3503 of the Texas Insurance Code, guaranteeing the prompt, full and faithful performance of the general guaranty and warranty contained in the Contract Documents, and Texas Law.

**Project:** The total construction of the work described in the Contract Documents performed by the Contractor, Other Contractor or the Owner in whole or part.

**Proposal:** The written statement or statements duly submitted to the OWNER by the person, persons, partnership, company, firm, association or corporation proposing to do the Work contemplated, including the approved form on which the formal bids for the Work are to be proposed.

**Plan, or Plans:** The plans are the drawings or reproductions therefrom made by the Owner or Owner's Representative and approved by the Owner showing the dimensions, location, design and position of the various elements of the Project and Work, including plans, elevations, sections, details, schedules, diagrams, working drawings, preliminary drawings, and such supplemental drawings as the Owner may issue to clarify other drawings or for the purpose of showing changes in the Contract Work authorized by the Owner, or for showing details not shown therein.

**Special Provisions or Conditions:** The special clauses of the Contract, or Contract Documents, setting forth conditions or requirements peculiar to the specific Project involved, supplementing the standard or general specifications and taking precedence over any conditions or requirements of the standard or general specifications with which they are in conflict.

**Specifications or Contract Specifications:** All of the general, special and technical conditions or provisions, and all addendum or supplements thereto consisting of written requirements for materials, equipment, systems, standards and performance of the work.

**Site:** The area upon or in which the CONTRACTOR'S operations are carried on, and such other areas adjacent thereto as may be designated as such by the OWNER.

**Subcontractors:** Any persons, firm or corporation, other than employees of the CONTRACTOR, who or which contracts with the CONTRACTOR to furnish, or who actually furnishes, labor and/or materials and equipment at or about the site.

**Sureties:** The corporate bodies which are bound by such bonds as are required with and for the CONTRACTOR. The sureties engaged to be responsible for the entire and satisfactory fulfillment of the Contract and for any and all requirements as set out in the specifications, Contract or plans.

**The Work:** All work including the furnishing of all labor, materials, tools, equipment, required submittals and incidentals to be performed by the CONTRACTOR under the terms of the Contract.

**Directed, Required, Approved and Words of Like Import:** Whenever they apply to the Work or its performance, the words "directed," "required," "permitted," "ordered," "designated," "established," "prescribed" and words of like import used in the Contract, specifications or upon the drawings shall imply the direction, requirement, permission, order, designation or prescription of the OWNER; and "approved," "acceptable," "satisfactory" and words of like import shall mean approved by, acceptable to or satisfactory to the OWNER.

**Equal:** Materials, articles or methods which are of equal or higher quality than those specified or shown on the drawings and as further defined in the "or equal" clause. Substitution of Materials shall be determined by the Engineer at his or her discretion, and approved by the Owner.

**Working Time, Completion Time or Contract Time:** The time set forth in the Contract for the performance and completion of the Work contracted for. The time may be expressed as calendar days, working days or a specific date.

**Calendar Day or Days:** Any successive days of the week or month, no days being excepted.

**Working Day:** A working day is defined as a calendar day not including Saturdays, Sundays or those legal holidays as specified in the list prepared by the OWNER for contract purposes. Nothing in this definition shall be construed as prohibiting the CONTRACTOR from working on Saturdays if he so desires, however permission of the OWNER shall be necessary if the CONTRACTOR chooses to work on Saturday. Work on Sundays shall not be permitted without the written permission of the OWNER. If Saturday or Sunday work is permitted, working time shall be charged on the same basis as week days. Where the working time is expressed as calendar days or a specific date, the concept of working days shall no longer be relevant to the contract.

## CONTRACT DOCUMENTS

- 1.2 The parties agree that the Contract Documents shall consist of the following documents in addition to any other documents referenced or incorporated herein:
- A. This written Construction Agreement, including any changes or modifications;
  - B. All addenda including the following listed and numbered addenda:  
Addendum No. 1 dated \_\_\_\_\_ Received \_\_\_\_\_  
Addendum No. 2 dated \_\_\_\_\_ Received \_\_\_\_\_
  - C. Advertisement for Bids, Instructions to Bidder, the Invitation to Bid and Bid Form;
  - D. The Special/Supplemental Conditions;
  - E. The Specifications and the Project Drawings (if any);
  - F. The Construction Details shown on plans;
  - G. The Standard Specifications and Standard Drawings from the Public Works Construction Standards-North Central Texas Council of Governments, 2004 edition and all subsequent addendums;
  - H. The Texas Department of Transportation Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges, as adopted by the Texas Department of Transportation on November 1, 2014, hereinafter referred to as the "Texas Standard Specifications";
  - I. The Performance Bond in the sum of ONE HUNDRED PERCENT (100%) of the total Contract Price;
  - J. The Payment Bond in the sum of ONE HUNDRED PERCENT (100%) of the total Contract Price; and,
  - K. The Maintenance Bond in the sum of TEN PERCENT (10%) of the total Contract Price.

### 1.2.1 PRIORITY OF THE CONTRACT DOCUMENTS

These Contract Documents (A through K above) form the Construction Agreement and are a part of this Construction Agreement as if fully set forth herein. In the event of an inconsistency in any of the provisions of the Contract Documents, the inconsistency shall be resolved by giving precedence to the Contract Documents in the order in which they are listed above.

### 1.2.2 THE CONTRACT

The Contract Documents form the Contract. The Contract represents the entire integrated agreement between the OWNER and the CONTRACTOR and supersedes all prior negotiations, and representations by either party.

## 1.3 CORRELATION AND INTENT OF DOCUMENTS

The Contract Documents are complementary and what is called for by any one shall be as binding as if called for by all. The intent of the documents, unless otherwise specifically provided, is to produce complete and finished work, which the CONTRACTOR undertakes to do in full compliance with the Contract Documents. It is not intended to mention every item of work in the specifications which can be

adequately shown on the drawings nor to show on the drawings all items of work described or required by the specifications. All materials or labor for work shown on the drawings or reasonably inferable therefrom as being necessary to produce a finished job shall be provided by the CONTRACTOR whether or not same is expressly covered in the specifications. No verbal conversation, understanding or agreement with any officer or employee or agent of the OWNER, either before or after the execution of the Contract, shall affect or modify any of the terms, conditions or obligations contained in the Contract Documents.

#### 1.3.1 CONTRACT DRAWINGS AND SPECIFICATIONS

The OWNER shall furnish the CONTRACTOR one copy of the Contract Drawings and any supplemental drawings and specifications reasonably necessary for the proper execution of the work. At least one copy of all drawings and specifications shall be accessible at all times to the OWNER at the job site.

#### 1.3.2 SUPPLEMENTAL DRAWINGS AND SPECIFICATIONS

In order to carry out the intent of the Contract Documents and to assist the CONTRACTOR in performing its work, the OWNER, after the execution of the Contract, may, by supplemental drawings, specifications or otherwise, furnish additional information or instructions as may be necessary for construction purposes.

All such supplemental drawings, specifications or instructions are intended to be consistent with the Contract Documents and reasonably inferable therefrom. Therefore, no extra costs shall be allowed by the OWNER on a claim that particular supplemental drawings, specifications or instructions differ from the requirements of the Contract Documents, incurring extra costs, unless the CONTRACTOR has first brought the matter, in writing, to the OWNER'S attention for adjustment before proceeding with the work covered by such.

If the OWNER decides that there is no departure from the requirements of the Contract Documents, the CONTRACTOR shall then proceed with the work as shown, specified or directed. If the OWNER shall decide that Extra Work is involved, he shall so modify the supplemental drawings, specifications or instructions to eliminate the Extra Work, or cause a written Change Order to be issued in accordance with the Contract Documents.

#### 1.3.3 ERRORS AND CORRECTIONS IN DRAWINGS AND SPECIFICATIONS

The CONTRACTOR shall not take advantage of any apparent errors, omissions or discrepancies in the drawings or specifications; and the Engineer shall be permitted to make such corrections or interpretations as may be necessary for the fulfillment of the intent of the Contract

Documents. In case of any errors, omissions or discrepancies in the drawings or specifications, the CONTRACTOR shall promptly submit the matter to the OWNER or OWNER'S Representative in writing who, in turn, shall promptly make a determination and issue the necessary instructions in writing. Any adjustment by the CONTRACTOR without this determination and instructions shall be at the CONTRACTOR'S own risk and expense. The Work is to be made complete as intended by the Contract Documents.

#### 1.3.4 EXISTING STRUCTURES

The plans show the general locations of some known surface and subsurface structures. The locations of many gas mains, water mains, conduits, sewers, other utilities, etc., however, are unknown, and the OWNER assumes no responsibility for failure to show any or all of these structures on the plans or to show them in their exact locations. It is mutually agreed that such failure shall not be considered sufficient basis for claims for additional compensation for Extra Work or for increasing the pay quantities in any manner whatsoever. The CONTRACTOR shall be solely responsible for locating all gas mains, water mains, conduits, sewers, other utilities etc., so as to perform the Work without damaging the same.

## II. THE WORK

### 2.1 SCOPE OF WORK

Contractor shall provide all labor, supervision, materials, and equipment necessary to perform all work required by the Contract Documents in connection with **(Bid #, Bid Title)**

### 2.2 CHANGE OR MODIFICATION OF CONTRACT

#### 2.2.1 ALTERATION OF PLANS AND SPECIFICATIONS

The OWNER reserves the right to make such changes in the plans and specifications and in the character of the work as may be necessary or desirable to insure completion in the most satisfactory manner, provided such changes do not materially alter the original plans and specifications or change the general nature of the Work as a whole. Such changes shall not be considered as waiving or invalidating any condition or provision of the Contract or bonds. Such changes shall be issued by the Engineer.

#### 2.2.2 INCREASED OR DECREASED QUANTITIES OF WORK

The OWNER reserves the right and may from time to time, by written order, and without notice to any surety, make changes in the quantity or time of performance of the Work, as may be considered necessary or desirable and such changes shall not be considered as waiving or invalidating any conditions or provisions of the Contract or bonds. The CONTRACTOR shall perform all the Contract Work in strict compliance with the Contract Documents, and shall not make any changes to the Work without prior

written authorization from the OWNER, in the form of a written Change Order. If such changes increase or decrease either the cost or the time necessary for the performance of the Work, then the parties will mutually agree upon an equitable adjustment to the price or time to perform the Work pursuant to the terms of the Contract.

### 2.2.3 EXTRA WORK/CHANGE ORDERS

When any work is necessary to the proper completion of the Project and for which no prices are provided for in the Bid or Proposal and Contract, the CONTRACTOR shall do such work, but only when and as ordered in writing by the OWNER. The OWNER may order changes in the Work without invalidating Contract. Payment for Extra Work shall be made as provided herein. Contractor agrees that overhead and profit for Extra Work shall not exceed 10% of the total cost of the Extra Work. The Contractor shall not be entitled to any additional funds for any work or Extra Work performed on the Project, unless a Change Order is issued and signed by the Owner. The CONTRACTOR shall perform the work as altered, whether increased or decreased, and no allowances shall be made for anticipated profits. Nothing in this section shall give rise to any claims for any delay or acceleration damages, and the CONTRACTORS sole remedy for any delays in the Project shall remain an equitable extension of time as provided for in the Contract Documents. CONTRACTOR acknowledges and agrees to waive all rights or claims for compensation for any additional or other work not specifically authorized by the OWNER.

## 2.3 DISPUTED WORK AND CLAIMS FOR ADDITIONAL COMPENSATION

If the CONTRACTOR is of the opinion that (a) the work necessary or required to accomplish the result intended by this Contract, or (b) any work ordered to be done as Contract Work by the OWNER is Extra Work and not Contract Work, or (c) any determination or order of the OWNER violates the terms and provisions of this Contract, the CONTRACTOR shall promptly, either before proceeding with such work or complying with such order or determination, notify the OWNER in writing of his contentions with respect thereto and request a final determination thereof.

Such determination of the OWNER shall be given in writing to the CONTRACTOR. If the OWNER determines that the work in question is Extra Work and not Contract Work, or that the order complained of requires performance by the CONTRACTOR beyond that required by the Contract or violates the terms and provisions of the Contract, thereupon the OWNER shall cause either (a) the issuance of a written Change Order covering the Extra Work as provided herein, or (b) the determination or order complained of to be rescinded or so modified so as to not require performance beyond that required by the terms and provisions of the Contract.

If the OWNER determines that the work in question is Contract Work and not Extra Work, or that the determination or order complained of does not require performance by the CONTRACTOR beyond that required by the Contract or

violate the terms and provisions of the Contract, he shall direct the CONTRACTOR to proceed, and the CONTRACTOR must promptly comply. In order to reserve his right to claim compensation for such work resulting from such compliance, however, the CONTRACTOR must, within 20 calendar days after receiving the OWNER'S determination and direction, notify the OWNER in writing that the work is being performed, or that the determination and direction is being complied with, under protest.

If the CONTRACTOR fails to so appeal to the OWNER for a determination or, having so appealed, should the CONTRACTOR thus fail to notify the OWNER in writing of his protest, the CONTRACTOR shall be deemed to have waived any claim for extra compensation or damages therefore. No oral appeals or oral protests, no matter to whom made, shall be deemed even substantial compliance with the provisions of this item.

In addition to the foregoing requirements, the CONTRACTOR shall, upon notice from the OWNER, produce for examination for a minimum period of three (3) years following final payment or termination of contract and audit at the CONTRACTOR'S office, by the representatives of the OWNER, all his books and records showing all of his acts and transactions in connection with contractual performance as well as relating to or arising by reason of the matter in dispute. At such examination a duly authorized representative of the CONTRACTOR may be present.

Unless the aforesaid requirements and conditions are complied with by the CONTRACTOR, the OWNER shall be released from all claims arising under, relating to or by reason of disputed work or Extra Work. It is further stipulated and agreed that no conduct on the part of the OWNER or any agent or employee of the OWNER shall ever be construed as a waiver of the requirements of this section, when such requirements constitute an absolute condition precedent to any approval of any claim for extra compensation, notwithstanding any other provisions of the Contract Documents; and in any action against the OWNER to recover any sum in excess of the contract amount, the CONTRACTOR must allege and prove strict compliance with the provisions of this section. The CONTRACTOR ASSUMES THE RISK OF NONPAYMENT, for failing to comply with any of the requirements of this section.

### **III. CONTRACTORS RESPONSIBILITIES**

#### **3.1 CONTRACTOR'S REPRESENTATIONS, WARRANTIES AND ASSURANCES.**

In consideration of, and to induce the award of this contract to him, the CONTRACTOR represents and warrants: (a) That he is financially solvent, and sufficiently experienced and competent to perform the work; (b) That the facts stated in the proposal and the information given by him pursuant to the bidding documents are true and correct in all respects; (c) That he has read, understood and complied with all the requirements set forth in the bidding documents; (d) That he

is familiar with and understands all laws and regulations applicable to the work; and (e) unless otherwise specifically provided for in the Contract Documents, the CONTRACTOR shall do all the Work and shall furnish all the tools, equipment, machinery, materials, labor and appliances, except as herein otherwise specified, necessary or proper for performing and completing the work required by this Contract, in the manner and within the time herein prescribed.

By executing the contract, the CONTRACTOR represents that he has visited the site of Work, has fully familiarized himself with the local and on-site conditions under which the work is to be performed and has correlated his observation with the requirements of the Contract Documents. In addition, the CONTRACTOR represents that he has satisfied himself as to subsurface conditions at the site of the Work. Information, data and representations contained in the Contract Documents pertaining to the conditions at the site, including subsurface conditions, are for information only and are not warranted or represented in any manner to accurately show the conditions at the site of the Work. The CONTRACTOR agrees that he shall make no claims for damages, additional compensation or extension of time against the OWNER because of encountering actual conditions in the course of the Work which vary or differ from conditions or information contained in the Contract Documents. All risks of differing subsurface conditions shall be borne solely by the CONTRACTOR.

The CONTRACTOR shall carefully study and compare the Contract Documents and shall at once report to the OWNER any error, inconsistency or omission he may discover. The CONTRACTOR shall perform no portion of the Work at any time without Contract Documents or, where required, approved shop drawings, product data or samples for such portion of the work.

### 3.1.1 SHOP DRAWINGS, PRODUCT DATA AND SAMPLES

A. Shop drawings are drawings, diagrams, schedules and other data specially prepared for the work by the CONTRACTOR or any subcontractor, manufacturer, supplier or distributor to illustrate some portion of the Work.

B. Product data are illustrations, standard schedules, performance charts, instructions, brochures, diagrams and other information furnished by the CONTRACTOR to illustrate a material, product or system for some portion of the work.

C. Samples are physical examples which illustrate materials, equipment or workmanship and establish standards by which the work shall be judged.

D. the CONTRACTOR shall provide, review, approve and submit to the Engineer with reasonable promptness and in such sequence as to cause no delay in the Work or in the work of the OWNER or any separate contractor, all shop drawings, product data and samples required by the Contract Documents. The Work will be performed in accordance with submittals

approved by the Engineer. The CONTRACTOR shall not be relieved responsibility for deviations from the requirements of the Contract Documents by errors or omissions by the OWNER or Engineer in approving Shop Drawings, Product Data, samples or any other submittals.

E. By approving and submitting shop drawings, product data and samples, the CONTRACTOR represents that he has determined and verified all materials, field measurements, and field construction criteria related thereto, or shall do so, and that he has checked and coordinated the information contained within such submittals with the requirements of the Work and of the Contract Documents.

F. As the Engineer's review is only for general conformance with the requirements of the Contract Documents, the CONTRACTOR shall not be relieved of responsibility for any deviation from the requirements of the Contract Documents by the Engineer's approval of shop drawings, product data or samples unless the CONTRACTOR has specifically informed the Engineer in writing of such deviation at the time of submission and the Engineer have given written approval to the specific deviation. The CONTRACTOR shall not be relieved from responsibility for errors or omissions in the shop drawings, product data or samples by the Engineer's approval thereof. The CONTRACTOR shall direct specific attention, in writing or on resubmitted shop drawings, product data or samples, to revisions other than those requested by the Engineer on previous submittals.

G. the CONTRACTOR shall be responsible for delays caused by rejection of the submittal of inadequate or incorrect shop drawings, product data or samples. The CONTRACTOR shall be responsible for seeing that any "approved" copies of shop drawings bearing the approval of the Engineer are allowed on the job site. The CONTRACTOR shall be responsible for providing all copies of approved shop drawings necessary for the construction operations.

H. the CONTRACTOR shall keep adequate records of submittal and approvals so that an accurate up-to-date record file is maintained at the job site at all times.

I. No portion of the work requiring submission of a shop drawing, product data or sample shall be commenced until the submittal has been approved by the Engineer. All such portions of the work shall be in accordance with approved submittals.

### 3.1.2 SURETY BONDS

With the execution and delivery of the contract, the CONTRACTOR shall furnish and file with the OWNER in the amounts herein required, the surety bonds specified hereunder. Without exception, the OWNER'S bond forms, attached hereto as Section 00610 and 00611 must be used, and exclusive

venue for any lawsuit in connection with such bonds shall be specified as the county in which the OWNER'S principal office is located. Such surety bonds shall be in accordance with Texas Law, including but not limited to, the provisions of Chapter 2253 of the Texas Government Code and Chapter 3503 of the Texas Insurance Code. These bonds shall automatically be increased by the amount of any change order or supplemental agreement which increases the contract price with or without notice to the surety, but in no event shall a change which reduces the contract amount reduce the penal amount of such bonds.

A. Performance Bond. A good and sufficient bond in an amount not less than 100 percent (100%) of the total amount of the Contract Price guaranteeing the full and faithful execution of the Work and performance of the Contract in accordance with the plans, specifications and Contract Documents, including any extensions thereof, for the protection of the OWNER. This bond shall provide for the repair and/or replacement of all defects due to faulty materials and workmanship that appear within a period of one year from the date of completion and acceptance of the improvement by the OWNER or such lesser or greater period as may be designated in the Contract Documents.

B. Payment Bond. A good and sufficient bond in an amount not less than 100 percent (100%) of the total amount of the Contract Price guaranteeing the full and proper protection of all payment bond beneficiaries and claimants supplying labor and material in the prosecution of the work provided for in said Contract and for the use of each claimant.

C. Maintenance Bond. A good and sufficient bond in an amount not less than ten percent (10%) of the total amount of the Contract Price guaranteeing the project against defects.

D. Sureties. No sureties shall be accepted by the OWNER who are now in default or delinquent on any bonds or who are interested in any litigation against the OWNER. All bonds shall be made on forms furnished by the OWNER and shall be executed by not less than one corporate surety authorized to do business in the State of Texas and acceptable to the OWNER. The sureties shall be listed in the most current Federal Register Treasury List. Each bond shall be executed by the CONTRACTOR and surety. Each surety shall designate an agent resident in the OWNER'S jurisdictional area acceptable to the OWNER to whom any requisite notices may be delivered and on whom service of process may be had in matters arising out of such suretyship. The OWNER reserves the right to reject any and all sureties.

E. Additional or Substitute Bonds. If at any time the OWNER is or becomes dissatisfied with any surety, then upon the performance or payment bond, the CONTRACTOR shall, within five days after notice from the OWNER to do so, substitute an acceptable bond (or bonds), or provide an additional

bond, in such form and sum and signed by such other surety or sureties as may be satisfactory to the OWNER. The premiums on such bonds shall be paid by the CONTRACTOR without recourse to the OWNER. No further payments under the contract shall be deemed due or payable until the substitute or additional bonds shall have been furnished and accepted by the OWNER.

### 3.1.3 PERMITS AND FEES

The CONTRACTOR shall secure and pay for all building permits and other permits and governmental fees, licenses and inspections necessary for proper execution and completion of the Work which are normally and legally required for the construction of similar projects in the State of Texas. The CONTRACTOR will give all notices required by laws, ordinances, rules, regulations and lawful orders of authorized public authorities required for the proper and legal performance of the Work.

### 3.14 CONTRACT DOCUMENTS AT SITE

The CONTRACTOR shall keep and maintain at the Project site one record copy of the Contract Documents, including but not limited to, the Drawings, Specifications, addenda, Change Orders, submittals, Product Data, Samples and other modifications, in good order and marked to show the current construction of the Project. These documents shall be available to the OWNER or Engineer to review at any time and shall be submitted to the OWNER upon completion of the Project, along with a complete set of as built drawings.

## 3.2 CONTRACTOR'S RESPONSIBILITIES

### 3.2.1 PERFORMANCE OF THE WORK

In addition to those matters elsewhere expressly made the responsibility of the CONTRACTOR, the CONTRACTOR shall have the full and direct responsibility for the performance and completion of the Work under this Contract and for any act or neglect of the CONTRACTOR, his agents, employees or subcontractors. He shall bear all losses, if any, resulting on account of the amount and character of the Work, or because the conditions under which the work must be done are different from what were estimated or anticipated by him, or because of weather, floods, elements or other causes.

### 3.2.2 MEANS AND METHODS OF CONSTRUCTION

Unless otherwise expressly provided in the contract drawings, specifications or bulletins, the means and methods of construction shall be such as the CONTRACTOR may choose; subject, however, to the

OWNER'S right to prohibit means and methods proposed by the CONTRACTOR which in the OWNER'S judgment:

- A. shall constitute a hazard to the Work, or to persons or property, or shall violate express requirements of applicable laws or ordinances; or
- B. shall cause unnecessary or unreasonable inconvenience to the public; or
- C. shall not produce finished work in accordance with the requirements of the Contract Documents; or
- D. shall not assure the Work to be completed within the time allowed by the contract.

The OWNER'S approval of the CONTRACTOR'S means or methods of construction, or the OWNER'S failure to exercise his right to prohibit such means or methods, shall not relieve the CONTRACTOR of his responsibility for the Work or of his obligation to accomplish the result intended by the Contract Documents; nor shall the exercise or non-exercise of such rights to prohibit create a cause of action for damages or provide a basis for any claim by the CONTRACTOR against the OWNER. The CONTRACTOR shall be solely responsible for, the construction means and methods, techniques, sequences, procedures, and for the safety precautions and programs in connection with the Work or the Project.

If the Contract Documents specify any means, methods, techniques, sequences or procedures, the CONTRACTOR shall evaluate said specifications and determine that they are safe for the proper prosecution of the Work. The CONTRACTOR shall be solely responsible for the job site safety of such means, methods, techniques, sequences or procedures. If the CONTRACTOR determines the specified means, methods, techniques, sequences or procedures may not be safe, the CONTRACTOR shall immediately notify the OWNER and Engineer and shall not proceed without further instructions.

### 3.2.3 CONSTRUCTION SCHEDULE

The CONTRACTOR, immediately after being awarded the contract, shall prepare and submit for the OWNER, and Engineer's information an estimated progress schedule for the work. The progress schedule shall be related to the entire Project to the extent required by the Contract Documents and shall provide for expeditious and reasonable execution of the work, not to exceed the time limits for completion provided in the Contract Documents. The progress schedule shall be updated as the Work proceeds or the schedule changes and immediately upon request by the OWNER. The CONTRACTOR shall also prepare a schedule of submittals that allows for a reasonable time for the OWNER or Engineer to review the submittals so as not to delay the Project.

#### 3.2.4 TIME OF PERFORMANCE OF THE WORK

The CONTRACTOR shall begin the work to be performed under this Contract not later than 10 days from the date specified in the purchase or work order and shall conduct the work in such a manner and with sufficient equipment, material and labor as is necessary to insure its completion within the working time. It is the intent of this specification to provide a continuous construction operation without delay except as occasioned by unforeseeable causes beyond the control and without the fault or negligence of the CONTRACTOR, and it shall be the CONTRACTOR's responsibility to execute the work in the most expeditious manner.

Work shall be done only during the regular and commonly accepted and prescribed working hours. No work shall be done on nights, Sundays or regular holidays unless permission is given by the OWNER

Time is of the Essence for the performance of the Work by the CONTRACTOR. CONTRACTOR agrees that the time allotted for the performance of the Work is reasonable.

#### 3.2.5 PERFORMANCE OF EXTRA OR DISPUTED WORK

While the CONTRACTOR or his subcontractor is performing Extra Work in accordance with the OWNER'S written order, the cost of which is to be determined on a time and material basis, or is performing disputed work or complying with a determination or order under protest, the CONTRACTOR shall, on the Monday following the performance of the work, furnish the OWNER'S representative at the site with three copies of verified statements showing:

- A. the name, address and telephone number of each workman employed on such Extra Work or engaged in complying with such determination or order, the character of Extra Work each is doing and the wages paid to him, including the rate and amount of payroll taxes, contributions for insurance, and federal social security; and
- B. the nature, cost and quantity of any materials, plant equipment or construction equipment furnished or used in connection with the performance of such Extra Work or in complying with such determination or order, and from whom purchased or rented, along with copies of invoices for such materials, plant equipment or construction equipment.

The CONTRACTOR and his subcontractors, when required by the OWNER, must also produce for inspection for a minimum period of three (3) years following final payment or termination of contract, produce for examination and audit by designated OWNER representatives, any and all of his books, vouchers, records, daily job diaries and reports, canceled

checks, etc. showing the nature and quantity of labor, materials and equipment actually used in the performance of the Extra Work; the amounts expended therefore; and the costs incurred for insurance premiums and other items of expense directly chargeable to such Extra Work. The CONTRACTOR must permit the OWNER'S representatives to make extracts therefrom or copies thereof as may be desired.

Failure of the CONTRACTOR to comply strictly with the requirements of this section shall constitute a waiver of any claim for extra compensation on account of the performance of such Extra Work.

### 3.3 QUALITY OF WORK

#### 3.3.1 INSPECTION AND TESTS

The CONTRACTOR shall furnish the OWNER with every reasonable accommodation and opportunity to ascertain whether or not the work performed is in accordance with the requirements and intent of the plans and specifications. Any work done or materials used without suitable inspection by the OWNER may be ordered removed and replaced at the CONTRACTOR'S expense. The CONTRACTOR shall not be relieved from his obligations to perform the Work in accordance with the Contract Documents either by the activities or duties of the OWNER in his administration of the contract, or by inspections, tests or approvals required or performed by persons other than the CONTRACTOR.

Unless otherwise provided, the CONTRACTOR shall make arrangements for all tests, inspections and approvals with an independent testing laboratory or entity required by the Contract Documents or by laws, ordinances, rules, regulations or orders of public authorities having jurisdiction over the Work or items to be tested, inspected or approved. If additional testing or inspection is required they shall be performed at the CONTRACTOR'S expense.

#### 3.3.2 REMOVAL OF DEFECTIVE AND UNAUTHORIZED WORK

All work which has been rejected or condemned shall be repaired, or if it cannot be repaired satisfactorily, it shall be removed and replaced at the CONTRACTOR'S expense. Defective materials shall be immediately removed from the site of the work. Work done without line and grade having been given, work done beyond the lines or not in conformity with the grades shown on the plans or as given, save as herein provided, work done without written authority and prior agreement in writing as to process, shall be done at the CONTRACTOR'S risk and shall be considered unauthorized and at the option of the OWNER may be ordered removed at the CONTRACTOR'S expense.

Upon failure of the CONTRACTOR to repair satisfactorily or to remove and replace, if so directed, rejected, unauthorized or condemned work or materials immediately after receiving notice from the OWNER, the OWNER shall, after giving written notice to the CONTRACTOR, have the authority to cause defective work to be remedied or removed and replaced, or to cause unauthorized work to be removed and to deduct the cost thereof from any monies due or to become due the CONTRACTOR. Alternatively, the OWNER may, at its option, declare the CONTRACTOR in default.

### 3.3.3 WORKING AREA; COORDINATION WITH OTHER CONTRACTORS; FINAL CLEANUP

The CONTRACTOR shall confine his equipment, storage of materials and construction operations to the area shown on the contract drawings or stated in the specifications, prescribed by ordinance, laws, or permits or as may be directed by the OWNER, and shall not unreasonably encumber the site or public right-of-way with his construction equipment, plant or materials.

Such area shall not be deemed for the exclusive use of the CONTRACTOR. Other contractors of the OWNER may enter upon and use such portions of the area and for such items as determined by the OWNER are necessary for all purposes required by their contracts. The CONTRACTOR shall give to such other contractors all reasonable facilities and assistance to the end that the work on this and other contracts shall not be unduly or unreasonably delayed. Any additional areas desired by the CONTRACTOR for his use shall be provided by him at his own cost and expense.

The CONTRACTOR is responsible for cutting, fitting or patching any parts of the Work where such work is necessary to make the Work complete, for parts to fit together, or for any damage to the Work prior to Final Acceptance.

The CONTRACTOR shall keep the Project and the surrounding area clean and free from the accumulation of waste materials or trash. Upon completion of the work and before final acceptance and final payment shall be made, the CONTRACTOR shall completely clean and remove from the site of the work surplus and discarded materials, temporary structures and debris of every kind. He shall leave the site of the work in a neat and orderly condition equal to that which originally existed, or as called for in the Contract Documents. Surplus and waste materials removed from the site of the work shall be disposed of at locations satisfactory to the OWNER, and at the CONTRACTOR'S sole cost.

## 3.4 LEGAL RESPONSIBILITIES

### 3.4.1. PATENTS AND COPYRIGHTS

The CONTRACTOR shall pay all royalties and license fees and shall provide, by suitable legal agreement with the patentee or owner, for the use of any design, device, material or process covered by letters, patent or any copyright. The CONTRACTOR shall indemnify, defend, hold and save the OWNER and its officers, employees and agents harmless from all liability and claims for infringement of any patent or copyright.

In the event that any claims, suit or action at law or in equity of any kind whatsoever is brought against the OWNER, or its officers, employees or agents involving any such patents, copyrights or license rights, then the OWNER shall have the right to and may retain from any money due or to become due to the CONTRACTOR such sum deemed necessary by the OWNER for its protection until such claim or suit shall have been settled and satisfactory evidence to that effect shall have been furnished the OWNER.

#### 3.4.2 INDEMNIFICATION

To the fullest extent permitted by law, the CONTRACTOR and his sureties shall indemnify, defend and hold harmless the OWNER and all of its, past, present and future, officers, agents and employees from all suits, cause of action, claims, liabilities, losses, fines, penalties, liens, demands, obligations, actions, proceedings, of any kind, character, name and description brought or arising, on account of any injuries or damages received or sustained by any person, destruction or damage to any property on account of, in whole or part, the operations of the CONTRACTOR, his agents, employees or subcontractors; or on account of any negligent act or fault of the CONTRACTOR, his agents, employees or subcontractors in the execution of said Contract; failing to comply with any law, ordinance, regulation, rule or order of any governmental or regulatory body including those dealing with health, safety, welfare or the environment; on account of the failure of the CONTRACTOR to provide the necessary barricades, warning lights or signs; and shall be required to pay any judgment, with cost, which may be obtained against the OWNER growing out of such injury or damage. In no event shall OWNER be liable to CONTRACTOR for indirect or consequential damages or loss of income or profit irrespective of the cause, fault or reason for same. CONTRACTOR'S duty to indemnify herein shall not be limited by any limitation on the type or amount of damages payable by or for CONTRACTOR or any Subcontractor under workman's compensation acts, disability benefit acts or any other employee benefit acts.

In addition, the CONTRACTOR likewise covenants and agrees to, and does hereby, indemnify and hold harmless the OWNER from and against any and all injuries, loss or damages to property of the OWNER during the performance of any of the terms and conditions of this Contract, arising out of or in connection with or resulting from, in whole or in part, any and all

alleged acts or omissions of officers, agents, servants, employees, contractors, subcontractors, licenses or invitees of the CONTRACTOR.

The rights and responsibilities provided in this indemnification provision shall survive the termination or completion of this Contract.

### 3.5 SUPERVISION AND CONSTRUCTION PROCEDURES

#### 3.5.1. SUPERVISION BY CONTRACTOR

The status of the CONTRACTOR is that of an independent CONTRACTOR under Texas law and the work under this Contract shall be under the direct charge and superintendence of the CONTRACTOR. Except where the CONTRACTOR is an individual and gives his personal superintendence to the work, the CONTRACTOR shall provide a competent superintendent or general foreman on the work site at all times during progress with full authority to act for the CONTRACTOR. The CONTRACTOR shall also provide an adequate staff for the coordination and expediting of the Work.

The superintendent and staff shall be satisfactory to the OWNER. The superintendent or general foreman shall not be changed during this Contract except with the written consent of the OWNER or unless the superintendent or general foreman proves unsatisfactory to the CONTRACTOR and ceases to be in his employ.

If the superintendent should be or become unsatisfactory to the OWNER, he shall be replaced by the CONTRACTOR upon written direction of the OWNER, and in such event, the CONTRACTOR shall not be entitled to file a claim for any additional working time or money from the OWNER.

#### 3.5.2 EMPLOYEES

The CONTRACTOR shall employ only competent, efficient workmen and shall not use on the work any unfit person or one not skilled in the work assigned to him and shall at all times maintain good order among its employees. Whenever the OWNER shall inform the CONTRACTOR in writing that, in his opinion, any employee is unfit, unskilled, disobedient, or is disrupting the orderly progress of the work, such employee shall be removed from the work and shall not again be employed on it. Under urgent circumstances, the OWNER may orally require immediate removal of an employee for cause, to be followed by written confirmation.

The CONTRACTOR shall supervise and direct all the work, using his best skill and attention. He shall be solely responsible for all construction means, methods, techniques, sequences, procedures and safety procedures and for coordinating all portions of the Work under the Contract. The

CONTRACTOR shall be responsible to the OWNER for the acts and omissions of his employees, subcontractors and their agents, employees and subcontractors performing any of the work under a contract with the CONTRACTOR.

3.5.3 LABOR AND MATERIALS

Unless otherwise provided in the Contract Documents, the CONTRACTOR shall provide and pay for all labor, materials, equipment, tools, construction equipment and machinery, water, heat, utilities, transportation and other facilities and services necessary for the proper execution and completion of the work, whether temporary or permanent and whether or not incorporated or to be incorporated into the work.

The CONTRACTOR shall at all times enforce strict discipline and good order among his employees and shall not employ on the work site any unfit person or anyone not skilled in the task assigned to him.

The rate of progress shall be such that the whole work shall be performed and the premises cleaned up in accordance with the Contract within the working time established in the Contract, unless an extension of time is made in the manner hereinafter specified.

3.5.4 WAGE SCALE

In accordance with The Texas Government Code, Title 10, Chapter 2258, Prevailing Wage Rates, the general prevailing wage rate has been determined for this locality for the craft or type of workman needed to execute work of a similar character of the project listed herein. The Contractor shall pay the prevailing wage rate in this locality to all his/her employees and subcontractors performing work on this project, and in no event shall the Contractor pay less than the rate shown in the following schedule.

\*Most current Wage Scale from before close of bidding downloaded from SAM.Gov to be inserted here\*

=====

END OF GENERAL DECISION

Except for work on legal holidays, the “General Prevailing Rate of Per Diem Wage” for the various crafts or type of workers or mechanics is the product of (a) the number of hours worked per day, except for overtime hours, times (b) the above respective rate per hour.

For legal holidays, the “General Prevailing Rate of Per Diem Wage” for the various crafts or type of workers or mechanics is the product of (a) one and one-half times the above respective rate per hour, times (b) the number of hours worked on the legal holiday.

For overtime work, the “General Prevailing Rate of Per Diem Wage” for the various crafts or type of workers or mechanics is the product of (a) one and one-half times the above respective rate per hour, times (b) the number of hours worked on overtime.

Under the provisions of Texas Government Code, Title 10, Chapter 2258, Prevailing Wage Rates, the contractor or subcontractor of the contractor shall forfeit as a penalty to the entity on whose behalf the contract is made or awarded, sixty dollars (\$60.00) for each calendar day, or portion thereof, that the worker is paid less than the wage rates stipulated in the contract.

If the construction project involves the expenditure of Federal funds in excess of \$2,000, the minimum wages to be paid various classes of laborers and mechanics will be based upon the wages that will be determined by the Secretary of Labor to be prevailing for the corresponding classes of laborers and mechanics employed on the project of a character similar to the Contract Work.

- 3.5.5 Contractors doing business with OWNER agree to comply with Federal Executive Order 13465 E-Verify. It is OWNER’S intention and duty to comply and support the Immigration and Nationality Act (INA) which includes provisions addressing employment eligibility, employment verification and non-discrimination. According to the INA, contractors/employers may hire only persons who may legally work in the United States. Subsequently, contractors and subcontractors doing business with OWNER must confirm their enrollment in the E-Verify system which verifies employment eligibility through completion and checking of I-9 forms. OWNER reserves the right to audit contractors process to verify enrollment compliance.

### 3.5.6 COMPLIANCE WITH LAWS

The CONTRACTOR shall fully comply with all local, state and federal laws, including all codes, ordinances and regulations applicable to this Contract and the Work to be done thereunder, which exist or which may be enacted later by governmental bodies having jurisdiction or authority for such enactment.

All work required under this Contract is intended to comply with all requirements of law, regulation, permit or license. If the CONTRACTOR finds that there is a variance, he shall immediately report this to the OWNER for resolution.

#### 3.5.6.1 EQUAL EMPLOYMENT OPPORTUNITY

The CONTRACTOR shall comply with all local, state and federal employment and discrimination laws and shall not discriminate against any employee or applicant for employment because of race, color, religion, sex, age, national origin or any other class protected by law.

### 3.5.7 RAILWAY CROSSINGS

Where the Work encroaches upon any right-of-way of any railway, the OWNER shall secure the necessary easement for the work. Where railway tracks are to be crossed, the CONTRACTOR shall observe all the regulations and instructions of the railway company as to methods of doing the work or precautions for safety of property and the public. All negotiations with the railway company, except for right-of-way, shall be made by the CONTRACTOR. The railway company shall be notified by the CONTRACTOR not less than five days prior to commencing the work. The CONTRACTOR shall not be paid separate compensation for such railway crossing but shall receive only the compensation as set out in the proposal.

#### 3.5.8 OTHER CONTRACTORS; OBLIGATION TO COOPERATE

The OWNER reserves the right to perform construction on the Project with its own forces or may award other contracts for additional work on this Project, and the CONTRACTOR shall fully cooperate with such other contractors and shall coordinate and fit his work to be done hereunder to such additional work as may be contracted by the OWNER. The CONTRACTOR shall not commit or permit any act which shall interfere with the performance of work by any other contractor.

Upon receiving written notice from the CONTRACTOR that the OWNER or another contractor is failing to coordinate his work with the Work under this Contract as directed by the OWNER, the OWNER shall promptly investigate the charge and take such necessary action as the situation may require. However, the OWNER shall not be liable to the CONTRACTOR for damages suffered by the CONTRACTOR due to the fault or negligence of another contractor or through failure of another contractor to carry out the directions of the OWNER. Should any interference occur between contractors, the Engineer may furnish the CONTRACTOR with written instructions designating priority of effort, whereupon the CONTRACTOR shall immediately comply with such direction. In such event, the CONTRACTOR shall be entitled to an extension of working time only for unavoidable delays verified by the Engineer; however, no increase in the Contract Price shall be due the CONTRACTOR.

#### 3.5.9 SUBCONTRACTS

The CONTRACTOR shall not make any subcontract for performing any portion of the Work included in the contract without written notice to the OWNER. This contract having been made pursuant to the bid submitted by the CONTRACTOR and in reliance with the CONTRACTOR'S personal qualifications and responsibility, the OWNER reserves the right to withhold approval of any subcontractor which the OWNER may deem would not be in the OWNER'S best interest.

The CONTRACTOR shall, as soon as practicable after signing the Contract, submit a separate written notice to the OWNER identifying each proposed subcontractor. Upon request of the OWNER, the CONTRACTOR shall promptly furnish additional information tending to establish that any proposed subcontractor has the necessary facilities, skill, integrity, past experience and financial resources to perform the work in accordance with the terms and conditions of this Contract.

If the OWNER determines that any proposed subcontractor is unacceptable, he shall so notify the CONTRACTOR, who may thereupon submit another proposed subcontractor unless the CONTRACTOR decides to do the work himself. Disapproval by the OWNER of any proposed subcontractor shall not provide a basis for any claim by the CONTRACTOR.

If an approved subcontractor fails to properly perform the work undertaken, he shall be removed from the job upon request of the OWNER, following notification to the CONTRACTOR in writing of the request for removal and the reasons therefore.

Each subcontract entered into shall provide that the provisions of this Contract shall apply to such subcontractor and his officers and employees in all respects as if he and they were employees of the CONTRACTOR. The OWNER'S decision not to disapprove of any subcontract shall not relieve the CONTRACTOR of any of his responsibilities, duties and liabilities hereunder. The CONTRACTOR shall be solely responsible for the acts, omissions, negligence or defaults of his subcontractors and of such subcontractor's officers, agents and employees, each of whom shall, for this purpose, be deemed to be the agent or employee of the CONTRACTOR to the extent of his subcontract.

The CONTRACTOR agrees to bind each subcontractor and each subcontractor agrees to be bound by the terms of the Contract Documents insofar as applicable to his work. The CONTRACTOR and each subcontractor jointly and severally agree that nothing in the Contract Documents or otherwise shall create or be deemed to create any rights in favor of a subcontractor against the OWNER; nor shall be deemed or construed to impose upon the OWNER any obligation, liability or duty to a subcontractor; or to create any contractual relation whatsoever between a subcontractor and the OWNER.

The provisions contained herein shall likewise apply to any sub-subcontracts.

## 3.6 PROTECTION OF WORK AND OF PERSONS AND PROPERTY

### 3.6.1 PROTECTION OF WORK

During performance and up to date of final acceptance, the CONTRACTOR shall be under the absolute obligation to protect the finished work against any damage, loss or injury. In the event of such damage, loss or injury, the CONTRACTOR shall promptly replace or repair such work, whichever the OWNER shall determine to be preferable. The obligation to deliver finished work in strict accordance with the Contract prior to final acceptance shall be absolute and shall not be affected by the OWNER'S approval of or failure to prohibit means and methods of construction used by the CONTRACTOR. All risk of loss or damage to the work shall be borne solely by the CONTRACTOR until final completion and acceptance of all work by the OWNER, as evidenced by the OWNER'S issuance of a certificate of acceptance.

### 3.6.2 PROTECTION OF PERSONS AND PROPERTY

The CONTRACTOR shall have the responsibility to provide and maintain all warning devices and take all precautionary measures required by law or otherwise to protect persons and property while said persons or property are approaching, leaving or within the work site or any area adjacent to said work site. No separate compensation shall be paid to the CONTRACTOR for the installation or maintenance of any warning devices, barricades, lights, signs or any other precautionary measures required by law or otherwise for the protection of persons or property.

The CONTRACTOR shall assume all duties owed by the OWNER to the general public in connection with the general public's immediate approach to and travel through the work site and the area adjacent to said work site.

Where the work is carried on in or adjacent to any street, alley, sidewalk, public right-of-way or public place, the CONTRACTOR shall at his own cost and expense provide such flagmen and watchmen and furnish, erect and maintain such warning devices, barricades, lights, signs and other precautionary measures for the protection of persons or property as may be prudent or necessary, or as are required by law. The CONTRACTOR'S responsibility for providing and maintaining flagmen, watchmen, warning devices, barricades, signs and lights and other precautionary measures shall not cease until the project shall have been completed and accepted by the OWNER, and shall cease when the certificate of acceptance is issued by the OWNER pursuant to the Contract Documents.

If the OWNER discovers that the CONTRACTOR has failed to comply with the applicable federal and state law (by failing to furnish the necessary flagmen, warning devices, barricades, lights, signs or other precautionary measures for the protection of persons or property), the OWNER may order the CONTRACTOR to take such additional precautionary measures as required by law to be taken to protect persons and property.

In addition, the CONTRACTOR shall be held responsible for all damages to the work and other public or private property due to the failure of warning devices, barricades, signs, lights or other precautionary measures in protecting said property; and whenever evidence is found of such damage, the OWNER may order the damaged portion immediately removed and replaced by and at the cost and expense of the CONTRACTOR.

### 3.6.3 SAFETY; TRENCH SAFETY; UNDERGROUND UTILITY SAFETY; PUBLIC CONVENIENCE AND SAFETY;

The CONTRACTOR shall be responsible for complying with state laws and federal regulations relating to safety, trench safety, and underground utility safety, including those which may be enacted during the performance under this Contract. The CONTRACTOR shall comply with the provisions of The Standard Specifications and Standard Drawings from the Public Works Construction Standards-North Central Texas Council of Governments, 2004 edition and all subsequent addendums and the Instructions to Bidders regarding trench safety, public convenience and safety, and sanitary provisions. The CONTRACTOR shall be solely responsible for, the construction means and methods, techniques, sequences, or procedures, or for the safety precautions and programs in connection with the Work and the Project.

### 3.6.4 STORM WATER PROTECTION

The Contractor shall perform, track, participate, implement, and comply with storm water pollution prevention minimum control measures, protocols, and best management practices (BMP) and ensure that water quality standards are not violated in accordance with all regulations and policies as they apply to the Texas Pollutant Discharge Elimination System general permits. Applicable permits include: 1) Texas Construction General Permit (TXR150000).

Contractors will obtain permit coverage for construction activities disturbing over one acre of land (total acreage is cumulative across all portions of the project). BMPs include, but are not limited to:

1. Preparing and implementing a site-specific Storm Water Pollution Prevention Plan (SWPPP) as outlined in the permit and prior to any soil disturbance.
2. Installing and managing erosion and sediment control.
3. Make available, upon request, permit associated documentation.
4. Practicing spill prevention and good housekeeping.
5. Meeting the requirements of the MS4 permit.

In addition to the requirements of the Construction General permit TXR150000, the MS4 permits lists prohibited discharges which will be enforced at the County construction sites whether the operator is the County or a contractor. The following discharges are prohibited:

1. Wastewater from washout of concrete and wastewater from water well drilling operations, unless managed by an appropriate control;
2. Wastewater from washout and cleanout of stucco, paint, from release oils, and other construction materials;
3. Fuels, oils, or other pollutants used in vehicle and equipment operation and maintenance;
4. Soaps or solvents used in vehicle and equipment washing; and,
5. Discharges from dewatering activities, including discharges from dewatering of trenches and excavations, unless managed by appropriate BMPs.

3.7 MATERIALS AND WORKMANSHIP; WARRANTIES AND GUARANTEES  
Unless otherwise expressly provided in the contract drawings or specifications, the work shall be performed in accordance with the best modern practice with materials and workmanship of the highest quality and suitable for their purpose. The OWNER shall judge and determine the CONTRACTOR'S compliance with these requirements.

#### 3.7.1 MATERIALS AND EQUIPMENT

The CONTRACTOR shall be free to secure the approved materials, equipment and articles from sources of his own selection. However, if the OWNER finds that the work shall be delayed or adversely affected in any way because a selected source of supply cannot furnish a uniform product in sufficient quantity and at the time required and a suitable source does exist, or the product is not suitable for the Work, the OWNER shall have the right to require the original source of supply changed by the CONTRACTOR. The CONTRACTOR shall have no claim for extra cost or damage because of this requirement.

The CONTRACTOR warrants to the OWNER that all materials and equipment furnished under this contract shall be new unless otherwise specified in the Contract Documents and that same shall be of good quality and workmanship, free from faults and defects and in conformance with the Contract Documents. All materials and equipment not conforming to these requirements, including substitutions not properly approved and authorized, may be considered defective and shall be promptly repaired or replaced by the CONTRACTOR at the CONTRACTOR's sole cost upon demand of the OWNER. If required by the OWNER, the CONTRACTOR shall furnish satisfactory evidence as to the kind and quality of materials and equipment.

##### 3.7.1.1 "OR EQUAL" CLAUSE

A. Whenever a material or article required is specified or shown on the plans, by using the name of a proprietary product or of a particular manufacturer or vendor, any material or article which the Engineer determines shall

perform adequately the duties imposed by the general design or which the Engineer deems to be of similar appearance (in cases where appearance is of importance) shall be considered equal and satisfactory, provided the material or article so proposed is of equal substance and function. Authorization for any substitution of materials or articles must be obtained by the CONTRACTOR from the Engineer before proceeding with such substitution.

B. Should an authorized substitution require redesign of a portion of the work or alterations to the plans or specifications in order for the materials or articles which are to be substituted to properly fit or in other ways to be satisfactory, the Engineer shall accomplish such redesigns and alterations. The CONTRACTOR shall bear all reasonable costs associated with redesign and alteration efforts performed by the Engineer.

### 3.7.2 WORKMANSHIP

The CONTRACTOR shall promptly correct or replace all work rejected by the OWNER as defective or as failing to conform to the Contract Documents whether observed before or after substantial completion and whether or not fabricated, installed or completed. The CONTRACTOR shall bear all costs of correcting such rejected work, including costs incurred for additional services made necessary thereby.

## 3.8 WARRANTIES

### 3.8.1 SPECIAL WARRANTY

If within one year after final acceptance of the work by the OWNER, as evidenced by the final certificate of acceptance or within such longer or shorter period of time as may be prescribed by law or by the terms of any other applicable special warranty on designated equipment or portions of work as required by the Contract Documents, any of the work is found to be defective or not in accordance with the Contract Documents, the CONTRACTOR shall correct it promptly after receipt of a written notice from the OWNER to do so. This obligation shall survive termination or completion of the Contract. The OWNER shall give such notice promptly after discovery of the condition.

The CONTRACTOR shall remove from the site all portions of the work which are defective or nonconforming and which have not been corrected unless removal is waived in writing by the OWNER.

### 3.8.2 SUBCONTRACTORS' AND MANUFACTURERS' WARRANTIES

All subcontractors', manufacturers' and suppliers' warranties and guarantees, express or implied, respecting any part of the work and any materials used therein, shall be obtained and enforced by the CONTRACTOR for the benefit of the OWNER without the necessity of separate transfer or assignment thereof.

### 3.8.3 CORRECTED WORK WARRANTY

Any work repaired or replaced, pursuant to this section, shall be subject to the provisions of this section to the same extent as work originally performed.

### 3.8.4 RIGHTS AND REMEDIES

The rights and remedies of the OWNER provided in this section are in addition to, and do not limit, any rights or remedies afforded to the OWNER by law or any other provision of the Contract Documents, or in any way limit the OWNER'S right to recovery of damage due to default under the Contract. No action or inaction by the OWNER shall constitute a waiver of a right or duty afforded it under the Contract.

## IV. INSURANCE

### 4.1 CONTRACTOR'S INSURANCE

**\*\*To be copied from Insurance Requirements under Section 002113 of solicitation including any Addenda\*\***

## V. OWNERS RIGHTS AND RESPONSIBILITIES

### MONTHLY ESTIMATE, PARTIAL PAYMENTS AND FINAL PAYMENTS

- 5.1 Progress and final payments shall be paid to the Contractor based upon the progress of the Project as indicated by the approved Applications for Payment, certificates of acceptance, or Certificates for Payment, that include an approved Schedule of Values that will be submitted by the CONTRACTOR to the OWNER prior to the commencement of the Work and in accordance with the following:

### 5.2 MONTHLY ESTIMATES

The CONTRACTOR shall deliver to the OWNER an itemized Application for Payment that shall include the work completed, materials stored at the Project site but not incorporated into the work, materials ready to be installed and stored at another agreed location, and the percentage of Work completed, through the 20<sup>th</sup> day of each month, on an Application for Payment with a schedule of values previously submitted by the Contractor and approved by the Owner. Prior to release of funds in connection with any Application for Payment, the Owner may request, and the Contractor must provide, properly executed statements of full or partial releases of claims acceptable to Owner in form and content, for all persons or entities supplying labor or materials to the Project.

5.2.1 The Application for Payment is a representation by the CONTRACTOR to the OWNER that the construction has progressed to the point indicated, the quality of the Work covered by the application is in accordance with the Contract Documents, and the Contractor is entitled to payment in the amount requested.

#### 5.2.2 INSPECTION AND PARTIAL PAYMENTS

Whenever the CONTRACTOR shall submit an Application for Payment to the OWNER for work performed by the CONTRACTOR, the CONTRACTOR shall notify the Engineer that the improvement is ready for inspection. The Engineer shall then make such inspection, and will have the authority to reject work that does not conform to the Contract Documents. If the work is satisfactory and in accordance with the specifications and Contract Documents, the Engineer shall issue a Certificate for Payment.

5.2.3 Within thirty (30) days of the Owner's receipt of a properly submitted and correct Application for Payment, and the issuance of a Certificate for Payment, the Owner shall make payment to the Contractor, in the amount approved by the Owner less 5% retainage. Such payment shall be adjusted for work that is incomplete or not in accordance with the Contract Documents or that is the subject of a separate contract, or subcontract or supplier claim or lien against the Contractor or the payment bonds for the project.

5.2.4 No partial or final payment or the entire use or occupancy of the Project by the OWNER shall be considered acceptance of work that does not strictly comply with the Contract Documents or release the CONTRACTOR of any of his responsibilities under the Contract.

#### 5.2.5 PAYMENT FOR LABOR AND MATERIAL; NO LIENS

The CONTRACTOR for himself or any of his subcontractors shall pay all indebtedness which may become due to any person, firm or corporation having furnished labor, material or both in the performance of this Contract. It shall be the responsibility of each person, firm or corporation claiming to have furnished labor, materials or both, in connection with this Contract, to protect his or its interest in the manner prescribed by applicable laws of the State of Texas, provided, however, that as this Contract provides for a public works project, no lien of any kind shall ever exist or be placed against the Work or any portion thereof, or any public funds or retainage held by the OWNER; and any subcontractor shall look solely to the CONTRACTOR and the payment bond surety, and not the OWNER, for payment of any outstanding amounts due for labor, materials or any other indebtedness in connection with the Work. However, the OWNER may, at any time prior to

making final payment, require the CONTRACTOR to furnish a Consent of Surety to any payment due the CONTRACTOR for completed work and may, at the discretion of the OWNER or the request of the Surety, make the check jointly payable to the CONTRACTOR and the Surety. The Owner shall have no obligation under this Agreement to pay or to be responsible in any way for payment to any Engineer, another design professional, contractor, subcontractor or supplier performing portions of the Work, pursuant to a contract with the Contractor.

#### 5.2.6 PAYMENT WITHHELD

In addition to express provisions elsewhere contained in the contract, the OWNER may withhold from any payment otherwise due the CONTRACTOR such amount as determined necessary to protect the OWNER'S interest, or, if it so elects, may withhold or retain all or a portion of any progress payment or refund payment on account of:

- A. unsatisfactory progress of the Work not caused by conditions beyond the CONTRACTOR'S control,
- B. defective work not corrected,
- C. CONTRACTOR'S failure to carry out instructions or orders of the OWNER or his representative,
- D. a reasonable doubt that the Contract can be completed for the balance then unpaid,
- E. work or execution thereof not in accordance with the Contract Documents,
- F. claim filed by or against the CONTRACTOR or reasonable evidence indicating probable filing of claims,
- G. failure of the CONTRACTOR to make payments to subcontractor or for material or labor,
- H. damage to another contractor,
- I. unsafe working conditions allowed to persist by the CONTRACTOR,
- J. failure of the CONTRACTOR to provide work schedules as required by the OWNER,
- K. use of subcontractors without the OWNER'S approval or,
- L. failure of the CONTRACTOR to keep current as-built record drawings at the job site or to turn same over in completed form to the OWNER.

When the above grounds are removed, payment shall be made for amounts withheld because of them, and OWNER shall never be liable for interest on any delayed or late payment.

#### 5.2.7 PAYMENT FOR EXTRA WORK

The Extra Work done by the CONTRACTOR as authorized and approved by the Engineer shall be paid for in the manner hereinafter described, and the compensation thus provided shall be accepted by the CONTRACTOR as payment in full for all labor, materials, tools, equipment and incidentals

and all superintendents' and timekeepers' services, all insurance, bond and all other overhead expense incurred in the performance of the Extra Work.

Payment for Extra Work shall be made by one of the following methods:

A. Method "A" — by unit prices agreed on in writing by the OWNER and CONTRACTOR before said Extra Work is commenced, subject to all other conditions of the contract.

B. Method "B" — by lump sum price agreed on in writing by the OWNER and the CONTRACTOR before said Extra Work is commenced, subject to all other conditions of the contract.

#### 5.2.8 SUBSTANTIAL COMPLETION

The Project will be considered substantially complete when the OWNER can utilize the Project for its intended purpose and the Work is in conformance with the Contract Documents.

### 5.3 APPLICATION FOR FINAL PAYMENT.

Upon full performance of all the Contract Work and the full performance of all the provisions of the Contract, the CONTRACTOR shall submit a final application for payment to the OWNER, the CONTRACTOR shall notify the Engineer that the improvement is ready for inspection. All warranties and guaranties required of the CONTRACTOR by the Contract Documents shall be assembled and delivered by the CONTRACTOR to the OWNER as Part of the final Application for Payment. The Contractor will assign to the Owner all manufacturer's warranties relating to materials and labor used in the work and will perform the Work in such a manner as to preserve all such manufacturer's warranties. The CONTRACTOR will deliver a certificate evidencing that insurance and bonds required by the Contract Documents will remain in full force and effect pursuant to the requirements of the Contract. The final Certificate for Payment will not be issued until all such warranties and guaranties have been received and accepted by the Owner, and a Certificate of Acceptance is issued by the Engineer.

#### 5.3.1 FINAL INSPECTION AND ACCEPTANCE

Whenever the improvements provided for by the Contract shall have been completely performed on the part of the CONTRACTOR, the CONTRACTOR shall notify the OWNER, and Engineer that the improvement is ready for final inspection. The Engineer shall then make such final inspection, and if the work is satisfactory and in accordance with the specifications and Contract Documents, the CONTRACTOR shall be issued a certificate of acceptance.

#### 5.3.2 FINAL PAYMENT

Whenever the improvements provided for by the Contract shall have been completely performed on the part of the CONTRACTOR, as evidenced in the certificate of acceptance, and all required submissions provided to the OWNER, a final estimate showing the value of the work shall be prepared by the Engineer as soon as the necessary measurements and computations can be made. All prior estimates upon which payments have been made are subject or necessary corrections or revisions in the final payment. The amount of this final estimate, less any sums that have been previously paid, or deducted under the provisions of the Contract, shall be paid the CONTRACTOR within 30 days after the final acceptance, provided that the CONTRACTOR has furnished to the OWNER a consent of surety and an affidavit or other satisfactory evidence that all indebtedness connected with the Work and all sums of money due for any labor, materials, apparatus, fixtures or machinery furnished for and used in the performance of the work have been paid or otherwise satisfied, or that the person or persons to whom the same may respectively be due have consented to such final payment.

The acceptance by the CONTRACTOR of the final payment as aforesaid shall operate as and shall be a release to the OWNER from all claims or liabilities under the Contract, including all subcontractor claims, for anything done or furnished or relating to the Work under the Contract or for any act or neglect of said OWNER relating to or connected with the Contract.

All warranties and guarantees shall commence from the date of the certificate of acceptance. No interest shall be due the CONTRACTOR on any partial or final payment or on the retainage.

### **5.3 MODIFICATIONS TO CONTRACT WORK OR TIME OF PERFORMANCE**

#### **5.3.1 OWNER'S RIGHT TO TEMPORARILY SUSPEND WORK**

#### **5.3.2 REASONS FOR SUSPENSION**

The OWNER shall have the right by written order to temporarily suspend the work, in whole or in part, whenever, in the judgment of the OWNER, such temporary suspension is required:

- A. in the interest of the OWNER generally,
- B. due to government or judicial controls or orders which make performance of this contract temporarily impossible or illegal,
- C. to coordinate the work of separate contractors at the job site,
- D. to expedite the completion of a separate contract even though the completion of this particular Contract may be thereby delayed,
- E. because of weather conditions unsuitable for performance of the Work, or

- F. because the CONTRACTOR is proceeding contrary to contract provisions or has failed to correct conditions considered unsafe for workmen.

The written order of the OWNER to the CONTRACTOR shall state the reasons for suspending the work and the anticipated periods for such suspension. Upon receipt of the OWNER'S written order, the CONTRACTOR shall suspend the work covered by the order and shall take such means and precautions as may be necessary to properly protect the finished and partially finished work, the unused materials and uninstalled equipment, including the providing of suitable drainage about the work and erection of temporary structures where necessary. The CONTRACTOR shall not suspend the Work without written direction from the OWNER and shall proceed with the work promptly when notified by the OWNER to resume operations.

### 5.3.3 NO ADDITIONAL COMPENSATION

No additional compensation shall be paid to the CONTRACTOR for a temporary suspension of the Work by the OWNER or otherwise where same is caused by the fault of the CONTRACTOR. Where such temporary suspension is not due to the fault of the CONTRACTOR, he shall be entitled to:

- A. an equitable extension of working time for the completion of the work, not to exceed the delay caused by such temporary suspension, as determined by the OWNER; and
- B. the actual and necessary costs of properly protecting the finished and partially finished work, unused materials and uninstalled equipment during the period of the ordered suspension as determined by the OWNER as being beyond the Contract requirements, such costs, if any, to be determined pursuant to the terms of the Contract; and
- C. where the CONTRACTOR elects to move equipment from the job site and then return it to the site when the work is ordered resumed, the actual and necessary costs of these moves, in an amount determined by the OWNER pursuant to the terms of the Contract.

### 5.3.4 USE OF COMPLETED PORTIONS OF WORK

The OWNER may, after written notice to the CONTRACTOR, and without incurring any liability for increased compensation to the CONTRACTOR,

take over and use any completed portion of the Work prior to the final completion and acceptance of the entire work included in the Contract, and notwithstanding that the time allowed for final completion has not expired. The OWNER and CONTRACTOR agree that occupancy of portions of the Work by the OWNER shall not in any way evidence the substantial completion of the entire work or signify the OWNER's acceptance of the Work.

The CONTRACTOR shall not object to, nor interfere in any way with, such occupancy or use after receipt of the OWNER'S written notice. Immediately prior to such occupancy and use, the OWNER shall inspect such portion of the Work to be taken over and shall furnish the CONTRACTOR a written statement of the work, if any, still to be done on such part. The CONTRACTOR shall promptly thereafter complete such unfinished work to permit occupancy and use on the date specified in the OWNER'S written order, unless the OWNER shall permit specific items of work to be finished after the occupancy and use by the OWNER.

In the event the CONTRACTOR is unreasonably delayed by the OWNER exercising its rights under this section, the CONTRACTOR may submit a request for an extension of time; CONTRACTOR'S sole remedy for an unreasonable delay shall be an extension of time and shall not be entitled to any additional compensation.

#### 5.4 COMMENCEMENT; TIME OF COMPLETION; DELAYS; EXTENSION OF TIME; LIQUIDATED DAMAGES

##### 5.4.1 COMMENCEMENT; TIME OF COMPLETION

Contractor shall commence work within ten (10) consecutive calendar days after receiving from County a notice to proceed. Contractor agrees and covenants that the number of consecutive calendar days allowed to complete all work following a notice to proceed shall be as follows:

---

##### 5.4.2. LIQUIDATED DAMAGES FOR FAILURE TO COMPLETE ON TIME

Time is of the essence in the progress and completion of this Contract. For each calendar day that any Work shall remain uncompleted after the time specified in the proposal and the Contract, or the increased time granted by the OWNER, or as equitably increased by additional work or materials ordered after the Contract is signed, the sum per day given in the following schedule, unless otherwise specified in the special provisions, shall be deducted from the monies due the CONTRACTOR:

\_\_\_\_\_ (\$ \_\_\_\_\_)

The sum of money thus deducted for such delay, failure or noncompletion is not to be considered as a penalty, but shall be deemed, taken and treated as reasonable liquidated damages, per calendar day that the CONTRACTOR shall be in default after the time stipulated in the Contract for completing the Work. The said amounts are fixed and agreed upon by and between OWNER and CONTRACTOR because of the impracticability and extreme difficulty of fixing and ascertaining the actual damages the OWNER in such event would sustain; and said amounts are agreed to be the amount of damages which the OWNER would sustain and which shall be retained from the monies due, or that may become due, the CONTRACTOR under this Contract; and if said monies be insufficient to cover the amount owing, then the CONTRACTOR or his surety shall pay any additional amounts due.

#### 5.4.3 EXTENTIONS OF TIME

The CONTRACTOR shall be entitled to an extension of working time under this Contract only when claim for such extension is submitted to the OWNER in writing by the CONTRACTOR within seven days from and after the time when any alleged cause of delay shall occur, and then only when such time is approved by the OWNER. In adjusting the Contract working time for the completion of the Project, unforeseeable causes beyond the control and without the fault or negligence of the CONTRACTOR, including, acts of God or the public enemy, acts of the OWNER, fires, floods, epidemics, quarantine restrictions, strikes, freight embargoes, or delays of subcontractors due to such causes beyond their control shall be taken into consideration.

If the satisfactory execution and completion of the Contract should require work and materials in greater amounts or quantities than those set forth in the Contract, requiring more time for completion than the anticipated time, then the contract working time shall be equitably increased, but not more than in the same proportion as the cost of the additional work bears to the cost of the original work contracted for. No allowances shall be made for delays or suspension of the performance of the Work due to the fault of the CONTRACTOR.

No adjustment to working time shall be made if, concurrently with the equitable cause for delay, there existed a cause for delay due to the fault or negligence of the CONTRACTOR, his agents, employees or subcontractors; and no adjustment shall be made to the Contract Price and the CONTRACTOR shall not be entitled to claim or receive any additional compensation as a result of or arising out of any delay resulting in adjustment to the working time hereunder, including delays caused by the acts or negligence of the OWNER. Notwithstanding any other provision of the Contract Documents, all claims for extension of working time must be

submitted in accordance with the provisions of this Contract, and no act of the OWNER shall be deemed a waiver or entitlement of such extension.

## 5.5 TERMINATION FOR CONVENIENCE OF THE OWNER

### 5.5.1 NOTICE OF TERMINATION

The performance of the Work under this Contract may be terminated by the OWNER in whole or from time to time in part, in accordance with this section, whenever the OWNER shall determine that such termination is in the best interest of the OWNER. Any such termination shall be effected by mailing a notice of termination to the CONTRACTOR specifying the extent to which performance of work under the Contract is terminated, and the date upon which such termination becomes effective. Receipt of the notice shall be deemed conclusively presumed and established when the letter is placed in the United States Mail by the OWNER. Further, it shall be deemed conclusively presumed and established that such termination is made with just cause as therein stated; and no proof in any claim, demand or suit shall be required of the OWNER regarding such discretionary action.

### 5.5.2 CONTRACTOR ACTION

After receipt of a notice of termination, and except as otherwise directed by the OWNER or Engineer, the CONTRACTOR shall:

- A. stop work under the Contract on the date and to the extent specified in the notice of termination;
- B. place no further orders or subcontracts for materials, services or facilities except as may be necessary for completion of such portion the Work under the Contract as is not terminated;
- C. terminate all orders and subcontracts to the extent that they relate to the performance of work terminated by the notice of termination;
- D. transfer title to the OWNER and deliver in the manner, at the times, and to the extent, if any, directed by the OWNER or Engineer:
  1. the fabricated or unfabricated parts, work in process, completed work, supplies and other material produced as a part of, or acquired in connection with the performance of, the work terminated by the notice of termination; and
  2. the completed or partially completed plans, drawings, information and other property which, if the Contract had been completed, would have been required to be furnished to the OWNER.
- E. complete performance of such part of the work as shall not have been terminated by the notice of termination; and
- F. take such action as may be necessary, or as the Engineer may direct, for the protection and preservation of the property related to its Contract which is in the possession of the CONTRACTOR and in which the OWNER has or may acquire an interest.

At a time not later than 30 days after the termination date specified in the notice of termination, the CONTRACTOR may submit to the OWNER a list, certified as to the quantity and quality, of any or all items of termination inventory not previously disposed of, exclusive of items the disposition of which has been directed or authorized by the Engineer. Not later than 15 days thereafter, the OWNER shall accept title to such items and remove them or enter into a storage agreement covering the same, provided that the list submitted shall be subject to verification by the Engineer upon removal of the items, or, if the items are stored, within 45 days from the date of submission of the list, and provided that any necessary adjustments to correct the list as submitted shall be made prior to final settlement.

### 5.5.3 TERMINATION CLAIM

Within 60 days after notice of termination, the CONTRACTOR shall submit his termination claim to the Engineer and the OWNER in the form and with the certification prescribed herein. Unless one or more extensions in writing are granted by the OWNER upon request of the CONTRACTOR, made in writing within such 60-day period or authorized extension thereof, any and all such claims shall be conclusively deemed waived. The termination claim shall (1) list all Contract Work which the CONTRACTOR has completed but for which the CONTRACTOR asserts it has not been paid, including any retainage; (2) list of all fabricated or unfabricated parts, work in process, completed work, supplies and other material produced as a part of, or acquired in connection with the performance of the Contract and the itemized cost for each such fabricated or unfabricated part, work in process, completed work, supplies and other material; (3) list all costs and expenses saved as a result of the termination of the Contract. The termination claim must include a copy of all invoices for fabricated or unfabricated parts, supplies and other material produced as a part of, or acquired in connection with the performance of the Contract for which the CONTRACTOR seeks compensation; all invoices for any subcontractors providing services related to the Contract; and (3) evidence of payment of all material suppliers and subcontractors, together with CONTRACTOR's certification that all such-material suppliers and subcontractors have been fully paid together with executed lien releases from each such material supplier and subcontractor. The termination claim may not include any request for payment of Extra Work for which a Change Order has not been issued or for which the CONTRACTOR has not fully and timely complied with the provisions of section 2.3 of this Contract.

### 5.5.4 AMOUNTS

The CONTRACTOR and OWNER may agree upon the whole or any part of the amount or amounts to be paid to the CONTRACTOR by reason of

the total or partial termination of work pursuant hereto, provided that such agreed amount or amounts shall never exceed the total contract price as reduced by the amount of payments otherwise made and as further reduced by the Contract Price of work not terminated. The contract shall be amended accordingly, and the CONTRACTOR shall be paid the agreed amount. No amount shall be due for lost or anticipated profits. Nothing prescribing the amount to be paid to the CONTRACTOR in the event of failure of the CONTRACTOR and the OWNER to agree upon the whole amount to be paid to the CONTRACTOR by reason of the termination of work pursuant to this section, shall be deemed to limit, restrict or otherwise determine or affect the amount or amounts which may be agreed upon to be paid to the CONTRACTOR pursuant to this paragraph.

#### 5.5.5 FAILURE TO AGREE

In the event of the failure of the CONTRACTOR and the OWNER to agree, as provided herein, upon the whole amount to be paid to the CONTRACTOR by reason of the termination of work pursuant to this section, the OWNER shall determine, on the basis of information available to it, the amount, if any, due to the CONTRACTOR by reason of the termination and shall pay to the CONTRACTOR the amounts determined. No amount shall be due for lost or anticipated profits.

#### 5.5.6 DEDUCTIONS

In arriving at the amount due the CONTRACTOR under this section, there shall be deducted (a) all unliquidated advance or other payments on account theretofore made to the CONTRACTOR, applicable to the terminated portion of this contract; (b) any claim which the OWNER may have against the CONTRACTOR in connection with this Contract; and (c) the agreed price for or the proceeds of sale of any materials, supplies or other things kept by the CONTRACTOR or sold, pursuant to the provisions of this clause, and not otherwise recovered by or credited to the OWNER.

#### 5.5.7 ADJUSTMENT

If the termination hereunder be partial prior to the settlement of the terminated portion of this Contract, the CONTRACTOR may file with the Owner a request in writing for an equitable adjustment of the price or prices specified in the Contract relating to the continued portion of the Contract (the portion not terminated by the notice of termination), and such equitable adjustment as may be agreed upon shall be made in such price or prices; nothing contained herein, however, shall limit the right of the OWNER and the CONTRACTOR to agree upon the amount or amounts to be paid to the CONTRACTOR for the completion of the continued portion of the Contract when said contract does not contain an established contract price for such continued portion.

#### 5.5.8 NO LIMITATION OF RIGHTS

Nothing contained in this section shall limit or alter the rights which the OWNER may have for termination of this Contract under any other provision of this Contract or any other right which OWNER may have for default or breach of contract by CONTRACTOR.

#### 5.6 CONTRACTOR DEFAULT: OWNER'S RIGHT TO SUSPEND WORK AND ANNUL CONTRACT

The Work or any portion of the Work under contract shall be suspended immediately on written order of the OWNER declaring the CONTRACTOR to be in default. A copy of such notice shall be served on the CONTRACTOR'S surety. The contract may be annulled by the OWNER for any good cause or causes, among others of which special reference is made to the following:

- A. failure of the CONTRACTOR to start the work within 10 days from date specified in the written work order issued by the OWNER to begin the work;
- B. evidence that the progress of the work being made by the CONTRACTOR is insufficient to complete the work within the specified working time;
- C. failure of the CONTRACTOR to provide sufficient and proper equipment, materials or construction forces for properly executing the Work;
- D. evidence that the CONTRACTOR has abandoned the Work or discontinuance of the performance of the Work or any part thereof and failure to resume performance within a reasonable time after notice to do so;
- E. evidence that the CONTRACTOR has become insolvent or bankrupt, or otherwise financially unable to carry on the Work;
- F. deliberate failure on the part of the CONTRACTOR to observe any requirements of the specifications or to comply with any orders given by the Engineer as provided for in the specifications;
- G. failure of the CONTRACTOR to promptly make good any defects in materials or workmanship, or any defects of any nature, the correction of which has been directed in writing by the OWNER;
- H. evidence of collusion for the purpose of illegally procuring a contract or perpetrating fraud on the OWNER in the construction of work under contract;
- I. repeated violations of safe working procedures;
- J. the filing by the CONTRACTOR of litigation against the OWNER prior to final completion of the Work. When the Work is suspended for any of the causes itemized above, or for any other cause or causes, the CONTRACTOR shall discontinue the Work or such part thereof as the OWNER shall designate, whereupon the surety may either at its option assume the Contract or that portion thereof which the OWNER has ordered the CONTRACTOR to discontinue and perform the same or, with the written consent of the OWNER, sublet the same, provided, however, that

the surety shall exercise its option within two weeks after the written notice to discontinue the work has been served upon the CONTRACTOR and upon the surety or its authorized agents. The surety in such event shall assume the CONTRACTOR'S place in all respects and shall be paid by the OWNER for all work performed by it in accordance with the terms of the Contract, but in no event shall such payments exceed the contract amount, regardless of the cost to the surety to complete the Work.

In the event that the surety assumes the CONTRACTOR'S place, duties and responsibilities in the Contract, all monies remaining due the CONTRACTOR at the time of his default shall thereupon become due and payable to the surety as the work progresses, subject to all terms of the Contract. In case the surety does not, within the hereinabove specified time, exercise its obligation to assume the Contract or that portion thereof which the OWNER has ordered the CONTRACTOR to discontinue, then the OWNER shall have the power to complete by contract or otherwise, as it may determine, the Work herein described or such part thereof as it may deem necessary; and the CONTRACTOR hereto agrees that the OWNER shall have the right to take possession of or use any or all of the materials, plans, tools, equipment, supplies and property of every kind provided by the CONTRACTOR for the purpose of the Work and to procure other tools, equipment and materials for the completion of the same and to charge to the account of the CONTRACTOR the expense of said contract for labor, materials, tools, equipment and expenses incident thereto. The expense so charged shall be deducted by the OWNER out of such monies as may be due or may at any time thereafter become due the CONTRACTOR under and by virtue of the Contract or any part thereof.

The OWNER shall not be required to obtain the lowest bid for the work of completing the Contract, but the expenses to be deducted shall be the actual cost of such work. In case such expense is less than the sum which would have been payable under the contract if the same had been completed by the CONTRACTOR, then in such case the OWNER may pay the CONTRACTOR the difference in the cost, provided that the CONTRACTOR shall not be entitled to any claim for damages or for loss of anticipated profits.

In case such expense shall exceed the amount which would have been payable under the Contract if the same had been completed by the CONTRACTOR, the CONTRACTOR and his surety shall pay the amount of the excess to the OWNER on notice from the OWNER for excess due including any costs incurred by the OWNER, such as inspection, legal fees and liquidated damages. When any particular part of the Work is being carried out by the OWNER by contract or otherwise under the provisions of this section, the CONTRACTOR shall continue the remainder of the Work in conformity with the terms of the contract and in such manner as not to hinder or interfere with the performance of workmen employed as above provided by the OWNER or surety.

## 5.7 SUSPENSION BY COURT ORDER AGAINST THE OWNER

The CONTRACTOR shall suspend such part or parts of the Work pursuant to a court order issued against the OWNER and shall not be entitled to additional compensation by virtue of such court order; neither shall the CONTRACTOR be liable to the OWNER in the event the Work is suspended by such court order, unless such suspension is due to the fault or negligence of the CONTRACTOR. A delay of the CONTRACTOR due to a court order against the OWNER, or due to the OWNER'S failure to secure right-of-way at the time required or because of a conflict of a utility with the Work, shall not be cause for additional compensation for damages sustained by the CONTRACTOR, but may be a cause for extension of contract working time only. The CONTRACTOR'S sole remedy for any suspensions of the Work is an equitable extension of time to perform the Work.

#### 5.8 NO WAIVER OF RIGHTS OR ESTOPPEL

The OWNER, or any officer or agent thereof, shall not be precluded at any time, either before or after final completion and acceptance of the Work and final payment therefore from:

A. showing the true and correct amount, classifications, quality and character of the Work done and materials furnished by the CONTRACTOR or any other person under this Contract, or from showing at any time that any determination, return, decision, approval, order, letter, payment or certification is untrue and incorrect or improperly made in any particular, or that the Work or the materials or any parts thereof do not in fact conform to the contract requirements; and (b) demanding the recovery from the CONTRACTOR of any overpayments made to him, or such damages as the OWNER may sustain by reason of the CONTRACTOR'S failure to perform each and every part of this Contract in strict accordance with its terms; or both.

### VI. AUTHORITY OF THE ENGINEER

6.1 All work shall be performed in a good and workmanlike manner and to the satisfaction of the Engineer. The Engineer shall decide all questions which arise as to the quality and acceptability of materials furnished, work performed, manner of performance, rate of progress of the work, sequence of the construction, interpretation of the plans and specifications, acceptable fulfillment of the Contract, compensation, mutual rights between contractors under these specifications and suspension of the Work. He shall determine the amount and quality of work performed and materials furnished, and his decisions and estimates shall be final. His estimate in such event shall be a condition precedent to the right of the CONTRACTOR to receive money due him under the Contract.

#### 6.2 OWNER'S REPRESENTATIVES

Where the Contract Documents indicate that determinations, directions or approvals shall be made by the OWNER or "Owner's representatives," this shall mean the OWNER acting directly, or through duly authorized persons acting within

the limit of authority delegated to them. Any determination, direction or approval of such authorized representatives shall be subject to review by the OWNER. For purposes of administering the schedule or the payment provisions of this Contract the Engineer may act as the Owner's representative for purposes of approving payments, changes, scheduling, or acceptance of the Work, at the OWNER'S discretion.

### 6.3 INSPECTIONS OF WORK PROGRESS

The Engineer shall visit the site at during construction of the Project as necessary as the Owner's Representative to verify that the Work is being performed in compliance with the Contract Documents and shall be given total access to the Project by the CONTRACTOR. Site visits or inspections by the Engineer shall in no way relieve the CONTRACTOR of any of its responsibilities or duties pursuant to the Contract Documents. The Engineer will neither have control over, nor be responsible for, the construction means and methods, techniques, sequences, or procedures, or for the safety precautions and programs in connection with the Work or the Project. The CONTRACTOR shall be solely responsible for, the construction means and methods, techniques, sequences, or procedures, or for the safety precautions and programs in connection with the Work or the Project.

### 6.4 CONSTRUCTION STAKES

Engineer will provide the Contractor with primary horizontal and vertical control to consist of one construction baseline and two benchmarks.

The Contractor shall take all necessary precautions to preserve any and/or all markings and staking. Payment for costs of restaking shall be the responsibility of the Contractor.

### 6.5 APPROVAL OF SUBMITTALS

The Engineer shall review and approve or take other appropriate action the CONTRACTOR's submittals such as Shop Drawings, Product Data and Samples, for the purpose of checking for conformance with the Contract Documents. The Engineers review of the submittals shall not relieve the CONTRACTOR of any of its obligations to perform the Work in strict compliance with the Contract Documents. The Engineer's review shall not be considered approval of safety precautions, means and methods, techniques, sequences or procedures that are the responsibility of the CONTRACTOR.

## VII. CLAIMS OR DISPUTES

### 7.1 CLAIMS AGAINST OWNER AND ACTION THEREON.

No claim against the OWNER under the Contract or for breach of the Contract or additional compensation for extra or disputed work shall be made or asserted against the OWNER under the Contract or in any court action, unless the CONTRACTOR shall have strictly complied with all requirements relating to the

giving of notice and information with respect to such claim as required by the Contract.

## 7.2 CLAIM AGAINST OFFICERS, EMPLOYEES OR AGENT OF THE OWNER.

No claim whatsoever shall be made by the CONTRACTOR against any, past, present or future, officer, employee or agent of the OWNER for or on account of, anything done or omitted to be done in connection with this Contract.

## VIII. MISCELLANEOUS PROVISIONS

### 8.1 FINANCIAL INTEREST IN ANY CONTRACT BY OWNER'S OFFICERS, EMPLOYEES OR AGENTS

No officer, employee or agent of the OWNER shall have a financial interest, direct or indirect, in any contract with the OWNER or be financially interested, directly or indirectly, in the sale to the OWNER of any land, materials, supplies or services, except on behalf of the OWNER as an officer or employee. Any willful violation of this article shall constitute malfeasance in office, and any officer or employee guilty thereof shall thereby forfeit his office or position. Any violation of this article with the knowledge, expressed or implied, of the persons, partnership, company, firm, association or corporation contracting with the OWNER shall render the contract involved voidable by the OWNER.

### 8.2 SERVICE OF NOTICES

The OWNER and the CONTRACTOR shall each designate addresses where all notices, directions or other communication may be delivered or to which they may be mailed.

Notices to the surety or sureties on contract bonds shall be directed or delivered to the home office, or to the agent or agents who executed the bonds on behalf of the surety or sureties, or to their designated agent for delivery of notices.

Actual delivery of any such notice, direction or communication to the aforesaid places or depositing it in a postpaid wrapper addressed thereto in any post office regularly maintained by the United States Postal Service shall be conclusively deemed to be sufficient service thereof upon the above persons as of the date of such delivery or deposit.

The designated addresses may be changed at any time by an instrument in writing executed by the party changing the addresses and delivered to the other party.

Nothing herein contained shall, however, be deemed to preclude or tender inoperative the service of any notice, direction or communication upon the above parties personally or, if the CONTRACTOR be a corporation, upon any officer or director thereof.

### 8.3 UNLAWFUL PROVISIONS DEEMED STRICKEN

In the event a term, condition, or provision of this Agreement is determined to be void, unenforceable, or unlawful by a court of competent jurisdiction, then that term, condition, or provision shall be deleted and the remainder of the Agreement shall remain in full force and effect.

#### 8.4 ALL LEGAL PROVISIONS INCLUDED

It is the intent and agreement of the parties to this contract that all legal provisions of law required to be inserted herein shall be and are inserted herein. If through mistake or oversight, however, any such provision is not herein inserted, or is not inserted in proper form, then upon application of either party, the contract shall be amended so as to strictly comply with the law and without prejudice to the rights of either party hereunder.

#### 8.5 ASSIGNMENTS

The CONTRACTOR shall not assign, transfer, convey or otherwise dispose of this contract, or his right to execute it, or his right, title or interest in it or any part thereof without the previous written consent of the surety company and the written approval of the OWNER.

The CONTRACTOR shall not assign, either legally or equitably, by power of attorney or otherwise, any of the monies due or to become due under this Contract or its claim thereto without the prior written consent of the surety company and the written approval of the OWNER.

The approval of the OWNER of a particular assignment, transfer or conveyance shall not dispense with such approval to any further or other assignments.

The approval by the OWNER of any assignment, transfer or conveyance shall not operate to release the CONTRACTOR or surety hereunder from any of the Contract and bond obligations, and the CONTRACTOR shall be and remain fully responsible and liable for the defaults, negligent acts and omissions of his assignees, their agents and employees, as if they were his own.

#### 8.6 STATE AND LOCAL SALES AND USE TAXES

The OWNER qualifies for exemption from the state and local sales and use taxes, pursuant to the provisions of Section 151.309 of the Texas Limited Sales, Excise and Use Tax Act. Therefore, the CONTRACTOR shall not pay such taxes which would otherwise be payable in connection with the performance of this Contract.

The CONTRACTOR shall issue an exemption certificate in lieu of the tax on the purchase, rental or lease of:

- A. all materials, supplies, equipment and other tangible personal property incorporated into the real property being improved; and

B. all materials, supplies, equipment and other tangible personal property used or consumed by the CONTRACTOR in performing the Contract with the OWNER. Materials and supplies “used in the performance of a contract” include only those materials actually incorporated into the property being improved and those supplies directly used to incorporate such materials into the property being improved. Overhead supplies and supplies used indirectly or only incidental to the performance of the Contract with the OWNER are not included in the exemption.

Under “reasons said purchaser is claiming this exemption” in the exemption certificate, the CONTRACTOR must name the OWNER and the project for which the equipment, material and supplies are being purchased, leased or rented.

#### 8.7 VENUE AND GOVERNING LAW

The parties agree that the laws of the State of Texas shall govern the interpretation, validity, performance and enforcement of this Construction Agreement, and that the exclusive venue for any legal proceeding involving this Construction Agreement shall be in Collin County, Texas.

#### 8.8 NO WAIVER OF LEGAL RIGHTS

Inspection by the Engineer or OWNER; any order, measurement, quantity or certificate by the Engineer; any order by the OWNER for payment of money; any payment for or acceptance of any work; or any extension of time or any possession taken by the OWNER shall not operate as a waiver of any provisions of the contract or any power therein reserved to the OWNER of any rights or damages therein provided. Any waiver of any breach of contract shall not be held to be a waiver of any other or subsequent breach. The OWNER reserves the right to correct any error that may be discovered in any estimate that may have been paid and to adjust the same to meet the requirements of the Contract Documents. The OWNER reserves the right to recover by process of law sums as may be sufficient to correct any error or make good any deficiency in the Work resulting from such error, dishonesty or collusion by the CONTRACTOR or his agents, discovered in the Work after the final payment has been made.

Neither final acceptance of the Work, nor final payment shall relieve the CONTRACTOR of responsibility for faulty materials or workmanship, and the CONTRACTOR shall promptly remedy any defects due thereto and pay for any damage to other work resulting therefrom. Likewise, neither final acceptance nor final payment, nor partial or entire use or occupancy of the work by the OWNER shall constitute acceptance of work not done in accordance with the Contract Documents or relieve CONTRACTOR of liability with respect to any expressed or implied warranties or responsibility for faulty materials or workmanship, whether same be patently or latently defective.

#### 8.9 OBLIGATION TO PERFORM FUNCTIONS

Any failure or neglect on the part of OWNER or Engineer or inspectors to enforce provisions herein dealing with supervision, control, inspection, testing or acceptance and approval of the work shall never operate to relieve CONTRACTOR from full compliance with the Contract Documents nor render OWNER liable to CONTRACTOR for money damages, extensions of time or increased compensation of any kind.

8.10 SUCCESSORS AND ASSIGNS

Subject to the limitations upon assignment and transfer herein contained, this contract shall be binding upon and inure to the benefit of the parties hereto, their respective successors and assigns.

8.11 HEADINGS

The title and headings contained in the Contract Documents and the subject organization are used only to facilitate reference, and in no way define or limit the scope of intent of any of the provisions of this Contract.

8.12 ENTIRE AGREEMENT; AMENDMENTS; BINDING EFFECT

This Construction Agreement, including the Contract Documents and all the documents incorporated therein represents the entire and integrated agreement between the OWNER, Collin County, and the CONTRACTOR, and supersedes all prior negotiations, representations, or agreements, either written or oral. This Construction Agreement may be amended only by written instrument signed by both, the OWNER, Collin County, and the CONTRACTOR. CONTRACTOR acknowledges that no representations have been made to it, upon which it is relying in entering into this Contract, which are not expressly set forth in the Contract Documents.

8.13 INTERPRETATION

Although this Agreement is drafted by the OWNER, Collin County, should any part be in dispute, the parties agree that this Construction Agreement shall not be construed more favorable for either party. No rule of construction requiring that ambiguities in this Contract shall be construed more favorably for either party shall apply.

8.14 EXPENSES FOR ENFORCEMENT

In the event either Party hereto is required to employ an attorney to enforce the provisions of this Agreement or is required to commence legal proceedings to enforce the provisions hereof, the prevailing Party shall be entitled to recover from the other, reasonable attorney's fees and court costs incurred in connection with such enforcement, including collection.

8.15 FORCE MAJEURE

No party shall be liable or responsible to the other party, nor be deemed to have defaulted under or breached this Agreement, for any failure or delay in fulfilling or performing any term of this Agreement, when and to the extent such failure or delay is caused by or results from acts beyond the affected party's reasonable control, including, without limitation: acts of God; flood, fire or explosion; war, invasion, riot or other civil unrest; actions, embargoes or blockades in effect on or after the

date of this Agreement; or national or regional emergency (each of the foregoing, a “Force Majeure Event”). A party whose performance is affected by a Force Majeure Event shall give notice to the other party, stating the period of time the occurrence is expected to continue and shall use diligent efforts to end the failure or delay and minimize the effects of such Force Majeure Event.

IN WITNESS WHEREOF, the parties have executed this Construction Agreement upon the year and date indicated beneath their signatures hereto.

**CONTRACTOR:**

\_\_\_\_\_

By: \_\_\_\_\_

\_\_\_\_\_

Date: \_\_\_\_\_

**ATTEST:**

\_\_\_\_\_  
Secretary

**COLLIN COUNTY, TEXAS:**

By: \_\_\_\_\_  
Michelle Charnoski, NIGP-CPP, CPPB, Purchasing Agent

Date: \_\_\_\_\_

\_\_\_\_\_  
Collin County Commissioners Court Order No.

**ATTEST:**

\_\_\_\_\_  
Secretary

**ACKNOWLEDGMENTS**

**STATE OF TEXAS** §

**COUNTY OF \_\_\_\_\_** §

**BEFORE ME,** \_\_\_\_\_ on this day personally appeared \_\_\_\_\_  
\_\_\_\_\_, of \_\_\_\_\_, a \_\_\_\_\_ corporation,  
known to me (or proved to me on the oath of) \_\_\_\_\_ or  
through \_\_\_\_\_ (description of identity card or other document) to be the  
person whose name is subscribed to the foregoing instrument and acknowledged to me that  
he/she executed the same as the act and deed of the corporation, for the purposes and  
consideration therein expressed and in the capacity therein stated.

**GIVEN UNDER MY HAND AND SEAL OF OFFICE,** this the \_\_\_ day of \_\_\_\_\_, 20\_\_

\_\_\_\_\_  
Notary Public, State of Texas

\_\_\_\_\_  
Printed Name

My Commission expires on the \_\_\_ day of \_\_\_\_\_, \_\_\_\_\_.

**STATE OF TEXAS** §

**COUNTY OF COLLIN§**

**BEFORE ME,** \_\_\_\_\_ on this day personally appeared \_\_\_\_\_  
\_\_\_\_\_, Purchasing Agent of COLLIN COUNTY, TEXAS, a political subdivision  
of the State of Texas, known to me (or proved to me on the oath of) \_\_\_\_\_  
\_\_\_\_\_ or through \_\_\_\_\_ (description of identity card or other document) to be  
the person whose name is subscribed to the foregoing instrument and acknowledged to me  
that he/she executed the same as the act and deed of COLLIN COUNTY, TEXAS, for the  
purposes and consideration therein expressed and in the capacity therein stated.

**GIVEN** under my hand and seal of office this the \_\_\_\_\_ day of \_\_\_\_\_  
\_\_\_\_\_, 20\_\_

\_\_\_\_\_  
Notary Public, State of Texas

\_\_\_\_\_  
Printed Name

My Commission expires on the \_\_\_ day of \_\_\_\_\_, \_\_\_\_\_.

**PERFORMANCE BOND**

STATE OF TEXAS §  
COUNTY OF COLLIN §

**KNOW ALL MEN BY THESE PRESENTS:**

That \_\_\_\_\_, a corporation organized and existing under the laws of the State of \_\_\_\_\_, and fully authorized to transact business in the State of Texas, whose address is \_\_\_\_\_ of the City of \_\_\_\_\_ County of \_\_\_\_\_, and State of \_\_\_\_\_, (hereinafter referred to as "Principal"), and \_\_\_\_\_ (hereinafter referred to as "Surety", a corporation organized under the laws of the State of \_\_\_\_\_ and authorized under the laws of the State of Texas to act as surety on bonds for principals, are held and firmly bound unto \_\_\_\_\_ (hereinafter referred to as "Owner") and unto all persons, firms and corporations who may furnish materials for or perform labor upon the buildings, structures or improvements referred to in the attached Contract, in the penal sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_) (not less than 100% of the approximate total amount of the Contract as evidenced in the proposal plus 10-percent of the stated penal sum as an additional sum of money representing additional court expenses, attorneys' fees, and liquidated damages arising out of or connected with the below identified Contract) in lawful money of the United States, for the payment whereof, the said Principal and Surety bind themselves, and their heirs, administrators, executors, successors, and assigns, jointly and severally, firmly by these presents:

**WHEREAS**, the Principal has entered into a certain written contract with the Owner, dated the \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_, to which said Contract is hereby referred to and made a part hereof and as fully and to the same extent as if copied at length herein for the construction of \_\_\_\_\_.

**NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION IS SUCH**, that if the said Principal fully and faithfully executes the work and performance of the Contract in accordance with the plans specifications, and Contract Documents, including any extensions thereof which may be granted with or without notice to Surety, during the original term thereof, and during the life of any guaranty required under the Contract, and according to the true intent and meaning of said Contract and the plans and specifications hereto annexed, if the Principal shall repair and/or replace all defects due to faulty materials or workmanship that appear within a period of one year from the date of final completion and final acceptance of the work by OWNER; and if the Principal shall fully indemnify and save harmless the OWNER from all costs and damages which OWNER may suffer by reason of failure to so perform herein and shall fully reimburse and repay OWNER all outlay and expense which the OWNER may incur in making good any default or deficiency, then this obligation shall be void; otherwise, to remain in full force and effect; and in case said CONTRACTOR shall fail to do so, it is agreed that the OWNER may do said work and supply such materials and charge the same against said CONTRACTOR and Surety on this obligation. Provided further, that if any legal action be filed on this Bond, venue shall lie in \_\_\_\_\_ Collin County, Texas.

**"PROVIDED, HOWEVER**, that this bond is executed pursuant to the provisions Texas Government Code, Chapter 2253, as amended, and Chapter 3503 of the Texas Insurance Code, as amended, and all liabilities on this bond shall be determined in accordance with the provisions of said articles to the same extent as if they were fully copied at length herein.

Surety, for value received, stipulates and agrees that the bond shall automatically be increased by the amount of any Change Order or supplemental agreement which increases the Contract price with or without notice to the Surety, but in no event shall a Change Order or Supplemental Agreement which reduces the Contract price decrease the penal sum of the Bond. And further that no change, extension of time, alteration, or addition to the terms of the Contract, or to the work performed thereunder, or the plans, specifications, or drawings accompanying the same shall in any way affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration, or addition to the terms of the Contract or to the work to be performed thereunder.

Surety agrees that the bond provides for the repairs and/or replacement of all defects due to faulty materials and workmanship that appear within a period of one (1) year from the date of completion and acceptance of the improvement by the OWNER.

The undersigned and designated agent is hereby designated by Surety herein as the agent resident to whom any requisite notice may be delivered and on whom service of process may be had in matters arising out of such suretyship.

**IN WITNESS WHEREOF**, the said Principal and Surety have signed and sealed this instrument this \_\_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_\_.

**WITNESS**

\_\_\_\_\_

**PRINCIPAL**

Printed/Typed Name \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

Address: \_\_\_\_\_

**WITNESS**

\_\_\_\_\_

**SURETY**

Printed/Typed Name \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

Address: \_\_\_\_\_

The Resident Agent of the Surety for delivery of notice and service of process is:  
Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
Phone Number: \_\_\_\_\_

**Note:** Date of Bond must NOT be prior to date of contract.

**PAYMENT BOND**

STATE OF TEXAS §  
COUNTY OF COLLIN §

**KNOW ALL MEN BY THESE PRESENTS:**

That \_\_\_\_\_, a corporation organized and existing under the laws of the State of \_\_\_\_\_, and fully authorized to transact business in the State of Texas, whose address is \_\_\_\_\_ of the City of \_\_\_\_\_ County of \_\_\_\_\_, and State of \_\_\_\_\_, (hereinafter referred to as "Principal"), and \_\_\_\_\_ (hereinafter referred to as "Surety", a corporation organized under the laws of the State of \_\_\_\_\_ and authorized under the laws of the State of Texas to act as surety on bonds for principals, are held and firmly bound unto \_\_\_\_\_ (hereinafter referred to as "Owner") and unto all persons, firms and corporations who may furnish materials for or perform labor upon the buildings, structures or improvements referred to in the attached Contract, in the penal sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_) (not less than 100% of the approximate total amount of the Contract as evidenced in the proposal) in lawful money of the United States, for the payment whereof, the said Principal and Surety bind themselves, and their heirs, administrators, executors, successors, and assigns, jointly and severally, firmly by these presents:

**WHEREAS**, the Principal has entered into a certain written contract with the Owner, dated the \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_, to which said Contract is hereby referred to and made a part hereof and as fully and to the same extent as if copied at length herein for the construction of \_\_\_\_\_.

**NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION IS SUCH**, that the bond guarantees the full and proper protection of all claimants supplying labor and material in the prosecution of the work provided for in said Contract and for the use of each claimant, and that conversely should the Principal faithfully perform said Contract and in all respects duly and faithfully observe and perform all and singular the covenants, conditions, and agreements in and by said Contract, agreed to by the Principal, and according to the true intent and meaning of said Contract and the claims and specifications hereto annexed, and any and all duly authorized modifications of said Contract that may hereafter be made, notice of which modification to Surety being hereby waived, then this obligation shall be void; otherwise, to remain in full force and effect. Provided further, that if any legal action be filed on this Bond, venue shall lie in Collin County, Texas.

**"PROVIDED, HOWEVER**, that this bond is executed pursuant to the provisions Texas Government Code, Chapter 2253, as amended, and Chapter 3503 of the Texas Insurance Code, as amended, and all liabilities on this bond shall be determined in accordance with the provisions of said articles to the same extent as if they were fully copied at length herein.

Surety, for value received, stipulates and agrees that the bond shall automatically be increased by the amount of any Change Order or supplemental agreement which increases the Contract price with or without notice to the Surety and that no change, extension of time, alteration or addition to the terms of the Contract, or to the work performed thereunder, or the plans, specifications, or drawings accompanying the same, shall in anyway affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the Contract, or to the work to be performed thereunder.

The undersigned and designated agent is hereby designated by Surety herein as the agent resident to whom any requisite notice may be delivered and on whom service of process may be had in matters arising out of such suretyship.

**IN WITNESS WHEREOF**, the said Principal and Surety have signed and sealed this instrument this \_\_\_\_\_ day of \_\_\_\_\_ 20\_\_\_\_\_.

**WITNESS**

\_\_\_\_\_

**PRINCIPAL**

Printed/Typed Name \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

Address: \_\_\_\_\_

**SURETY**

Printed/Typed Name \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

Address: \_\_\_\_\_

**WITNESS**

\_\_\_\_\_

The Resident Agent of the Surety for delivery of notice and service of process is:  
Name: \_\_\_\_\_  
Address: \_\_\_\_\_  
Phone Number: \_\_\_\_\_

**Note:** Date of Bond must NOT be prior to date of contract.

**006119 MAINTENANCE BOND**

STATE OF TEXAS            §  
COUNTY OF COLLIN       §

**KNOW ALL MEN BY THESE PRESENTS:**

That \_\_\_\_\_, a corporation organized and existing under the laws of the State of \_\_\_\_\_, and fully authorized to transact business in the State of Texas, whose address is \_\_\_\_\_ of the City of \_\_\_\_\_ County of \_\_\_\_\_, and State of \_\_\_\_\_, (hereinafter referred to as "Principal"), and \_\_\_\_\_ (hereinafter referred to as "Surety", a corporation organized under the laws of the State of \_\_\_\_\_ and authorized under the laws of the State of Texas to act as surety on bonds for principals, are held and firmly bound unto \_\_\_\_\_ (hereinafter referred to as "Owner") and unto all persons, firms and corporations who may furnish materials for or perform labor upon the buildings, structures or improvements referred to in the attached Contract, , in the penal sum of \_\_\_\_\_ Dollars (\$ \_\_\_\_\_) in lawful money of the United States, for the payment whereof, the said Principal and Surety bind themselves, and their heirs, administrators, executors, successors, and assigns, jointly and severally, firmly by these presents:

**WHEREAS**, the Principal has entered into a certain written contract with the Owner, dated the \_\_\_\_\_ day of \_\_\_\_\_, 202\_\_\_\_, to which said Contract is hereby referred to and made a part hereof and as fully and to the same extent as if copied at length herein for the construction of \_\_\_\_\_.

**NOW, THEREFORE, THE CONDITION OF THIS OBLIGATION IS SUCH**, that the bond guarantees the full and proper maintenance and repair of the work herein contracted to be done and performed for a period of \_\_\_\_\_ year(s) from the date of acceptance and Principal will do all necessary backfilling that may arise on account of sunken conditions in ditches, or otherwise, and do and perform all necessary work and repair any defective condition growing out of or arising from the improper laying or construction of same, or on account of any breaking of same caused by said CONTRACTOR in construction of same , or on account of any defect arising in any of said work laid or constructed by said CONTRACTOR or on account of improper excavation or backfilling, it being understood that the purpose of this section is to cover all defective conditions arising by reason of defective materials, work or labor performed by said CONTRACTOR, then this obligation shall be void; otherwise, to remain in full force and effect; and in case said CONTRACTOR shall fail to do so, it is agree that the OWNER may do said work and supply such materials and charge the same against said CONTRACTOR and Surety on this obligation. Provided further, that if any legal action be filed on this Bond, venue shall lie in Collin County, Texas.

**"PROVIDED, HOWEVER**, that said Surety, for value received, stipulates and agrees the bond shall automatically be increased by the amount of any Change Order or supplemental agreement which increases the Contract price with or without notice to the Surety and that no change, extension of time, alteration or addition to the terms of the Contract, or to the work performed thereunder, or the plans specifications, or drawings accompanying the same shall in any way affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration, or addition to the terms of the Contract or to the work to be performed thereunder.

The undersigned and designated agent is hereby designated by Surety herein as the agent resident to whom any requisite notice may be delivered and on whom service of process may be had in matters arising out of such suretyship.

**IN WITNESS WHEREOF**, the said Principal and Surety have signed and sealed this instrument this \_\_\_\_\_ day of \_\_\_\_\_ 202\_\_\_\_.

**WITNESS**

\_\_\_\_\_

**PRINCIPAL**

\_\_\_\_\_

Printed/Typed Name \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

\_\_\_\_\_

Address: \_\_\_\_\_

\_\_\_\_\_

**WITNESS**

\_\_\_\_\_

**SURETY**

\_\_\_\_\_

Printed/Typed Name \_\_\_\_\_

Title: \_\_\_\_\_

Company: \_\_\_\_\_

\_\_\_\_\_

Address: \_\_\_\_\_

\_\_\_\_\_

The Resident Agent of the Surety for delivery of notice and service of process is:

Name: \_\_\_\_\_

Address: \_\_\_\_\_

Phone Number: \_\_\_\_\_

**Note:**     Date of Bond must NOT be  
prior to date of contract.

# CONFLICT OF INTEREST QUESTIONNAIRE

For vendor doing business with local governmental entity

## FORM CIQ

This questionnaire reflects changes made to the law by H.B. 23, 84th Leg., Regular Session.

This questionnaire is being filed in accordance with Chapter 176, Local Government Code, by a vendor who has a business relationship as defined by Section 176.001(1-a) with a local governmental entity and the vendor meets requirements under Section 176.006(a).

By law this questionnaire must be filed with the records administrator of the local governmental entity not later than the 7th business day after the date the vendor becomes aware of facts that require the statement to be filed. See Section 176.006(a-1), Local Government Code.

A vendor commits an offense if the vendor knowingly violates Section 176.006, Local Government Code. An offense under this section is a misdemeanor.

### OFFICE USE ONLY

Date Received

**1** Name of vendor who has a business relationship with local governmental entity.

**2**  Check this box if you are filing an update to a previously filed questionnaire. (The law requires that you file an updated completed questionnaire with the appropriate filing authority not later than the 7th business day after the date on which you became aware that the originally filed questionnaire was incomplete or inaccurate.)

**3** Name of local government officer about whom the information is being disclosed.

\_\_\_\_\_  
Name of Officer

**4** Describe each employment or other business relationship with the local government officer, or a family member of the officer, as described by Section 176.003(a)(2)(A). Also describe any family relationship with the local government officer. Complete subparts A and B for each employment or business relationship described. Attach additional pages to this Form CIQ as necessary.

A. Is the local government officer or a family member of the officer receiving or likely to receive taxable income, other than investment income, from the vendor?

Yes       No

B. Is the vendor receiving or likely to receive taxable income, other than investment income, from or at the direction of the local government officer or a family member of the officer AND the taxable income is not received from the local governmental entity?

Yes       No

**5** Describe each employment or business relationship that the vendor named in Section 1 maintains with a corporation or other business entity with respect to which the local government officer serves as an officer or director, or holds an ownership interest of one percent or more.

**6**  Check this box if the vendor has given the local government officer or a family member of the officer one or more gifts as described in Section 176.003(a)(2)(B), excluding gifts described in Section 176.003(a-1).

**7**

\_\_\_\_\_  
Signature of vendor doing business with the governmental entity

\_\_\_\_\_  
Date

## **CONFLICT OF INTEREST QUESTIONNAIRE**

### **For vendor doing business with local governmental entity**

A complete copy of Chapter 176 of the Local Government Code may be found at <http://www.statutes.legis.state.tx.us/Docs/LG/htm/LG.176.htm>. For easy reference, below are some of the sections cited on this form.

**Local Government Code § 176.001(1-a):** "Business relationship" means a connection between two or more parties based on commercial activity of one of the parties. The term does not include a connection based on:

- (A) a transaction that is subject to rate or fee regulation by a federal, state, or local governmental entity or an agency of a federal, state, or local governmental entity;
- (B) a transaction conducted at a price and subject to terms available to the public; or
- (C) a purchase or lease of goods or services from a person that is chartered by a state or federal agency and that is subject to regular examination by, and reporting to, that agency.

**Local Government Code § 176.003(a)(2)(A) and (B):**

(a) A local government officer shall file a conflicts disclosure statement with respect to a vendor if:

\*\*\*

(2) the vendor:

(A) has an employment or other business relationship with the local government officer or a family member of the officer that results in the officer or family member receiving taxable income, other than investment income, that exceeds \$2,500 during the 12-month period preceding the date that the officer becomes aware that

(i) a contract between the local governmental entity and vendor has been executed;  
or

(ii) the local governmental entity is considering entering into a contract with the vendor;

(B) has given to the local government officer or a family member of the officer one or more gifts that have an aggregate value of more than \$100 in the 12-month period preceding the date the officer becomes aware that:

(i) a contract between the local governmental entity and vendor has been executed; or  
(ii) the local governmental entity is considering entering into a contract with the vendor.

**Local Government Code § 176.006(a) and (a-1)**

(a) A vendor shall file a completed conflict of interest questionnaire if the vendor has a business relationship with a local governmental entity and:

(1) has an employment or other business relationship with a local government officer of that local governmental entity, or a family member of the officer, described by Section 176.003(a)(2)(A);

(2) has given a local government officer of that local governmental entity, or a family member of the officer, one or more gifts with the aggregate value specified by Section 176.003(a)(2)(B), excluding any gift described by Section 176.003(a-1); or

(3) has a family relationship with a local government officer of that local governmental entity.

(a-1) The completed conflict of interest questionnaire must be filed with the appropriate records administrator not later than the seventh business day after the later of:

(1) the date that the vendor:

(A) begins discussions or negotiations to enter into a contract with the local governmental entity; or

(B) submits to the local governmental entity an application, response to a request for proposals or bids, correspondence, or another writing related to a potential contract with the local governmental entity; or

(2) the date the vendor becomes aware:

(A) of an employment or other business relationship with a local government officer, or a family member of the officer, described by Subsection (a);

(B) that the vendor has given one or more gifts described by Subsection (a); or

(C) of a family relationship with a local government officer.

# Request for Taxpayer Identification Number and Certification

Go to [www.irs.gov/FormW9](http://www.irs.gov/FormW9) for instructions and the latest information.

**Give form to the  
 requester. Do not  
 send to the IRS.**

**Before you begin.** For guidance related to the purpose of Form W-9, see *Purpose of Form*, below.

<b>Print or type. See Specific Instructions on page 3.</b>	<b>1</b>	Name of entity/individual. An entry is required. (For a sole proprietor or disregarded entity, enter the owner's name on line 1, and enter the business/disregarded entity's name on line 2.)	
	<b>2</b>	Business name/disregarded entity name, if different from above.	
	<b>3a</b>	Check the appropriate box for federal tax classification of the entity/individual whose name is entered on line 1. Check only <b>one</b> of the following seven boxes.  <input type="checkbox"/> Individual/sole proprietor <input type="checkbox"/> C corporation <input type="checkbox"/> S corporation <input type="checkbox"/> Partnership <input type="checkbox"/> Trust/estate  <input type="checkbox"/> LLC. Enter the tax classification (C = C corporation, S = S corporation, P = Partnership) _____ <b>Note:</b> Check the "LLC" box above and, in the entry space, enter the appropriate code (C, S, or P) for the tax classification of the LLC, unless it is a disregarded entity. A disregarded entity should instead check the appropriate box for the tax classification of its owner.  <input type="checkbox"/> Other (see instructions) _____	<b>4</b> Exemptions (codes apply only to certain entities, not individuals; see instructions on page 3):  Exempt payee code (if any) _____  Exemption from Foreign Account Tax Compliance Act (FATCA) reporting code (if any) _____  <i>(Applies to accounts maintained outside the United States.)</i>
	<b>3b</b>	If on line 3a you checked "Partnership" or "Trust/estate," or checked "LLC" and entered "P" as its tax classification, and you are providing this form to a partnership, trust, or estate in which you have an ownership interest, check this box if you have any foreign partners, owners, or beneficiaries. See instructions _____ <input type="checkbox"/>	
	<b>5</b>	Address (number, street, and apt. or suite no.). See instructions.	Requester's name and address (optional)
	<b>6</b>	City, state, and ZIP code	
	<b>7</b>	List account number(s) here (optional)	

## Part I Taxpayer Identification Number (TIN)

Enter your TIN in the appropriate box. The TIN provided must match the name given on line 1 to avoid backup withholding. For individuals, this is generally your social security number (SSN). However, for a resident alien, sole proprietor, or disregarded entity, see the instructions for Part I, later. For other entities, it is your employer identification number (EIN). If you do not have a number, see *How to get a TIN*, later.

<b>Social security number</b>									
				-					
<b>or</b>									
<b>Employer identification number</b>									

**Note:** If the account is in more than one name, see the instructions for line 1. See also *What Name and Number To Give the Requester* for guidelines on whose number to enter.

## Part II Certification

Under penalties of perjury, I certify that:

1. The number shown on this form is my correct taxpayer identification number (or I am waiting for a number to be issued to me); and
2. I am not subject to backup withholding because (a) I am exempt from backup withholding, or (b) I have not been notified by the Internal Revenue Service (IRS) that I am subject to backup withholding as a result of a failure to report all interest or dividends, or (c) the IRS has notified me that I am no longer subject to backup withholding; and
3. I am a U.S. citizen or other U.S. person (defined below); and
4. The FATCA code(s) entered on this form (if any) indicating that I am exempt from FATCA reporting is correct.

**Certification instructions.** You must cross out item 2 above if you have been notified by the IRS that you are currently subject to backup withholding because you have failed to report all interest and dividends on your tax return. For real estate transactions, item 2 does not apply. For mortgage interest paid, acquisition or abandonment of secured property, cancellation of debt, contributions to an individual retirement arrangement (IRA), and, generally, payments other than interest and dividends, you are not required to sign the certification, but you must provide your correct TIN. See the instructions for Part II, later.

<b>Sign Here</b>	Signature of U.S. person	Date
------------------	--------------------------	------

## General Instructions

Section references are to the Internal Revenue Code unless otherwise noted.

**Future developments.** For the latest information about developments related to Form W-9 and its instructions, such as legislation enacted after they were published, go to [www.irs.gov/FormW9](http://www.irs.gov/FormW9).

## What's New

Line 3a has been modified to clarify how a disregarded entity completes this line. An LLC that is a disregarded entity should check the appropriate box for the tax classification of its owner. Otherwise, it should check the "LLC" box and enter its appropriate tax classification.

New line 3b has been added to this form. A flow-through entity is required to complete this line to indicate that it has direct or indirect foreign partners, owners, or beneficiaries when it provides the Form W-9 to another flow-through entity in which it has an ownership interest. This change is intended to provide a flow-through entity with information regarding the status of its indirect foreign partners, owners, or beneficiaries, so that it can satisfy any applicable reporting requirements. For example, a partnership that has any indirect foreign partners may be required to complete Schedules K-2 and K-3. See the Partnership Instructions for Schedules K-2 and K-3 (Form 1065).

## Purpose of Form

An individual or entity (Form W-9 requester) who is required to file an information return with the IRS is giving you this form because they

must obtain your correct taxpayer identification number (TIN), which may be your social security number (SSN), individual taxpayer identification number (ITIN), adoption taxpayer identification number (ATIN), or employer identification number (EIN), to report on an information return the amount paid to you, or other amount reportable on an information return. Examples of information returns include, but are not limited to, the following.

- Form 1099-INT (interest earned or paid).
- Form 1099-DIV (dividends, including those from stocks or mutual funds).
- Form 1099-MISC (various types of income, prizes, awards, or gross proceeds).
- Form 1099-NEC (nonemployee compensation).
- Form 1099-B (stock or mutual fund sales and certain other transactions by brokers).
- Form 1099-S (proceeds from real estate transactions).
- Form 1099-K (merchant card and third-party network transactions).
- Form 1098 (home mortgage interest), 1098-E (student loan interest), and 1098-T (tuition).
- Form 1099-C (canceled debt).
- Form 1099-A (acquisition or abandonment of secured property).

Use Form W-9 only if you are a U.S. person (including a resident alien), to provide your correct TIN.

**Caution:** If you don't return Form W-9 to the requester with a TIN, you might be subject to backup withholding. See *What is backup withholding*, later.

**By signing the filled-out form**, you:

1. Certify that the TIN you are giving is correct (or you are waiting for a number to be issued);
2. Certify that you are not subject to backup withholding; or
3. Claim exemption from backup withholding if you are a U.S. exempt payee; and
4. Certify to your non-foreign status for purposes of withholding under chapter 3 or 4 of the Code (if applicable); and
5. Certify that FATCA code(s) entered on this form (if any) indicating that you are exempt from the FATCA reporting is correct. See *What Is FATCA Reporting*, later, for further information.

**Note:** If you are a U.S. person and a requester gives you a form other than Form W-9 to request your TIN, you must use the requester's form if it is substantially similar to this Form W-9.

**Definition of a U.S. person.** For federal tax purposes, you are considered a U.S. person if you are:

- An individual who is a U.S. citizen or U.S. resident alien;
- A partnership, corporation, company, or association created or organized in the United States or under the laws of the United States;
- An estate (other than a foreign estate); or
- A domestic trust (as defined in Regulations section 301.7701-7).

**Establishing U.S. status for purposes of chapter 3 and chapter 4 withholding.** Payments made to foreign persons, including certain distributions, allocations of income, or transfers of sales proceeds, may be subject to withholding under chapter 3 or chapter 4 of the Code (sections 1441–1474). Under those rules, if a Form W-9 or other certification of non-foreign status has not been received, a withholding agent, transferee, or partnership (payor) generally applies presumption rules that may require the payor to withhold applicable tax from the recipient, owner, transferor, or partner (payee). See Pub. 515, *Withholding of Tax on Nonresident Aliens and Foreign Entities*.

The following persons must provide Form W-9 to the payor for purposes of establishing its non-foreign status.

- In the case of a disregarded entity with a U.S. owner, the U.S. owner of the disregarded entity and not the disregarded entity.
- In the case of a grantor trust with a U.S. grantor or other U.S. owner, generally, the U.S. grantor or other U.S. owner of the grantor trust and not the grantor trust.
- In the case of a U.S. trust (other than a grantor trust), the U.S. trust and not the beneficiaries of the trust.

See Pub. 515 for more information on providing a Form W-9 or a certification of non-foreign status to avoid withholding.

**Foreign person.** If you are a foreign person or the U.S. branch of a foreign bank that has elected to be treated as a U.S. person (under Regulations section 1.1441-1(b)(2)(iv) or other applicable section for chapter 3 or 4 purposes), do not use Form W-9. Instead, use the appropriate Form W-8 or Form 8233 (see Pub. 515). If you are a qualified foreign pension fund under Regulations section 1.897(l)-1(d), or a partnership that is wholly owned by qualified foreign pension funds, that is treated as a non-foreign person for purposes of section 1445 withholding, do not use Form W-9. Instead, use Form W-8EXP (or other certification of non-foreign status).

**Nonresident alien who becomes a resident alien.** Generally, only a nonresident alien individual may use the terms of a tax treaty to reduce or eliminate U.S. tax on certain types of income. However, most tax treaties contain a provision known as a saving clause. Exceptions specified in the saving clause may permit an exemption from tax to continue for certain types of income even after the payee has otherwise become a U.S. resident alien for tax purposes.

If you are a U.S. resident alien who is relying on an exception contained in the saving clause of a tax treaty to claim an exemption from U.S. tax on certain types of income, you must attach a statement to Form W-9 that specifies the following five items.

1. The treaty country. Generally, this must be the same treaty under which you claimed exemption from tax as a nonresident alien.
2. The treaty article addressing the income.
3. The article number (or location) in the tax treaty that contains the saving clause and its exceptions.
4. The type and amount of income that qualifies for the exemption from tax.
5. Sufficient facts to justify the exemption from tax under the terms of the treaty article.

**Example.** Article 20 of the U.S.-China income tax treaty allows an exemption from tax for scholarship income received by a Chinese student temporarily present in the United States. Under U.S. law, this student will become a resident alien for tax purposes if their stay in the United States exceeds 5 calendar years. However, paragraph 2 of the first Protocol to the U.S.-China treaty (dated April 30, 1984) allows the provisions of Article 20 to continue to apply even after the Chinese student becomes a resident alien of the United States. A Chinese student who qualifies for this exception (under paragraph 2 of the first Protocol) and is relying on this exception to claim an exemption from tax on their scholarship or fellowship income would attach to Form W-9 a statement that includes the information described above to support that exemption.

If you are a nonresident alien or a foreign entity, give the requester the appropriate completed Form W-8 or Form 8233.

## Backup Withholding

**What is backup withholding?** Persons making certain payments to you must under certain conditions withhold and pay to the IRS 24% of such payments. This is called "backup withholding." Payments that may be subject to backup withholding include, but are not limited to, interest, tax-exempt interest, dividends, broker and barter exchange transactions, rents, royalties, nonemployee pay, payments made in settlement of payment card and third-party network transactions, and certain payments from fishing boat operators. Real estate transactions are not subject to backup withholding.

You will not be subject to backup withholding on payments you receive if you give the requester your correct TIN, make the proper certifications, and report all your taxable interest and dividends on your tax return.

**Payments you receive will be subject to backup withholding if:**

1. You do not furnish your TIN to the requester;
2. You do not certify your TIN when required (see the instructions for Part II for details);
3. The IRS tells the requester that you furnished an incorrect TIN;
4. The IRS tells you that you are subject to backup withholding because you did not report all your interest and dividends on your tax return (for reportable interest and dividends only); or
5. You do not certify to the requester that you are not subject to backup withholding, as described in item 4 under "*By signing the filled-out form*" above (for reportable interest and dividend accounts opened after 1983 only).

Certain payees and payments are exempt from backup withholding. See *Exempt payee code*, later, and the separate Instructions for the Requester of Form W-9 for more information.

See also *Establishing U.S. status for purposes of chapter 3 and chapter 4 withholding*, earlier.

## What Is FATCA Reporting?

The Foreign Account Tax Compliance Act (FATCA) requires a participating foreign financial institution to report all U.S. account holders that are specified U.S. persons. Certain payees are exempt from FATCA reporting. See *Exemption from FATCA reporting code*, later, and the Instructions for the Requester of Form W-9 for more information.

## Updating Your Information

You must provide updated information to any person to whom you claimed to be an exempt payee if you are no longer an exempt payee and anticipate receiving reportable payments in the future from this person. For example, you may need to provide updated information if you are a C corporation that elects to be an S corporation, or if you are no longer tax exempt. In addition, you must furnish a new Form W-9 if the name or TIN changes for the account, for example, if the grantor of a grantor trust dies.

## Penalties

**Failure to furnish TIN.** If you fail to furnish your correct TIN to a requester, you are subject to a penalty of \$50 for each such failure unless your failure is due to reasonable cause and not to willful neglect.

**Civil penalty for false information with respect to withholding.** If you make a false statement with no reasonable basis that results in no backup withholding, you are subject to a \$500 penalty.

**Criminal penalty for falsifying information.** Willfully falsifying certifications or affirmations may subject you to criminal penalties including fines and/or imprisonment.

**Misuse of TINs.** If the requester discloses or uses TINs in violation of federal law, the requester may be subject to civil and criminal penalties.

## Specific Instructions

### Line 1

You must enter one of the following on this line; **do not** leave this line blank. The name should match the name on your tax return.

If this Form W-9 is for a joint account (other than an account maintained by a foreign financial institution (FFI)), list first, and then circle, the name of the person or entity whose number you entered in Part I of Form W-9. If you are providing Form W-9 to an FFI to document a joint account, each holder of the account that is a U.S. person must provide a Form W-9.

- **Individual.** Generally, enter the name shown on your tax return. If you have changed your last name without informing the Social Security Administration (SSA) of the name change, enter your first name, the last name as shown on your social security card, and your new last name.

**Note for ITIN applicant:** Enter your individual name as it was entered on your Form W-7 application, line 1a. This should also be the same as the name you entered on the Form 1040 you filed with your application.

- **Sole proprietor.** Enter your individual name as shown on your Form 1040 on line 1. Enter your business, trade, or “doing business as” (DBA) name on line 2.

- **Partnership, C corporation, S corporation, or LLC, other than a disregarded entity.** Enter the entity’s name as shown on the entity’s tax return on line 1 and any business, trade, or DBA name on line 2.

- **Other entities.** Enter your name as shown on required U.S. federal tax documents on line 1. This name should match the name shown on the charter or other legal document creating the entity. Enter any business, trade, or DBA name on line 2.

- **Disregarded entity.** In general, a business entity that has a single owner, including an LLC, and is not a corporation, is disregarded as an entity separate from its owner (a disregarded entity). See Regulations section 301.7701-2(c)(2). A disregarded entity should check the appropriate box for the tax classification of its owner. Enter the owner’s name on line 1. The name of the owner entered on line 1 should never be a disregarded entity. The name on line 1 should be the name shown on the income tax return on which the income should be reported. For

example, if a foreign LLC that is treated as a disregarded entity for U.S. federal tax purposes has a single owner that is a U.S. person, the U.S. owner’s name is required to be provided on line 1. If the direct owner of the entity is also a disregarded entity, enter the first owner that is not disregarded for federal tax purposes. Enter the disregarded entity’s name on line 2. If the owner of the disregarded entity is a foreign person, the owner must complete an appropriate Form W-8 instead of a Form W-9. This is the case even if the foreign person has a U.S. TIN.

### Line 2

If you have a business name, trade name, DBA name, or disregarded entity name, enter it on line 2.

### Line 3a

Check the appropriate box on line 3a for the U.S. federal tax classification of the person whose name is entered on line 1. Check only one box on line 3a.

IF the entity/individual on line 1 is a(n) . . .	THEN check the box for . . .
• Corporation	Corporation.
• Individual or • Sole proprietorship	Individual/sole proprietor.
• LLC classified as a partnership for U.S. federal tax purposes or • LLC that has filed Form 8832 or 2553 electing to be taxed as a corporation	Limited liability company and enter the appropriate tax classification: P = Partnership, C = C corporation, or S = S corporation.
• Partnership	Partnership.
• Trust/estate	Trust/estate.

### Line 3b

Check this box if you are a partnership (including an LLC classified as a partnership for U.S. federal tax purposes), trust, or estate that has any foreign partners, owners, or beneficiaries, and you are providing this form to a partnership, trust, or estate, in which you have an ownership interest. You must check the box on line 3b if you receive a Form W-8 (or documentary evidence) from any partner, owner, or beneficiary establishing foreign status or if you receive a Form W-9 from any partner, owner, or beneficiary that has checked the box on line 3b.

**Note:** A partnership that provides a Form W-9 and checks box 3b may be required to complete Schedules K-2 and K-3 (Form 1065). For more information, see the Partnership Instructions for Schedules K-2 and K-3 (Form 1065).

If you are required to complete line 3b but fail to do so, you may not receive the information necessary to file a correct information return with the IRS or furnish a correct payee statement to your partners or beneficiaries. See, for example, sections 6698, 6722, and 6724 for penalties that may apply.

### Line 4 Exemptions

If you are exempt from backup withholding and/or FATCA reporting, enter in the appropriate space on line 4 any code(s) that may apply to you.

#### Exempt payee code.

- Generally, individuals (including sole proprietors) are not exempt from backup withholding.
- Except as provided below, corporations are exempt from backup withholding for certain payments, including interest and dividends.
- Corporations are not exempt from backup withholding for payments made in settlement of payment card or third-party network transactions.
- Corporations are not exempt from backup withholding with respect to attorneys’ fees or gross proceeds paid to attorneys, and corporations that provide medical or health care services are not exempt with respect to payments reportable on Form 1099-MISC.

The following codes identify payees that are exempt from backup withholding. Enter the appropriate code in the space on line 4.

1—An organization exempt from tax under section 501(a), any IRA, or a custodial account under section 403(b)(7) if the account satisfies the requirements of section 401(f)(2).

- 2—The United States or any of its agencies or instrumentalities.
- 3—A state, the District of Columbia, a U.S. commonwealth or territory, or any of their political subdivisions or instrumentalities.
- 4—A foreign government or any of its political subdivisions, agencies, or instrumentalities.
- 5—A corporation.
- 6—A dealer in securities or commodities required to register in the United States, the District of Columbia, or a U.S. commonwealth or territory.
- 7—A futures commission merchant registered with the Commodity Futures Trading Commission.
- 8—A real estate investment trust.
- 9—An entity registered at all times during the tax year under the Investment Company Act of 1940.
- 10—A common trust fund operated by a bank under section 584(a).
- 11—A financial institution as defined under section 581.
- 12—A middleman known in the investment community as a nominee or custodian.
- 13—A trust exempt from tax under section 664 or described in section 4947.

The following chart shows types of payments that may be exempt from backup withholding. The chart applies to the exempt payees listed above, 1 through 13.

IF the payment is for . . .	THEN the payment is exempt for . . .
• Interest and dividend payments	All exempt payees except for 7.
• Broker transactions	Exempt payees 1 through 4 and 6 through 11 and all C corporations. S corporations must not enter an exempt payee code because they are exempt only for sales of noncovered securities acquired prior to 2012.
• Barter exchange transactions and patronage dividends	Exempt payees 1 through 4.
• Payments over \$600 required to be reported and direct sales over \$5,000 <sup>1</sup>	Generally, exempt payees 1 through 5. <sup>2</sup>
• Payments made in settlement of payment card or third-party network transactions	Exempt payees 1 through 4.

<sup>1</sup> See Form 1099-MISC, Miscellaneous Information, and its instructions.

<sup>2</sup> However, the following payments made to a corporation and reportable on Form 1099-MISC are not exempt from backup withholding: medical and health care payments, attorneys' fees, gross proceeds paid to an attorney reportable under section 6045(f), and payments for services paid by a federal executive agency.

**Exemption from FATCA reporting code.** The following codes identify payees that are exempt from reporting under FATCA. These codes apply to persons submitting this form for accounts maintained outside of the United States by certain foreign financial institutions. Therefore, if you are only submitting this form for an account you hold in the United States, you may leave this field blank. Consult with the person requesting this form if you are uncertain if the financial institution is subject to these requirements. A requester may indicate that a code is not required by providing you with a Form W-9 with "Not Applicable" (or any similar indication) entered on the line for a FATCA exemption code.

A—An organization exempt from tax under section 501(a) or any individual retirement plan as defined in section 7701(a)(37).

B—The United States or any of its agencies or instrumentalities.

C—A state, the District of Columbia, a U.S. commonwealth or territory, or any of their political subdivisions or instrumentalities.

D—A corporation the stock of which is regularly traded on one or more established securities markets, as described in Regulations section 1.1472-1(c)(1)(i).

E—A corporation that is a member of the same expanded affiliated group as a corporation described in Regulations section 1.1472-1(c)(1)(i).

F—A dealer in securities, commodities, or derivative financial instruments (including notional principal contracts, futures, forwards, and options) that is registered as such under the laws of the United States or any state.

G—A real estate investment trust.

H—A regulated investment company as defined in section 851 or an entity registered at all times during the tax year under the Investment Company Act of 1940.

I—A common trust fund as defined in section 584(a).

J—A bank as defined in section 581.

K—A broker.

L—A trust exempt from tax under section 664 or described in section 4947(a)(1).

M—A tax-exempt trust under a section 403(b) plan or section 457(g) plan.

**Note:** You may wish to consult with the financial institution requesting this form to determine whether the FATCA code and/or exempt payee code should be completed.

### Line 5

Enter your address (number, street, and apartment or suite number). This is where the requester of this Form W-9 will mail your information returns. If this address differs from the one the requester already has on file, enter "NEW" at the top. If a new address is provided, there is still a chance the old address will be used until the payor changes your address in their records.

### Line 6

Enter your city, state, and ZIP code.

## Part I. Taxpayer Identification Number (TIN)

**Enter your TIN in the appropriate box.** If you are a resident alien and you do not have, and are not eligible to get, an SSN, your TIN is your IRS ITIN. Enter it in the entry space for the Social security number. If you do not have an ITIN, see *How to get a TIN* below.

If you are a sole proprietor and you have an EIN, you may enter either your SSN or EIN.

If you are a single-member LLC that is disregarded as an entity separate from its owner, enter the owner's SSN (or EIN, if the owner has one). If the LLC is classified as a corporation or partnership, enter the entity's EIN.

**Note:** See *What Name and Number To Give the Requester*, later, for further clarification of name and TIN combinations.

**How to get a TIN.** If you do not have a TIN, apply for one immediately. To apply for an SSN, get Form SS-5, Application for a Social Security Card, from your local SSA office or get this form online at [www.SSA.gov](http://www.SSA.gov). You may also get this form by calling 800-772-1213. Use Form W-7, Application for IRS Individual Taxpayer Identification Number, to apply for an ITIN, or Form SS-4, Application for Employer Identification Number, to apply for an EIN. You can apply for an EIN online by accessing the IRS website at [www.irs.gov/EIN](http://www.irs.gov/EIN). Go to [www.irs.gov/Forms](http://www.irs.gov/Forms) to view, download, or print Form W-7 and/or Form SS-4. Or, you can go to [www.irs.gov/OrderForms](http://www.irs.gov/OrderForms) to place an order and have Form W-7 and/or Form SS-4 mailed to you within 15 business days.

If you are asked to complete Form W-9 but do not have a TIN, apply for a TIN and enter "Applied For" in the space for the TIN, sign and date the form, and give it to the requester. For interest and dividend payments, and certain payments made with respect to readily tradable instruments, you will generally have 60 days to get a TIN and give it to the requester before you are subject to backup withholding on payments. The 60-day rule does not apply to other types of payments. You will be subject to backup withholding on all such payments until you provide your TIN to the requester.

**Note:** Entering "Applied For" means that you have already applied for a TIN or that you intend to apply for one soon. See also *Establishing U.S. status for purposes of chapter 3 and chapter 4 withholding*, earlier, for when you may instead be subject to withholding under chapter 3 or 4 of the Code.

**Caution:** A disregarded U.S. entity that has a foreign owner must use the appropriate Form W-8.

## Part II. Certification

To establish to the withholding agent that you are a U.S. person, or resident alien, sign Form W-9. You may be requested to sign by the withholding agent even if item 1, 4, or 5 below indicates otherwise.

For a joint account, only the person whose TIN is shown in Part I should sign (when required). In the case of a disregarded entity, the person identified on line 1 must sign. Exempt payees, see *Exempt payee code*, earlier.

**Signature requirements.** Complete the certification as indicated in items 1 through 5 below.

**1. Interest, dividend, and barter exchange accounts opened before 1984 and broker accounts considered active during 1983.** You must give your correct TIN, but you do not have to sign the certification.

**2. Interest, dividend, broker, and barter exchange accounts opened after 1983 and broker accounts considered inactive during 1983.** You must sign the certification or backup withholding will apply. If you are subject to backup withholding and you are merely providing your correct TIN to the requester, you must cross out item 2 in the certification before signing the form.

**3. Real estate transactions.** You must sign the certification. You may cross out item 2 of the certification.

**4. Other payments.** You must give your correct TIN, but you do not have to sign the certification unless you have been notified that you have previously given an incorrect TIN. "Other payments" include payments made in the course of the requester's trade or business for rents, royalties, goods (other than bills for merchandise), medical and health care services (including payments to corporations), payments to a nonemployee for services, payments made in settlement of payment card and third-party network transactions, payments to certain fishing boat crew members and fishermen, and gross proceeds paid to attorneys (including payments to corporations).

**5. Mortgage interest paid by you, acquisition or abandonment of secured property, cancellation of debt, qualified tuition program payments (under section 529), ABLE accounts (under section 529A), IRA, Coverdell ESA, Archer MSA or HSA contributions or distributions, and pension distributions.** You must give your correct TIN, but you do not have to sign the certification.

## What Name and Number To Give the Requester

For this type of account:	Give name and SSN of:
1. Individual	The individual
2. Two or more individuals (joint account) other than an account maintained by an FFI	The actual owner of the account or, if combined funds, the first individual on the account <sup>1</sup>
3. Two or more U.S. persons (joint account maintained by an FFI)	Each holder of the account
4. Custodial account of a minor (Uniform Gift to Minors Act)	The minor <sup>2</sup>
5. a. The usual revocable savings trust (grantor is also trustee)	The grantor-trustee <sup>1</sup>
b. So-called trust account that is not a legal or valid trust under state law	The actual owner <sup>1</sup>
6. Sole proprietorship or disregarded entity owned by an individual	The owner <sup>3</sup>
7. Grantor trust filing under Optional Filing Method 1 (see Regulations section 1.671-4(b)(2)(i)(A))**	The grantor*

For this type of account:	Give name and EIN of:
8. Disregarded entity not owned by an individual	The owner
9. A valid trust, estate, or pension trust	Legal entity <sup>4</sup>
10. Corporation or LLC electing corporate status on Form 8832 or Form 2553	The corporation
11. Association, club, religious, charitable, educational, or other tax-exempt organization	The organization
12. Partnership or multi-member LLC	The partnership
13. A broker or registered nominee	The broker or nominee
14. Account with the Department of Agriculture in the name of a public entity (such as a state or local government, school district, or prison) that receives agricultural program payments	The public entity
15. Grantor trust filing Form 1041 or under the Optional Filing Method 2, requiring Form 1099 (see Regulations section 1.671-4(b)(2)(i)(B))**	The trust

<sup>1</sup> List first and circle the name of the person whose number you furnish. If only one person on a joint account has an SSN, that person's number must be furnished.

<sup>2</sup> Circle the minor's name and furnish the minor's SSN.

<sup>3</sup> You must show your individual name on line 1, and enter your business or DBA name, if any, on line 2. You may use either your SSN or EIN (if you have one), but the IRS encourages you to use your SSN.

<sup>4</sup> List first and circle the name of the trust, estate, or pension trust. (Do not furnish the TIN of the personal representative or trustee unless the legal entity itself is not designated in the account title.)

\* **Note:** The grantor must also provide a Form W-9 to the trustee of the trust.

\*\* For more information on optional filing methods for grantor trusts, see the Instructions for Form 1041.

**Note:** If no name is circled when more than one name is listed, the number will be considered to be that of the first name listed.

## Secure Your Tax Records From Identity Theft

Identity theft occurs when someone uses your personal information, such as your name, SSN, or other identifying information, without your permission to commit fraud or other crimes. An identity thief may use your SSN to get a job or may file a tax return using your SSN to receive a refund.

To reduce your risk:

- Protect your SSN,
- Ensure your employer is protecting your SSN, and
- Be careful when choosing a tax return preparer.

If your tax records are affected by identity theft and you receive a notice from the IRS, respond right away to the name and phone number printed on the IRS notice or letter.

If your tax records are not currently affected by identity theft but you think you are at risk due to a lost or stolen purse or wallet, questionable credit card activity, or a questionable credit report, contact the IRS Identity Theft Hotline at 800-908-4490 or submit Form 14039.

For more information, see Pub. 5027, Identity Theft Information for Taxpayers.

Victims of identity theft who are experiencing economic harm or a systemic problem, or are seeking help in resolving tax problems that have not been resolved through normal channels, may be eligible for Taxpayer Advocate Service (TAS) assistance. You can reach TAS by calling the TAS toll-free case intake line at 877-777-4778 or TTY/TDD 800-829-4059.

**Protect yourself from suspicious emails or phishing schemes.**

Phishing is the creation and use of email and websites designed to mimic legitimate business emails and websites. The most common act is sending an email to a user falsely claiming to be an established legitimate enterprise in an attempt to scam the user into surrendering private information that will be used for identity theft.

The IRS does not initiate contacts with taxpayers via emails. Also, the IRS does not request personal detailed information through email or ask taxpayers for the PIN numbers, passwords, or similar secret access information for their credit card, bank, or other financial accounts.


If you receive an unsolicited email claiming to be from the IRS, forward this message to [phishing@irs.gov](mailto:phishing@irs.gov). You may also report misuse of the IRS name, logo, or other IRS property to the Treasury Inspector General for Tax Administration (TIGTA) at 800-366-4484. You can forward suspicious emails to the Federal Trade Commission at [spam@uce.gov](mailto:spam@uce.gov) or report them at [www.ftc.gov/complaint](http://www.ftc.gov/complaint). You can contact the FTC at [www.ftc.gov/idtheft](http://www.ftc.gov/idtheft) or 877-IDTHEFT (877-438-4338). If you have been the victim of identity theft, see [www.IdentityTheft.gov](http://www.IdentityTheft.gov) and Pub. 5027.

Go to [www.irs.gov/IdentityTheft](http://www.irs.gov/IdentityTheft) to learn more about identity theft and how to reduce your risk.

## Privacy Act Notice

Section 6109 of the Internal Revenue Code requires you to provide your correct TIN to persons (including federal agencies) who are required to file information returns with the IRS to report interest, dividends, or certain other income paid to you; mortgage interest you paid; the acquisition or abandonment of secured property; the cancellation of debt; or contributions you made to an IRA, Archer MSA, or HSA. The person collecting this form uses the information on the form to file information returns with the IRS, reporting the above information. Routine uses of this information include giving it to the Department of Justice for civil and criminal litigation and to cities, states, the District of Columbia, and U.S. commonwealths and territories for use in administering their laws. The information may also be disclosed to other countries under a treaty, to federal and state agencies to enforce civil and criminal laws, or to federal law enforcement and intelligence agencies to combat terrorism. You must provide your TIN whether or not you are required to file a tax return. Under section 3406, payors must generally withhold a percentage of taxable interest, dividends, and certain other payments to a payee who does not give a TIN to the payor. Certain penalties may also apply for providing false or fraudulent information.

# **COLLIN COUNTY**

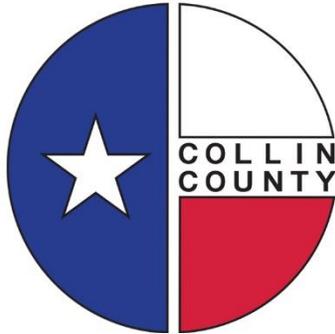

## **Collin County Adult Detention Center Cluster 1 Generator Project No. 251780**

**September 24, 2025**



**MD ENGINEERING**

**MD Engineering, LLP Texas**

**Registered Engineering Firm F-7489**

THIS PAGE INTENTIONALLY LEFT BLANK

TABLE OF CONTENTS

**DIVISION 26 – ELECTRICAL**

26 00 10	ELECTRICAL SUBMITTAL PROCESS
26 05 00	COMMON WORK RESULTS FOR ELECTRICAL SYSTEMS
26 05 01	ELECTRICAL DEMOLITION
26 05 02	ELECTRICAL WORK IN EXISTING FACILITIES
26 05 03	FIRE STOPPING
26 05 19	LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES
26 05 26	GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS
26 05 29	HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS
26 05 33	RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS
26 05 53	IDENTIFICATIONS FOR ELECTRICAL SYSTEMS
26 05 93	ELECTRICAL TESTING
26 32 13	ENGINE GENERATORS – DIESEL



**09/24/2025**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 00 10 – ELECTRICAL SUBMITTAL PROCESS**

**PART 1 - GENERAL**

**1.1 SUBMITTALS**

- A. Comply with all submittal provisions of Division 1.
- B. Submit electronic copies of the submittal to the prime consultant (i.e. architect) in order to process and track the submittals properly in accordance with Division 1 and 26 submittal requirements.
  - 1. Architects and consultants are to submit all submittals and RFI's to the electrical engineer electronically.
  - 2. Send to **"mdengca@md-eng.com"**.
  - 3. Submittals shall be labeled by their project specification section or CSI specification section if not listed in project specifications.
- C. Contractor is responsible to separate submittals per specification section. Unseparated submittals are subject to rejection without review.
- D. Allow a minimum of ten (10) working days for the review of submittals and each re-submittal.
- E. Submittals that have been reviewed and marked as REJECTED (REJ) or REVISE & RESUBMIT (RES) should be resubmitted within 10 days to be reviewed again by engineer.
- F. Compliance with the Contract documents shall be the sole responsibility of the Contractor. Items on equipment that were not accepted by the Architect in writing as an approved equal shall be replaced or revised to comply with the contract documents at the Contractor's expense.
- G. Resubmission of rejected submittals shall be limited to one (1) in number.
  - 1. Costs for processing subsequent resubmittals in excess of the first resubmittal, resulting from the Contractor's disregard of Architect/Engineer's primary submittal rejection comments, shall be borne by the Contractor.
    - a. Costs shall be based on Architect/Engineer's hourly rates as published in their current professional fee schedules and shall also include reimbursable costs for delivery, mailing, and photocopies at direct cost-plus ten percent (10%).
- H. Submittals required of materials and equipment include following:
  - 1. Materials list of items proposed to be provided under Division 26.
  - 2. Manufacturer's specifications and other data needed to prove compliance with specified requirements. Term "Compliance" is understood to mean that Contractor certifies that submitted equipment meets or exceeds Contract Document requirements. Items that do not clearly meet this definition should be identified and explained as required in following paragraph.
  - 3. Identify difference between specified item and proposed item. Explain with enough detail so that it can easily be determined that item complies with functional intent. List the disadvantages or advantages of proposed item versus specified item. Submit technical data sheets and/or pictures and diagrams to support and clarify. Organize in clear and concise format. Substitutions shall be approved in writing by Engineer. Engineer's decision shall be final.
  - 4. Items of equipment that are not accepted in writing as approved equal shall be replaced or revised to comply with Contract Documents at Contractor's expense.
  - 5. The manufacturers recommended installation procedures shall become basis for accepting or rejecting actual installation procedures used on Work.
  - 6. Shop drawings shall consist of detailed drawings with dimensions, schedules, weights, capacities, installation details and pertinent information needed to describe the material or equipment.
- I. Provide a dimension layout of electrical rooms(s) and generator equipment room(s) if applicable.

1.2 REQUIRED SPECIFICATIONS (PROJECT SPECIFIC)

A. The following chart indicates the submittals required for the project.

Required X	Submittal Name	Spec Reference
X	<b>Common Work Results for Electrical</b> <i>-Submittals, Shop Drawings.</i>	26 05 00
X	<b>Electrical Demolition</b> <i>-See Specification for information</i>	26 05 01
X	<b>Electrical Work in Existing Facilities</b> <i>-Site Inspection Report</i>	26 05 02
X	<b>Fire Stopping</b> <i>-Materials</i>	26 05 03
X	<b>Low Voltage Electrical Power Conductors and Cables</b> <i>-Conductors, Cables</i>	26 05 19
X	<b>Grounding &amp; Bonding for Electrical Systems</b> <i>-Materials, Chemical ground rod</i>	26 05 26
X	<b>Hangers &amp; Supports for Electrical Systems</b> <i>-Hanger &amp; clamps, Fabricated devices</i>	26 05 29
X	<b>Raceways and Boxes for Electrical Systems</b> <i>-Boxes, Floor Boxes</i>	26 05 33
X	<b>Identification for Electrical Systems</b> <i>-Submit all marking systems per spec.</i>	26 05 53
X	<b>Electrical Testing</b> <i>-Final Report</i>	26 05 93
X	<b>Engine Generators – Diesel</b> <i>-Manufacturer’s Sizing Report, Rating, Engine, -Alternators, Controls</i>	26 32 13

**END OF SECTION**

**SECTION 26 05 00 – COMMON WORK RESULTS FOR ELECTRICAL**

**PART 1 - GENERAL**

**1.1 RELATED DOCUMENTS**

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification sections, apply to work of this section.
- B. Division 01, Commissioning Requirements, applies to this section and will require the contractor participation in the commissioning process.

**1.2 SUMMARY**

- A. General Requirements for Electrical Work are intended to be complementary to General Requirements of Construction Contract.
- B. Work Included: Provide complete electrical systems where shown on Drawings, as specified herein, and as needed for complete and proper installation including, but not necessarily limited to following summary of Work.
  - 1. Packaged generator set
  - 2. Other items and services required to complete electrical systems.

**1.3 QUALITY ASSURANCE**

- A. Use adequate numbers of skilled workers thoroughly trained and experienced in necessary crafts and completely familiar with specified requirements and methods needed for proper performance of Work of this Division.
  - 1. Ensure that there is a minimum of one journeyman electrician, on job site whenever Division 26 Work is being performed.
- B. Scope of Work
  - 1. Without additional cost, furnish all labor, material, equipment, technical supervision, and incidental services required to complete, test and leave ready for operation the electrical systems as specified in Division 26 Specification section and as indicated on Drawings.
- C. Codes and Standards
  - 1. Perform all Work in accordance with applicable Federal, State and local codes rules, ordinances and regulations. The electrical and physical properties of all materials, and the design, performance characteristics, and methods of construction of all items of equipment, shall be in accordance with the latest issue of the various, applicable Standards, Rules and Regulations of NFPA, NECA, UL, and as follows unless otherwise indicated.
    - a. A.N.S.I. - American National Standards Institute
    - b. A.S.T.M. - American Society for Testing Materials
    - c. I.C.E.A. - Insulated Cable Engineers Association
    - d. I.E.E.E. - Institute of Electrical and Electronics Engineers
    - e. N.E.C. - National Electrical Code
    - f. N.E.C.A. - National Electrical Contractors Association
    - g. N.E.M.A. - National Electrical Manufacturer's Association
    - h. U.L. - Underwriters Laboratories, Inc.
    - i. N.E.C.A. 1-2000, "Practices for Good Workmanship in Electrical Contracting (ANSI)."
- D. Where available products included in the work shall "Listed" or "Certified" by a nationally recognized testing laboratory. The listing or certification shall be acceptable to the authority having jurisdiction. The listing or certification shall indicate that the product's safety-related standards have been evaluated with regard to all reasonably foreseeable safety-related hazards, including fire, electrical shock and mechanical hazards.

- E. Notify the Architect/Engineer before submitting a proposal should any changes in Drawings or Specifications be required to conform to the above codes, rules or regulations. After entering into Contract, make all changes required to conform to above ordinances, rules and regulations without additional expense to the Owner.
- F. All materials shall be new unless indicated otherwise to reuse existing equipment.
- G. Source Limitations: All equipment of the same or similar systems shall be by the same manufacturer.
- H. Tests and Inspections
  - 1. Perform all tests required by state, city, county and/or other agencies having jurisdiction.
  - 2. Provide all materials, equipment, etc., and labor required for tests.
- I. Performance Requirements
  - 1. Perform all work following practices for good workmanship, in accordance with the latest accepted standards and practices for the trades involved.
- J. Sequence and Schedule
  - 1. Work so as to avoid interference with the work of other trades. Be responsible for removing and relocating any work which in the opinion of the Owner's Representatives causes interference.

#### 1.4 CODES, PERMITS AND FEES

- A. Unless otherwise indicated, all required permits, licenses, inspections, approvals and fees for electrical work shall be secured and paid for by the Contractor.
- B. Prepare any detailed Drawings or diagrams which may be required by the governing authorities or authorities having jurisdiction. Where the Drawings and/or Specifications indicate materials or construction more than code requirements, the Drawings and/or Specifications shall govern.

#### 1.5 DRAWINGS

- A. The Drawings show the location and general arrangement of equipment, electrical systems and related items. They shall be followed as closely as elements of the construction will permit.
- B. Examine the Drawings of other trades and verify the conditions governing the work on the job site. Arrange work accordingly, providing such fittings, conduit, junction boxes and accessories as may be required to meet such conditions.
- C. Deviations from the Drawings, with the exception of minor changes in routing and other such incidental changes that do not affect the functioning or serviceability of the systems, shall not be made without the written approval of the Architect/Engineer.
- D. The architectural and structural Drawings take precedence in all matters pertaining to the building structure, mechanical Drawings in all matters pertaining to mechanical trades and electrical Drawings in all matters pertaining to electrical trades. Where there are conflicts or differences between the Drawings for the various trades, report such conflicts or differences to the Architect/Engineer for resolution. Drawings are not intended to be scaled for rough-in or to serve as shop drawings. Take all field measurements required to complete the Work.

#### 1.6 SUBMITTALS

- A. Comply with pertinent provisions of 26 00 10.
- B. Submittals required of materials and equipment include following:
  - 1. Materials list of items proposed to be provided under Division 26.
  - 2. Manufacturer's specifications and other data needed to prove compliance with specified requirements. Term "Compliance" is understood to mean that Contractor certifies that submitted equipment meets or exceeds Contract Document requirements. Items that do not clearly meet this definition should be identified and explained as required in following paragraph.

3. Identify difference between specified item and proposed item. Explain with enough detail so that it can easily be determined that item complies with functional intent. List the disadvantages or advantages of proposed item versus specified item. Submit technical data sheets and/or pictures and diagrams to support and clarify. Organize in clear and concise format. Substitutions shall be approved in writing by Engineer. Engineer's decision shall be final.
  4. Allow minimum of 10 working days for review of each submittal and re-submittal.
  5. Items of equipment that are not accepted in writing as approved equal shall be replaced or revised to comply with Contract Documents at Contractor's expense.
  6. The manufacturers recommended installation procedures shall become basis for accepting or rejecting actual installation procedures used on Work.
  7. Shop drawings shall consist of detailed drawings with dimensions, schedules, weights, capacities, installation details and pertinent information needed to describe the material or equipment.
- C. Submittals required of materials and equipment under this Division include following listed items not supplied by Owner. These submittal requirements are intended to be complimentary to requirements that may be listed in individual sections. In the event of conflict, more stringent requirement shall apply.
1. Conductors and Cables:
    - a. Submit product data for each specified product.
    - b. Submit tabular list of wire and wiring systems that will be increased in capacity or size to comply with Section 26 05 19 and/or similar requirements shown on Drawings. List shall include size shown on Drawings, proposed increase to comply with Section 26 0519, and proposed installed length.
  2. Raceways and Boxes:
    - a. Submit product data for surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
    - b. Submit Shop Drawings including layout drawings showing components and wiring for nonstandard boxes, enclosures, and cabinets.
  3. Engine-Generator Set:
    - a. Submit exhaust emissions. Submit prototype test data.
    - b. Submit wiring diagrams for the system, showing power and control connections and distinguishing between factory-installed and field-installed wiring.
    - c. Submit product data for products specified in this Section. Include data on features, components, ratings, and performance. Include a dimensioned outline plan and elevation drawings of the engine generator set, the weatherproof enclosure, sub-base fuel tank and other system components.
    - d. Submit maintenance data for the system and components for inclusion in Operating and Maintenance Manual specified in this Section.
    - e. Submit detailed operating instructions, covering operation under both normal and emergency conditions and sound test reports.
    - f. Submit certification of torsional vibration compatibility: Conform to NFPA 110.
    - g. Submit factory test reports for units to be shipped for this Project showing evidence of compliance with specified requirements.

1.7 MATERIAL AND EQUIPMENT MANUFACTURERS

- A. All items of equipment shall be furnished complete with all accessories normally supplied with the catalog items listed and all other accessories necessary for a complete and satisfactory operating system.
- B. All equipment and materials shall be new and shall be standard products of manufacturers regularly engaged in the production of electrical equipment and shall be of the manufacturer's latest design.

- C. If an approved manufacturer is other than the manufacturer used as the basis for design, the equipment or product provided;
  - 1. Shall be equal in size, quality, durability, appearance, capacity, and efficiency through all ranges of operation,
  - 2. Shall conform with arrangements and space limitations of the equipment shown on the plans and/or specified,
  - 3. Shall be compatible with the other components of the system,
  - 4. Shall be by the same manufacturer, and
  - 5. Shall comply with the requirements for Items Requiring Prior Approval specified in this section of the Specifications.
- D. All costs to make these items of equipment comply with these requirements including, but not limited to, electrical work, mechanical work, controls work, technology work and building alterations shall be included in the original Bid.

#### 1.8 INSPECTION OF SITE

- A. Visit the site, examine and verify the conditions under which the Work must be conducted before submitting Proposal. The submitting of a Proposal implies that the Contractor has visited the site and understands the conditions under which the Work must be conducted. No additional charges will be allowed because of failure to make this examination or to include all materials and labor to complete the Work.

#### 1.9 ITEMS REQUIRING PRIOR APPROVAL

- A. Bids shall be based upon manufactured equipment specified.
- B. All items that the Contractor proposes to use in the Work that are not specifically named in the Contract Documents must be submitted for review prior to bids. Such items must be submitted in compliance with Division 1 specifications.
- C. Requests for prior approval must be accompanied by complete catalog information, including but not limited to, model, size, accessories, complete electrical information and performance data in the form given in the equipment schedule on the drawings at stated design conditions. Where items are referred to by symbolic designations on the drawings, all requests for prior approval shall bear the same designations.
  - 1. Equipment to be considered for prior approval shall be equal in quality, durability, appearance, capacity and efficiency through all ranges of operation, shall fulfill the requirements of equipment arrangement and space limitations of the equipment shown on the plans and/or specified and shall be compatible with the other components of the system.
  - 2. All costs incurred to make equipment comply with other requirements, including providing maintenance, clearance, electrical, replacement of other components, and building alterations shall be included in the original bid.
- D. Voluntary alternates may be submitted for consideration, with listed addition or deduction to the bid.

#### 1.10 SHOP DRAWINGS/SUBMITTALS

- A. Submit project-specific submittals for review in compliance with Division 26 00 10
- B. Submittals required of materials and equipment include following:
  - 1. Materials list of items proposed to be provided under Division 26.
  - 2. Manufacturer's specifications and other data needed to prove compliance with specified requirements. Term "Compliance" is understood to mean that Contractor certifies that submitted equipment meets or exceeds Contract Document requirements. Items that do not clearly meet this definition should be identified and explained as required in following paragraph.

3. Identify difference between specified item and proposed item. Explain with enough detail so that it can easily be determined that item complies with functional intent. List the disadvantages or advantages of proposed item versus specified item. Submit technical data sheets and/or pictures and diagrams to support and clarify. Organize in clear and concise format. Substitutions shall be approved in writing by Engineer. Engineer's decision shall be final.
  4. Allow minimum of 10 working days for review of each submittal and re-submittal.
  5. Items of equipment that are not accepted in writing as approved equal shall be replaced or revised to comply with Contract Documents at Contractor's expense.
  6. The manufacturers recommended installation procedures shall become basis for accepting or rejecting actual installation procedures used on Work.
  7. Shop drawings shall consist of detailed drawings with dimensions, schedules, weights, capacities, installation details and pertinent information needed to describe the material or equipment.
- C. All shop Drawings shall be submitted in groupings of similar and/or related items (lighting fixtures, switchgear, etc.). Incomplete submittal groupings will be returned unchecked.
- D. If deviations (not substitutions) from Contract Documents are deemed necessary by the Contractor, details of such deviations, including changes in related portions of the project and the reasons therefore, shall be submitted with the submittal for approval.
- E. Submit for approval shop drawings for all electrical systems and equipment as listed below.
1. Where items are referred to by symbolic designation on the Drawings and in the Specifications, all submittals shall bear a similar designation (light fixtures, wiring devices, etc.) as identified on the Drawings and in the Specifications and shall be submitted together and under the same cover, unless requested otherwise.
- F. Refer to other sections of the electrical Specifications for additional requirements.
1. Cables and Conductors
  2. Raceways and Boxes
  3. Engine-Generator Set

#### 1.11 SUBSTITUTIONS

- A. The Contract Documents list manufacturers' names and catalog numbers followed by the phrase "or equal" are to establish a standard of quality and utility for the specified items and to provide a dimensional reference to the scaled drawings.
- B. Submittals for "equal" items shall include the following data, which is not necessarily required for specified items, which list the manufacturer and catalog number:
1. Performance characteristics.
  2. Materials.
  3. Finish.
  4. Certification of conformance with specified codes and standards.
  5. Manufacturer's specifications and other data needed to prove compliance with specified requirements. Term "compliance" is understood to mean that the submitted equipment will meet or exceed the Contract Document requirements.
    - a. Items that do not clearly meet this definition shall be identified and explained as required in following Paragraph.
      - 1) Identify all differences between the specified item and proposed item.
      - 2) Explain all differences with sufficient detail to permit the Engineer to easily determine that the substituted item complies with the functional intent.
      - 3) List disadvantages and advantages of proposed item versus specified item.
      - 4) Submit technical data sheets and/or pictures and diagrams to support and clarify.
      - 5) Organize in clear and concise format. Engineer shall approve substitutions in writing.
      - 6) Engineer's decision shall be final unless owner approves.

- C. Submittals of "equal" components or systems may be rejected if:
    - 1. Material or equipment would necessitate alteration of mechanical, electrical, architectural, or structural design.
    - 2. Dimensions vary from specified material or equipment so that accessibility or clearances are impaired or Work of other trades is adversely affected.
  - D. Proposed substitutions for materials or equipment must be submitted 10 days prior to final bid date for consideration as approved equals. Otherwise, substitutions will not be permitted. Only the prime bidders shall be permitted make proposals for substitutions.
  - E. No substitution shall be made unless authorized in writing by the Engineer. Should substitution be accepted and should substitute material prove defective or otherwise unsatisfactory for service intended, and within guarantee period, replace this material or equipment with material or equipment specified, to satisfaction of Engineer and at no cost to Owner.
- 1.12 COORDINATION DRAWINGS
- A. Submit project specific coordination drawings for review in compliance with Division 1 Specification Sections.
- 1.13 OPERATION AND MAINTENANCE INSTRUCTIONAL MANUALS
- A. Submit 3 digital copies.
  - B. Submit project specific Operation and Maintenance Instructional Manuals for review in compliance with Division 1 Specification Sections.
    - 1. Maintenance and operating instructional manuals shall be provided when construction is approximately 75% complete.
    - 2. Maintenance and operating instructional manuals shall be job specific to this project. Generic manuals are not acceptable.
    - 3. Provide complete operation and maintenance instructional manuals covering all electrical equipment herein specified, together with parts lists.
    - 4. The operating and maintenance instructions shall include a brief, general description for all mechanical systems including, but not limited to:
      - a. Routine maintenance procedures.
      - b. Lubrication chart listing all types of lubricants to be used for each piece of equipment and the recommended frequency of lubrication.
      - c. Trouble-shooting procedures.
      - d. Contractor's telephone numbers for warranty repair service.
      - e. Submittals.
      - f. Recommended spare parts lists.
      - g. Names and telephone numbers of major material suppliers and subcontractors.
      - h. System schematic drawings on 8-1/2" x 11" sheets.
    - 5. Four (4) copies of all literature shall be furnished for Owner and shall be bound in ring binder form.
    - 6. White bond, at least 20 pound weight
    - 7. 11 inches in height preferable; bind in with text; foldout acceptable; larger drawings acceptable but fold to fit within Manual and provide drawing pocket inside rear cover or bind in with text.

C. Required Layout

<b>O&amp;M Manual Requirements</b> <i>MEP &amp; Fire Suppression</i>	
•	Title Page <ul style="list-style-type: none"><li>○ Job Name</li><li>○ Site Address</li><li>○ Include Contact information of prime contractor.</li></ul>
•	Table of contents
•	Warranty Information. <ul style="list-style-type: none"><li>○ Include all contractor warranties<ul style="list-style-type: none"><li>▪ Signed and dated documents</li></ul></li></ul>
•	Permits-Inspections
•	Subcontractor list <ul style="list-style-type: none"><li>○ Include all subcontractors.<ul style="list-style-type: none"><li>▪ Company name, Contact info.</li><li>▪ Trade Responsibility.</li></ul></li></ul>
•	Vendor list <ul style="list-style-type: none"><li>○ Include name and addresses of vendors<ul style="list-style-type: none"><li>▪ Warranty information</li><li>▪ Replaceable parts</li></ul></li></ul>
•	Approved submittals <ul style="list-style-type: none"><li>○ Include all approved product submittals</li></ul>
•	Reports/Certificates/Redlines <ul style="list-style-type: none"><li>○ Engineers Observation Reports</li><li>○ Electrical tests.</li><li>○ Grounding test Report</li><li>○ Generator testing</li><li>○ Overcurrent Protection Study</li><li>○ Sequence of operations report</li><li>○ Surge Protection Commissioning Report</li><li>○ Contractor Start-up Report</li><li>○ Manufacturer Start-up Report</li><li>○ Owners Training Report. (All Trades)</li></ul>
•	O&M Manuals
•	Equipment Information. <ul style="list-style-type: none"><li>○ Include Model, Serial and location.</li></ul>
•	Signed Approval <ul style="list-style-type: none"><li>○ Page for approval signature of the engineer and approval date.</li></ul>

1.14 RECORD DRAWINGS

- A. Submit record drawings in compliance with Division 1.
- B. Contractor shall submit to the Architect/Engineer, record drawings on electronic media or mylar which have been neatly marked to represent as-built conditions for all new electrical work.
- C. The Contractor shall keep accurate note of all deviations from the construction documents and discrepancies in the underground concealed conditions and other items of construction on field drawings as they occur. The marked up field documents shall be available for review by the Architect, Engineer and Owner at their request.
- D. Final Project Record Documents
  - 1. The purpose of the final Project Record Documents is to provide factual information regarding all aspects of the Work, both concealed and visible, to enable future modification of the Work to proceed without lengthy and expensive site measurement, investigation, and examination.

2. Provide CADD electronic files in dwg Format using AutoCAD Release 2002 or later software. Upon written request, completion of a release form, and payment of the Engineer's standard fee of \$200 plus applicable sales tax for a set-up charge and \$50 per drawing plus applicable sales tax for copies of such files, Engineer will provide AutoCAD Release 2002 electronic files of base Contract Drawings in dwg format on compact discs. Engineer will also provide a list of drawing layers and names that shall be maintained.
3. Provide completed record drawings on a CD reproducible of each drawing.

1.15 INSTRUCTION OF OWNER PERSONNEL

- A. Before final inspection, instruct Owner's designated personnel in operation, adjustment, and maintenance of electrical equipment and systems at agreed upon times.
  1. A minimum of 8 hours of formal instruction to Owner's personnel shall be provided for each building. Additional hours are specified in individual specification sections. Demonstration shall include, but is not limited to:
    - a. Maintenance of all electrical equipment.
    - b. Locations of equipment.
    - c. Locations of in-ground junction boxes.
    - d. Underground conduit.
    - e. Any specialized/unique equipment.
- B. Use operation and maintenance manuals as basis for instruction. Review contents of manual with personnel in detail to explain all aspects of operation and maintenance.
- C. In addition to individual equipment training provide an overview of each electrical system. Utilize the as-built documents for this overview.
- D. Prepare and insert additional data in operation and maintenance manual when need for such data becomes apparent during instruction, or as requested by Owner.

1.16 WARRANTY

- A. Warranty:
  1. Comply with the requirements in Division 1 Specification Sections.
  2. Contractor shall warranty that the electrical installation is free from defects and agrees to replace or repair, to the Owner's satisfaction, any part of this electrical installation which becomes defective within a period of one year (unless specified otherwise in other Division 26 sections) from the date of substantial completion following final acceptance, provided that such failure is due to defects in the equipment, material, workmanship or failure to follow the contract documents.
- B. Contractor shall be responsible for any and all temporary services including equipment and installation required to maintain operation as a result of any equipment failure or defect during warranty period.
- C. File with the Owner any and all warranties from the equipment manufacturers including the operating conditions and performance capacities they are based on.

1.17 USE OF EQUIPMENT

- A. The use of any equipment, or any part thereof for purposes other than testing even with the Owner's consent, shall not be construed to be an acceptance of the work on the part of the Owner, nor be construed to obligate the Owner in any way to accept improper work or defective materials.
- B. Do not use Owner's lamps for temporary lighting except as allowed and directed by the Owner. Equip lighting fixtures with new lamps when the project is turned over to the Owner.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 COMMON REQUIREMENTS FOR ELECTRICAL INSTALLATION

- A. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electrical equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- B. Right of Way: Give to raceways and piping systems installed at a required slope.
- C. All work shall be run parallel or perpendicular to the lines of the building unless noted on the Drawings.

3.2 DEMOLITION WORK

- A. All demolition of existing electrical equipment and materials will be done by this Contractor unless otherwise indicated. Include all items such as, but not limited to, electrical equipment, devices, and associated conduit and wiring called out on the Drawings and as necessary whether such items are actually indicated on the Drawings or not in order to accomplish the installation of the specified new work.
- B. In general, demolition work is indicated on the Drawings. However, the Contractor shall visit the job site to determine the full extent and character of this work.
- C. Unless specifically noted to the contrary, removed materials shall not be reused in the work. Salvaged materials that are to be reused shall be stored safe against damage and turned over to the appropriate trade for reuse. Salvaged materials of value that are not to be reused shall remain the property of the Owner unless such ownership is waived. Items on which the Owner waives ownership shall become the property of the Contractor, who shall remove and legally dispose of same, away from the premises.
- D. Appropriately reroute lighting, power and technology wiring as required to maintain service to equipment and devices to remain.

3.3 INSTALLATION OF EQUIPMENT

- A. Install all equipment in strict accordance with all directions and recommendations furnished by the manufacturer. Where such directions are in conflict with the Drawings and Specifications, report such conflicts to the Architect/Engineer for resolution.
- B. Prior to rough in, allow for flexibility, ten feet in any direction, in the final location of electrical system and wiring devices without additional cost to the Owner.

3.4 WORK IN EXISTING BUILDINGS

- A. The Owner will provide access to existing buildings as required. Access requirements to occupied buildings shall be identified on the project schedule. The Contractor, once Work is started in the existing building, shall complete same without interruption so as to return work areas as soon as possible to Owner.
- B. Adequately protect and preserve all existing and newly installed Work. Promptly repair any damage at Contractor's expense.
- C. Consult with the Owner's Representative as to the methods of carrying on the Work so as not to interfere with the Owner's operation any more than absolutely necessary. Accordingly, all service lines shall be kept in operation as long as possible, and the services shall only be interrupted at such time as will be designated by the Owner's Representative.

- D. Prior to starting work in any area, obtain approval for doing so from a qualified representative of the Owner who is designated and authorized by the Owner to perform testing and abatement of all hazardous materials including but not limited to, asbestos. The Contractor shall not perform any inspection, testing, containment, removal or other work that is related in any way whatsoever to hazardous materials under the Contract. Provide a temporary diesel generator of sufficient load capacity to fully supply the required emergency power to the building during the construction period of the project.
- E. CUTTING, PATCHING AND DAMAGE TO OTHER WORK
- F. Refer to General Conditions for requirements.
- G. All cutting, patching and repair work shall be performed by the Contractor through approved, qualified subcontractors. Contractor shall include full cost of same in bid.
- H. Request for Engineer's consent:
1. Prior to cutting which affects structural safety, submit a written request to Engineer for permission to proceed with cutting.
  2. When conditions of Work or schedule require a change of materials or methods for cutting and patching, notify Engineer and secure written permission to proceed with the work.
- 3.5 EQUIPMENT CONNECTIONS
- A. As included in the work, make connections to equipment, and other items included in the work in accordance with the approved shop Drawings and rough-in measurements furnished by the manufacturers of the particular equipment furnished. All additional connections not shown on the Drawings but called out by the equipment manufacturer's shop Drawings shall be provided.
- 3.6 CLEANING
- A. All debris shall be removed daily as required to maintain the work area in a neat, orderly condition.
- 3.7 PROTECTION AND HANDLING OF EQUIPMENT AND MATERIALS
- A. Equipment and materials shall be protected from theft, injury or damage.
- B. Protect conduit openings with temporary plugs or caps.
- C. Provide adequate storage for all equipment and materials delivered to the job site. Location of the space will be designated by the Owner's representative or Architect/Engineer. Equipment set in place in unprotected areas must be provided with temporary protection.
- 3.8 EXTRA WORK
- A. For any extra electrical work which may be proposed, this Contractor shall furnish to the Construction Manager, an itemized breakdown of the estimated cost of the materials and labor required to complete this work.
- B. Proceed only after receiving a written order from the Construction Manager establishing the agreed price and describing the work to be done.
- 3.9 DRAWINGS AND MEASUREMENTS
- A. These Specifications and accompanying Drawings are intended to describe and provide for finished work. They are intended to be cooperative, and what is called for by either shall be as binding as if called for by both. The Contractor understands that the work herein described shall be complete in every detail.
- B. The Drawings are not intended to be scaled for rough-in measurements or to serve as Shop Drawings.
- C. Field measurements necessary for ordering materials and fitting the installation to the building construction and arrangement are the Contractor's responsibility.

**END OF SECTION**

**SECTION 26 05 01 – ELECTRICAL DEMOLITION**

**PART 1 - GENERAL**

**1.1 RELATED DOCUMENTS**

- A. The Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to the Work in this Section.

**1.2 SUMMARY**

- A. Provided all equipment, materials, labor supervision, and services necessary for or incidental to the demolition of electrical equipment and materials as indicated on the drawings, and as specified.
- B. Work included:
  - 1. Removal of a generator, , conduit and wire and other electrical equipment and materials where indicated.

**1.3 STANDARDS**

- A. All work shall comply with the Toxic Substances Control Act (TSCA) 1976.

**1.4 SUBMITTALS AND SHOP DRAWINGS**

- A. Submit qualifications of the disposal company.

**1.5 QUALITY ASSURANCE**

- A. Use adequate numbers of skilled workers who are thoroughly trained and experienced in the necessary crafts and who are completely familiar with the specified requirements and the methods needed for proper performance of the work of this Section.
- B. Without additional cost to the Owner, provide such other labor and materials as are required to complete the work of this Section in accordance with the requirements of governmental agencies having jurisdiction, regardless of whether such materials and associated labor are called for elsewhere in these Contract Documents.

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION**

**3.1 DISCONNECTION OF THE SOURCES OF POWER**

- A. Prior to the demolition of work by any trade, provide a qualified electrician to disconnect all sources of power serving equipment, within the area of demolition. Verify by testing that power has been disconnected. The electrician shall remain on the site during demolition, to disconnect and test electrical work that becomes accessible during the course of demolition.

**3.2 SALVAGE AND DISPOSAL**

- A. Tour the project site with the Owner's representative to identify and mark those items, scheduled for demolition, which the Owner wishes to retain. Verify whether the owner wishes to retain or have the contractor dispose of the old generator, Deliver those items so marked, to the Owner's storage, within the project site, as directed.
- B. All remaining demolition items shall become the Contractor's property and shall be removed from the site. Hazardous materials shall be disposed of in accordance with federal regulations.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 260502 – ELECTRICAL WORK IN EXISTING FACILITIES**

**PART 1 - GENERAL**

**1.1 RELATED DOCUMENTS**

- A. The Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to the Work in this Section.

**1.2 SUMMARY**

- A. Provide labor, materials, equipment, transportation, tools and services, and perform operations required for, and reasonably incidental to the providing or modification of electrical work and systems in existing facilities.

**1.3 SHOP DRAWINGS**

- A. Show the joining of new work with existing, illustrating the actual existing conditions in accordance with Division 01.

**1.4 QUALITY ASSURANCE**

- A. Use adequate numbers of skilled workmen who are thoroughly trained and experienced in the necessary crafts and who are completely familiar with the specified requirements and the methods needed for proper performance of the work of this Section.
- B. Without additional cost to the Owner, provide such other labor and materials as are required to complete the work of this Section in accordance with the requirements of governmental agencies having jurisdiction, regardless of whether such materials and associated labor are called for elsewhere in these Contract Documents.

**PART 2 - PRODUCTS**

**2.1 WIRING METHODS AND MATERIALS**

- A. Where new conduits, wires, cables, outlets, wiring devices, , etc. are installed, they shall be of the type and quality specified, regardless of the types and quality of existing materials that are to remain.

**PART 3 - EXECUTION**

**3.1 SITE INSPECTION**

- A. The Contract Documents do not propose to show all existing systems material or equipment. Obtain information related to existing facilities from existing documents, measurements, notations, photographs, surveys and other observations at the site.
- B. Visit the project site and verify the existing materials, conditions, wiring methods, penetrations through fire rated walls, supporting devices and panelboards. Inspect panelboard interiors, etc. Note any existing conditions which require work to bring the project into code compliance for the occupancy under construction.
- C. Modify, repair and replace materials relating to any existing conditions whether shown on the drawings, noted during the site visit or discovered during the course of construction, which require work to bring the project into code compliance for the occupancy under construction.

**3.2 SCHEDULE OF WORK**

- A. Since the building will continue in use throughout the construction period, carry out the work under this Division in such a manner as to minimize disturbance to the occupants.

- B. The schedule contemplates working in designated areas in the existing building while other adjacent areas are still being occupied. Carry out work in this Division in such a manner as to minimize disturbance to those occupied areas.
  - C. Should the work in the designated areas affect any services to the areas to remain in use, new permanent or temporary services or a combination of both shall be installed as required to enable those occupied areas to function properly.
  - D. Perform no work in the existing building which would interfere with its use during normal hours of occupancy, unless special permission is granted by the Owner. Included shall be operations which would cause objectionable noise or service interruptions.
  - E. Any work involving a service suspension shall be scheduled in advance with the Owner
  - F. Should it be necessary to perform certain operations on an "overtime" basis in order not to interrupt the normal usage of the building, include the costs of such overtime without change in the Contract amount.
- 3.3 TEMPORARY WORKING ACCESS
- A. Remove existing wire, conduit, equipment, fixtures, and other items as required to provide access for work in existing facilities.
  - B. Reinstall and refinish items removed, or otherwise damaged, to match existing adjacent conditions upon completion of the work.
- 3.4 DISRUPTION OF EXISTING FUNCTIONS
- A. Access: Access to and use of the existing facilities and site will be restricted and shall be under the direction and control of the Owner.
  - B. Provide a temporary diesel generator of sufficient load capacity to fully supply the required emergency power to the building during the construction period of the project.
  - C. Outages: Schedule power outages to avoid interference with the Owner's or other tenant's activities. Obtain approval prior to the requested outage as specified in Division 1. Provide a schedule showing sequence and duration of all activities during the requested outage.
  - D. Disruptions: Maintain existing electrical, communications, alarm, and other existing systems, and maintain existing functions in service except for scheduled disruptions as specified in Division 1. Where existing functions to remain in use are disrupted, they shall be fully restored after disruption, in full compliance with this Division of the Specifications.
  - E. Duration: Complete as large a portion of the work as possible before initiating disruption and perform only that work necessary so as to minimize duration of disruption. Maintain adequate personnel, supplies, materials, equipment, tools, and other resources at job site to avoid unnecessary delay in resumption of normal service.
  - F. Schedule: Provide a complete schedule to the Owner for review and approval indicating the type and duration of any required disruption involved in the execution of the work.
- 3.5 SALVAGE, DEMOLITION AND RELOCATION
- A. General
    1. Modify, remove, or relocate materials, equipment and devices as indicated or required by the installation of new facilities.
    2. Working jointly with the Owner's Representative, establish and mark salvage and demolition items before commencing work; report items scheduled for relocation, reinstallation or reuse, which are found to be in damaged condition; await further instructions from the Owner before commencing with work.
    3. Demolition material shall be removed from the site and disposed of by the Contractor. Salvaged equipment and devices shall be the property of the Owner unless noted otherwise. Store or dispose of as directed by Owner.

**END OF SECTION**

**SECTION 26 05 03 – FIRE STOPPING**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. The Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to the Work in this Section.

1.2 SUMMARY

- A. Only tested firestop systems shall be used in specific locations as follows:
  - 1. Penetrations for the passage of conduit and other electrical equipment through fire-rated vertical barriers (walls and partitions), horizontal barriers (floor/ceiling assemblies), and vertical service shaft walls and partitions.
  - 2. Completion of firestop installations to maintain the rating integrity of the barrier penetrated.
  - 3. SUBMITTALS: Provide submittals as required in section 26 00 10, "Submittal Process."

1.3 DEFINITIONS

- A. Firestopping: Material or combination of materials used to retain integrity of fire-rated construction by maintaining an effective barrier against the spread of flame, smoke, water and hot gases through penetrations in fire rated wall and floor assemblies.

1.4 REFERENCES

- A. Test Requirements: ASTM E-814, "Standard Method of Fire Tests of Through Penetration Fire Stops" (July 1997).
- B. Underwriters Laboratories (UL) of Northbrook, IL runs ASTM E-814 under their designation of UL 1479 and publishes the results in their "FIRE RESISTANCE DIRECTORY" that is updated annually.
  - 1. UL Fire Resistance Directory:
    - a. Through-Penetration Firestop Devices (XHCR)
    - b. Fire Resistance Ratings (BXUV)
    - c. Through-Penetration Firestop Systems (XHEZ)
    - d. Fill, Voids, or Cavity Material (XHHW)
    - e. Forming Materials (XHKU)
- C. Inspection Requirements: ASTM E 2174-01 "Standard Practice for On-Site Inspection of Installed Fire Stops".
- D. International Firestop Council Guidelines for Evaluating Firestop Systems Engineering Judgments.
- E. ASTM E-84, Standard Test Method for Surface Burning Characteristics of Building Materials.
- F. NFPA 101 - Life Safety Code
- G. NFPA 70 – National Electric Code.

1.5 QUALITY ASSURANCE

- A. A manufacturer's direct representative (not distributor or agent) to be on-site during initial installation of firestop systems to train appropriate contractor personnel in proper selection and installation procedures. This will be done per manufacturer's written recommendations published in their literature and drawing details.
- B. Firestop System installation must meet requirements of ASTM E-814 or UL 1479 tested assemblies that provide a fire rating equal to that of construction being penetrated.
- C. Proposed firestop materials and methods shall conform to applicable governing codes having local jurisdiction.

- D. Firestop Systems do not reestablish the structural integrity of load bearing partitions/assemblies or support live loads and traffic. Installer shall consult the structural engineer prior to penetrating any load bearing assembly.
- E. For those firestop applications that exist for which no UL tested system is available through a manufacturer, a manufacturer's engineering judgment derived from similar UL system designs or other tests will be submitted to local authorities having jurisdiction for their review and approval prior to installation. Engineer judgment drawings must follow requirements set forth by the International Firestop Council (September 7, 1994 as may be amended from time to time).

1.6 SUBMITTALS

- A. Submit Product Data: Manufacturer's specifications and technical data for each material including the composition and limitations, documentation of UL firestop systems to be used and manufacturer's installation instructions to comply with Section 26 00 10.
- B. Manufacturer's engineering judgment identification number and drawing details when no UL system is available for an application. Engineer judgment must include both project name and contractor's name that will install firestop system as described in drawing.
- C. Submit material safety data sheets provided with product delivered to job-site.

1.7 INSTALLER QUALIFICATIONS

- A. Engage an experienced Installer who is certified, licensed, or otherwise qualified by the firestopping manufacturer as having the necessary experience, staff, and training to install manufacturer's products per specified requirements. A manufacturer's willingness to sell its firestopping products to the Contractor or to an Installer engaged by the Contractor does not in itself confer qualification on the buyer.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials undamaged in manufacturer's clearly labeled, unopened containers, identified with brand, type, and UL label where applicable.
- B. Coordinate delivery of materials with scheduled installation date to allow minimum storage time at job-site.
- C. Store materials under cover and protect from weather and damage in compliance with manufacturer's requirements.
- D. Comply with recommended procedures, precautions or remedies described in material safety data sheets as applicable.
- E. Do not use damaged or expired materials.

1.9 PROJECT CONDITIONS

- A. Do not use materials that contain flammable solvents.
- B. Scheduling
  - 1. Schedule installation of CAST IN PLACE firestop devices after completion of floor formwork, metal form deck, or composite deck but before placement of concrete.
  - 2. Schedule installation of other firestopping materials after completion of penetrating item installation but prior to covering or concealing of openings.
- C. Verify existing conditions and substrates before starting work. Correct unsatisfactory conditions before proceeding.
- D. Weather conditions: Do not proceed with installation of firestop materials when temperatures exceed the manufacturer's recommended limitations for installation printed on product label and product data sheet.
- E. During installation, provide masking and drop cloths to prevent firestopping materials from contaminating any adjacent surfaces.

PART 2 - PRODUCTS

2.1 FIRESTOPPING, GENERAL

- A. Provide firestopping composed of components that are compatible with each other, the substrates forming openings, and the items, if any, penetrating the firestopping under conditions of service and application, as demonstrated by the firestopping manufacturer based on testing and field experience.
- B. Provide components for each firestopping system that are needed to install fill material. Use only components specified by the firestopping manufacturer and approved by the qualified testing agency for the designated fire-resistance-rated systems.
- C. Firestopping materials are either "cast-in-place" (integral with concrete placement) or "post installed". Provide cast-in-place Firestop devices prior to concrete placement.

2.2 ACCEPTABLE MANUFACTURERS

- A. Subject to compliance with through penetration firestop systems (XHEZ) listed in Volume II of the UL Fire Resistance Directory, provide products of the following manufacturers as identified below:
  - 1. Hilti, Inc., Tulsa, Oklahoma (800) 879-8000
  - 2. Tremco Sealants & Coatings, Beechwood, Ohio (216) 292-5000
  - 3. 3M Fire Protection Products, St. Paul, Minnesota (612) 736-0203
  - 4. Johns-Manville Firetemp
  - 5. Other manufacturers listed in the U.L. Fire Resistance Directory – Volume 2

2.3 MATERIALS

- A. Use only firestop products that have been UL 1479, ASTM E-814 tested for specific fire-rated construction conditions conforming to construction assembly type, penetrating item type, annular space requirements, and fire-rating involved for each separate instance.
- B. Sealants or caulking materials for use with non-combustible items including steel pipe, copper pipe, rigid steel conduit and electrical metallic tubing (EMT), the following products are acceptable:
  - 1. Hilti FS-ONE Intumescent Firestop Sealant
  - 2. Hilti CP 604 Self-leveling Firestop Sealant
  - 3. Hilti CP 620 Fire Foam
  - 4. 3M Fire Stop Sealant 2000
  - 5. 3M Fire Barrier CP25 WB
  - 6. Tremco Tremstop Fyre-Sil Sealant
  - 7. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- C. Sealants or caulking materials for use with sheet metal ducts, the following products are acceptable:
  - 1. Hilti CP 601s Elastomeric Firestop Sealant
  - 2. Hilti CP 606 Flexible Firestop Sealant
  - 3. Hilti FS-ONE Intumescent Firestop Sealant
  - 4. Hilti CP 604 Self-leveling Firestop Sealant
  - 5. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- D. Intumescent sealants or caulking materials for use with combustible items (penetrants consumed by high heat and flame) including insulated metal pipe, PVC jacketed, flexible cable or cable bundles and plastic pipe, the following products are acceptable:
  - 1. Hilti FS-ONE Intumescent Firestop Sealant
  - 2. 3M Fire Barrier CP25 WB
  - 3. Tremco Tremstop WBM Intumescent Firestop Sealant
  - 4. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- E. Intumescent sealants, caulking or putty materials for use with flexible cable or cable bundles, the following products are acceptable:
  - 1. Hilti FS-ONE Intumescent Firestop Sealant
  - 2. Hilti CP 620 Fire Foam

3. Hilti CP 618 Firestop Putty Stick
4. 3M Fire Barrier CP25 WB
5. Tremco Tremstop WBM Intumescent Firestop Sealant
6. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- F. Non curing, re-penetrable intumescent sealants, caulking or putty materials for use with flexible cable or cable bundles, the following products are acceptable:
  1. Hilti CP 618 Firestop Putty Stick
  2. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- G. Wall opening protective materials for use with U.L. listed metallic and specified nonmetallic outlet boxes, the following products are acceptable:
  1. Hilti CP 617 Firestop Putty Pad
  2. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- H. Firestop collar or wrap devices attached to assembly around combustible plastic conduit, the following products are acceptable:
  1. Hilti CP 642 Firestop Collar
  2. Hilti CP 643 Firestop Collar
  3. 3M Fire Barrier PPD Plastic Pipe Device
  4. Hilti CP 645 Wrap Strip
  5. Equivalent products listed in the U.L. Fire Resistance Directory – Volume 2
- I. which is equal to the time rating of construction being penetrated.

### PART 3 - EXECUTION

#### 3.1 PREPARATION

- A. Verification of Conditions: Examine areas and conditions under which work is to be performed and identify conditions detrimental to proper or timely completion.
  1. Verify penetrations are properly sized and in suitable condition for application of materials.
  2. Surfaces to which firestop materials will be applied shall be free of dirt, grease, oil, rust, laitance, release agents, water repellents, and any other substances that may affect proper adhesion.
  3. Provide masking and temporary covering to prevent soiling of adjacent surfaces by firestopping materials.
  4. Comply with manufacturer's recommendations for temperature and humidity conditions before, during and after installation of firestopping.
  5. Do not proceed until unsatisfactory conditions have been corrected.

#### 3.2 COORDINATION

- A. Coordinate location and proper selection of cast-in-place Firestop Devices with trade responsible for the work. Ensure device is installed before placement of concrete.
- B. Responsible trade to provide adequate spacing of field run pipes to allow for installation of cast-in-place firestop devices without interferences.

#### 3.3 INSTALLATION

- A. Regulatory Requirements: Install firestop materials in accordance with UL Fire Resistance Directory.
- B. Manufacturer's Instructions: Comply with manufacturer's instructions for installation of through-penetration and construction joint materials.
  1. Seal all holes or voids made by penetrations to ensure an air and water resistant seal.
  2. Protect materials from damage on surfaces subjected to traffic.

3.4 FIELD QUALITY CONTROL

- A. Examine sealed penetration areas to ensure proper installation before concealing or enclosing areas.
- B. Keep areas of work accessible until inspection by applicable code authorities.
- C. Inspection of through-penetration firestopping shall be performed in accordance with ASTM E 2174, "Standard Practice for On-Site Inspection of Installed Fire Stops" or other recognized standard.
- D. Perform under this section patching and repairing of firestopping caused by cutting or penetrating of existing firestop systems already installed by other trades.

3.5 ADJUSTING AND CLEANING

- A. Remove equipment, materials and debris, leaving the area undamaged, clean condition.
- B. Clean all surfaces adjacent to sealed holes and joints to be free of excess firestop materials and soiling as work progresses.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 05 19 – LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Building wires and cables rated 600 V and less.
  - 2. Connectors, splices, and terminations rated 600 V and less.
- B. Related Requirements:
  - 1. Division 26 Section "Identification for Electrical Systems" for building wire and cable colors and identification.

1.3 DEFINITIONS

- A. VFC: Variable-frequency controller.

1.4 SUBMITTALS

- A. Product Data: For each type of product provide submittals as required in section 26 00 10, "Submittal Process."
- B. Qualification Data: For testing agency.
- C. Field quality-control reports.

1.5 QUALITY ASSURANCE

- A. Testing Agency Qualifications: An independent agency, with the experience and capability to conduct the testing indicated, that is a member company of the InterNational Electrical Testing Association or is a nationally recognized testing laboratory (NRTL) as defined by OSHA in 29 CFR 1910.7, and that is acceptable to authorities having jurisdiction.
  - 1. Testing Agency's Field Supervisor: Person currently certified by the InterNational Electrical Testing Association or the National Institute for Certification in Engineering Technologies to supervise on-site testing specified in Part 3.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

*\*\*\* Note: All wire sizes indicated on the contract documents are sized for copper. If the contractor substitutes aluminum for copper, it is their responsibility to appropriately size the wiring for the use of aluminum.*

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
  - 1. American insulated Wire Corp.: a Leviton Company.
  - 2. Senator Wire & Cable Company.
  - 3. Southwire Company.
  - 4. General Cable Corporation.
  - 5. Stabiloy of Alcan Cable.

- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- C. Conductors: Aluminum and copper, complying with NEMA WC 70/ICEA S-95-658.
  - 1. All branch circuits are to be copper wire.
- D. Conductor Insulation: Comply with NEMA WC 70/ICEA S-95-658 for Type THHN/THWN-2 Type XHHW-2 and Type USE.
- E. Pull Cords: Minimum 1/8" nylon.
- F. Pulling Compound: Ideal "Yellow 77".
- G. Fire-resistive Cable: Comply with NEMA WC 70. Cable shall be UL labeled as 2-hour fire-rated, type MI mineral-insulated with nickel-clad copper conductor, magnesium oxide insulation, copper alloy sheath, and rated 600 volts. Provide factory installed terminations or field termination kits from the same manufacturer as the cable.
  - 1. Pentair Pyrotenax
  - 2. In lieu of the mineral-insulated cable above, a 2-hour fire rated metal clad cable may be substituted. Provide RSCC & Cable VITALink.
- H. Aluminum Conductor
  - 1. Use of aluminum conductors Type XHHW-2 is permitted for feeder (NEC definitions) circuits in sizes 1/0 AWG and larger. All branch circuits shall be copper conductor. Aluminum alloy conductors shall be compact strand AA-8000 Series electrical grade conductor such as STABILOY® of Alcan Cable.
  - 2. Connectors and terminations installed with aluminum alloy conductors shall be only those listed by Underwriter's Laboratories, Inc. standard 486-B, and marked "AL7CU" for 75° C or "AL9CU" for 90° C. Connectors and terminations shall be sized to accept aluminum conductors of the ampacity specified. Connections and terminations shall be installed according to the manufacturer's recommendations.
  - 3. Sizing of conductors and conduits shall be based on schedule on Drawings.
  - 4. Tighten Electrical connectors and terminals, including screws and bolts, in accordance with manufacturer's published torque values or with tightening torques specified in UL Standard 486B.
  - 5. Only U.S manufactured Aluminum Wire & Cable with XHHW-2 Insulation are approved.
- I. Use the following color code system:

	240/120 Volt Systems	208Y/120 Volt Systems	480Y/277 Volt Systems
Phase A	Black	Black	Brown
Phase B	Orange	Red	Orange
Phase C	Blue	Blue	Yellow
Neutral	White	White	Gray
Ground	Green	Green	Green
Switch	Purple	Purple	Purple

2.2 CONNECTORS AND SPLICES

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
  - 1. AFC Cable Systems, Inc.
  - 2. Hubbell Power Systems, Inc.
  - 3. O-Z/Gedney; EGS Electrical Group LLC.
  - 4. 3M; Electrical Products Division.
  - 5. Tyco Electronics Corp.

6. Thomas & Betts.
- B. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated; listed and labeled as defined in NFPA 70 and marked for intended location and application.

2.3 PRODUCT DELIVERY, STORAGE, AND HANDLING

- A. Deliver wires and cables to the project in full cartons or reels marked with conductor size, insulation type, and Underwriters' Laboratories, Inc. label.
- B. Store wires and cables in a manner to prevent damage from the elements, personnel, equipment, and moisture.
- C. Handle wires and cables in a manner to prevent damage to conductor, insulation, and identifying

PART 3 - EXECUTION

3.1 INSPECTION

- A. Examine the system in which the wire is to be installed for defects in equipment and installation which may cause damage to the wire.
- B. Do not start work until defects have been corrected and until permission is obtained from the Construction Manager.

3.2 WIRING INSTALLATION IN RACEWAYS

- A. Pull all conductors into a raceway at the same time. Use UL listed wire-pulling lubricant for pulling 4 AWG and larger wires.
- B. Install wire in raceway after interior of building has been physically protected from the weather and all mechanical work likely to injure conductors has been completed.
- C. Completely and thoroughly swab raceway system before installing conductors.

3.3 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders: Copper for feeders smaller than No. 1/0 AWG; copper or aluminum for feeders No. 1/0 AWG and larger. Conductors shall be solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.
- B. Branch Circuits: Copper. Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.
- C. VFC Output Circuits Cable: Extra-flexible stranded for all sizes.
- D. Minimum Conductor Sizes:
1. Feeders and Branch Circuits: No. 12 AWG.
  2. Class 1 Control Circuits: No. 14 AWG.
  3. Class 2 Control Circuits: No. 16 AWG.
- E. Conductors shall be sized per "Feeder and Branch Circuit Sizing Schedule" on Drawings, unless noted otherwise.
- F. Unless indicated otherwise, power circuits shall be 2#12, 1#12G, 3/4"C.

3.4 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Service Entrance: Type THHN/THWN-2, single conductors in raceway.
- B. Emergency Feeder Circuits: Type THHN-THWN or Type XHHW, single conductors in raceway, installed below floor slab or installed in a minimum 1-hour fire rating, or mineral-insulated, metal-sheathed cable, Type MI.
- C. Exposed Feeders: Type THHN/THWN-2, single conductors in raceway.
- D. Feeders Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN/THWN-2 or Type XHHW-2, single conductors in raceway.
- E. Exposed Branch Circuits, Including in Crawlspace: Type THHN/THWN-2, single conductors in raceway.

- F. Branch Circuits Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THHN/THWN-2, single conductors in raceway.
- 3.5 INSTALLATION OF CONDUCTORS AND CABLES
- A. Complete raceway installation between conductor and cable termination points according to Section 260533 "Raceways and Boxes for Electrical Systems" prior to pulling conductors and cables.
  - B. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
  - C. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
  - D. Install exposed cables parallel and perpendicular to surfaces of exposed structural members and follow surface contours where possible.
  - E. Support cables according to Section 260529 "Hangers and Supports for Electrical Systems."
  - F. Identify and color-code conductors and cables according to Division 26 Section "Identification for Electrical Systems."
  - G. Do not install conductors supplied from different panelboards, distribution panels, or switchboards in same conduit or raceway, unless otherwise noted.
  - H. Circuits of multiple phases passing through enclosures shall have phases grouped to reduce the reactance effect.
- 3.6 CONNECTIONS
- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A-486B.
  - B. Make splices, terminations, and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than un-spliced conductors.
  - C. Wiring at Outlets: Install conductor at each outlet, with at least 6 inches (150 mm).
- 3.7 IDENTIFICATION
- A. Identify and color-code conductors and cables according to Section 260553 "Identification for Electrical Systems."
  - B. Identify each spare conductor at each end with identity number and location of other end of conductor and identify as spare conductor.
- 3.8 SLEEVE AND SLEEVE-SEAL INSTALLATION FOR ELECTRICAL PENETRATIONS
- A. Install sleeves and sleeve seals at penetrations of exterior floor and wall assemblies. Comply with requirements in Section 260544 "Sleeves and Sleeve Seals for Electrical Raceways and Cabling."
- 3.9 FIRESTOPPING
- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly according to Section 078413 "Penetration Firestopping."
- 3.10 FIELD QUALITY CONTROL
- A. Perform the following tests and inspections with the assistance of a factory-authorized service representative as required:
    - 1. Perform each of the following visual and electrical tests:
      - a. Inspect exposed sections of conductor and cable for physical damage and correct connection according to the one-line diagram.
      - b. Test bolted connections for high resistance using one of the following:
        - 1) A low-resistance ohmmeter.
        - 2) Calibrated torque wrench.
        - 3) Thermographic survey.

- c. Inspect compression applied connectors for correct cable match and indentation.
  - d. Inspect for correct identification.
  - e. Inspect cable jacket and condition.
  - f. Insulation-resistance test on each conductor with respect to ground and adjacent conductors. Apply a potential of 500-V dc for 300-V rated cable and 1000-V dc for 600-V rated cable for a one-minute duration.
  - g. Continuity test on each conductor and cable.
  - h. Uniform resistance of parallel conductors.
- 2. Initial Infrared Scanning: After Substantial Completion, but before Final Acceptance, perform an infrared scan of each splice in conductors No. 3 AWG and larger. Remove box and equipment covers so splices are accessible to portable scanner. Correct deficiencies determined during the scan.
  - a. Instrument: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.
  - b. Record of Infrared Scanning: Prepare a certified report that identifies switches checked and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.
- 3. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each switch 11 months after date of Substantial Completion.
- B. Cables will be considered defective if they do not pass tests and inspections.
- C. Prepare test and inspection reports to record the following:
  - 1. Procedures used.
  - 2. Results that comply with requirements.
  - 3. Results that do not comply with requirements and corrective action taken to achieve compliance with requirements.

3.11 VOLTAGE DROP

- A. Voltage drop within AC systems shall not exceed two percent for feeder conductors.
- B. Voltage drop within AC systems shall not exceed three percent for branch conductors. Refer to table below for maximum permitted branch conductor lengths at rated voltages:
- C. Total voltage drop within DC systems shall not exceed three percent (combined PV source circuits and PV output circuits)

Voltage Configuration	#12 AWG 20 amp OCP	#10 AWG 20 amp OCP	#10 AWG 30 amp OCP	#8 AWG 40 amp OCP	#6 AWG 50 amp OCP
120V, single phase	56 feet	93 feet	62 feet	72 feet	91 feet
208V, single phase	97 feet	162 feet	108 feet	124 feet	159 feet
240V, single phase	112 feet	187 feet	125 feet	144 feet	183 feet
277V, single phase	129 feet	216 feet	144 feet	166 feet	211 feet
480V, single phase	225 feet	374 feet	249 feet	288 feet	367 feet
208V, three phase	112 feet	187 feet	100 feet	115 feet	133 feet
240V, three phase	103 feet	173 feet	125 feet	144 feet	183 feet
480V, three phase	259 feet	433 feet	288 feet	333 feet	424 feet

Note: Table assumptions include copper conductors at 80% load capacity, 1.0 power factor, 75°C temperature rating, EMT conduit, and a three percent voltage drop.

**END OF SECTION**

**SECTION 26 05 26 – GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

**1.2 SUMMARY**

- A. Section includes grounding and bonding systems and equipment.

**1.3 SUBMITTALS**

- A. Product Data: For each type of product indicated.
- B. Provide submittals as required in section 26 00 10, "Submittal Process."
- C. As-Built Data: Plans showing dimensioned as-built locations of grounding features specified in "Field Quality Control" Article, including the following:
  - 1. Ground rods.
  - 2. Grounding arrangements and connections for separately derived systems.
- D. Field quality-control reports.

**1.4 QUALITY ASSURANCE**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with UL 467 for grounding and bonding materials and equipment.
- C. Grounding electrode resistance to earth testing.
- D. Grounding conductor continuity testing and conductor insulation testing.
- E. Use adequate numbers of skilled workmen who are thoroughly trained and experienced in the necessary crafts and who are completely familiar with the specified requirements and the methods needed for proper performance of the work of this Section.
- F. Without additional cost to the Owner, provide such other labor and materials as are required to complete the work of this Section in accordance with the requirements of governmental agencies having jurisdiction, regardless of whether such materials and associated labor are called for elsewhere in these Contract Documents.
- G. When requested, provide the Engineer with the manufacturer's certificate stating that materials meet or exceed minimum requirements as specified.

**1.5 REFERENCED STANDARDS**

- A. National Electrical Code, NFPA 70.
- B. EIA/TIA Standard 607
- C. IEEE - Standard 142 - Recommended Practice for Grounding of Industrial and Commercial Power Systems.
- D. IEEE – Standard 1100 – Recommended Practice for Powering and Grounding Electronic Equipment.
- E. IEEE Standard 81 - Guide for Measuring Earth Resistivity.

**PART 2 - PRODUCTS**

**2.1 SYSTEM DESCRIPTION**

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with UL 467 for grounding and bonding materials and equipment.

## 2.2 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Bare Copper Conductors:
  - 1. Solid Conductors: ASTM B 3.
  - 2. Stranded Conductors: ASTM B 8.
  - 3. Tinned Conductors: ASTM B 33.
  - 4. Bonding Cable: 28 kcmil, 14 strands of No. 17 AWG conductor, 1/4 inch (6 mm) in diameter.
  - 5. Bonding Conductor: No. 4 or No. 6 AWG, stranded conductor.
  - 6. Bonding Jumper: Copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches (41 mm) wide and 1/16 inch (1.6 mm) thick.
  - 7. Tinned Bonding Jumper: Tinned-copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches (41 mm) wide and 1/16 inch (1.6 mm) thick.

## 2.3 CONNECTORS

- A. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- B. All connections made below grade, in inaccessible locations, and all connections and splices in the grounding electrode conductor system shall be made by exothermic weld process equal to Cadweld. Provide polyethylene inspection well covers and lids equal to Erico #T416B, unless noted otherwise.
- C. All other connections shall be hydraulically crimped with irreversible connectors equal to Thomas and Betts 54000 Series.
- D. Connections to building structural steel shall be exothermic weld equal to Cadweld.
- E. Connections which require flexibility for movement, expansion, or vibration shall be made with flexible flat conductor, multiple strands of 30-gauge copper conductors or equivalent circular mil area to the primary ground conductor. Protect ends with copper bolt hole end pieces.

## 2.4 CONDUIT

- A. Provide malleable iron conduit grounding bushings where:
  - 1. Metallic raceways terminate at metal housings without mechanical and electrical connection to housing.
  - 2. At each end of metallic conductors for grounding conductors where conduits are electrically non-continuous.
  - 3. At the ends of service entrance conduit.

## 2.5 GROUNDING ELECTRODES

- A. Ground Rods: Copper-clad steel; 3/4 inch by 10 feet (19 mm by 3 m).

## PART 3 - EXECUTION

### 3.1 APPLICATIONS

- A. Conductors: Install solid conductor for No. 10 AWG and smaller, and stranded conductors for No. 8 AWG and larger unless otherwise indicated.
- B. Underground Grounding Conductors: Install bare tinned-copper conductor, No. 2/0 AWG minimum.
  - 1. Bury at least 24 inches (600 mm) below grade.
- C. Conductor Terminations and Connections:
  - 1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
  - 2. Underground Connections: Welded connectors except at test wells and as otherwise indicated.
  - 3. Connections to Ground Rods at Test Wells: Bolted connectors.
  - 4. Connections to Structural Steel: Welded connectors.

3.2 GROUNDING AT THE SERVICE

- A. Equipment grounding conductors and grounding electrode conductors shall be connected to the ground bus. Install a main bonding jumper between the neutral and ground buses.

3.3 GROUNDING SEPARATELY DERIVED SYSTEMS

- A. Generator: Install grounding electrode(s) at the generator location. The electrode shall be connected to the equipment grounding conductor and to the frame of the generator.

3.4 INSTALLATION

- A. Grounding Conductors: Route along the shortest and straightest paths possible unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
- B. Ground Rods: Drive rods until tops are 2 inches (50 mm) below finished floor or final grade unless otherwise indicated.
  - 1. Interconnect ground rods with grounding electrode conductor below grade and as otherwise indicated. Make connections without exposing steel or damaging coating if any.
  - 2. For the grounding electrode system, install at least three rods spaced at least one-rod length from each other and located at least the same distance from other grounding electrodes, and connect to the service grounding electrode conductor.
- C. Bonding Straps and Jumpers: Install in locations accessible for inspection and maintenance except where routed through short lengths of conduit.
  - 1. Bonding to Structure: Bond straps directly to basic structure, taking care not to penetrate any adjacent parts.
  - 2. Bonding to Equipment Mounted on Vibration Isolation Hangers and Supports: Install bonding so vibration is not transmitted to rigidly mounted equipment.
  - 3. Use exothermic-welded connectors for outdoor locations; if a disconnect-type connection is required, use a bolted clamp.

3.5 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
  - 1. After installing the grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
  - 2. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.
  - 3. Test completed grounding system at each location where a maximum ground-resistance level is specified, at service disconnect enclosure grounding terminal, at ground test wells, and at individual ground rods. Make tests at ground rods before any conductors are connected.
    - a. Measure ground resistance no fewer than two full days after last trace of precipitation and without soil being moistened by any means other than natural drainage or seepage and without chemical treatment or other artificial means of reducing natural ground resistance.
    - b. Perform tests by fall-of-potential method according to IEEE 81.
  - 4. Prepare dimensioned Drawings locating each test well, ground rod and ground-rod assembly, and other grounding electrodes. Identify each by letter in alphabetical order, and key to the record of tests and observations. Include the number of rods driven and their depth at each location and include observations of weather and other phenomena that may affect test results. Describe measures taken to improve test results.
- B. Grounding system will be considered defective if it does not pass tests and inspections.
- C. Excessive Ground Resistance: If resistance to ground exceeds specified values, notify Architect promptly and include recommendations to reduce ground resistance.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 05 29 – HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Hangers and supports for electrical equipment and systems.
  - 2. Construction requirements for concrete bases.

1.3 DEFINITIONS

- A. EMT: Electrical metallic tubing.
- B. IMC: Intermediate metal conduit.
- C. RMC: Rigid metal conduit.

1.4 PERFORMANCE REQUIREMENTS

- A. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.
- B. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

1.5 SUBMITTALS

- A. Product Data: For each type of product.
  - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for the following:
    - a. Hangers.
    - b. Steel slotted support systems.
    - c. Nonmetallic support systems.
  - 2. Include rated capacities and furnished specialties and accessories.
- B. Provide submittals as required in section 26 00 10, "Submittal Process."

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Engage a qualified professional engineer, as defined in Section 014000 "Quality Requirements," to design hanger and support system.
- B. Surface-Burning Characteristics: Comply with ASTM E 84; testing by a qualified testing agency. Identify products with appropriate markings of applicable testing agency.
  - 1. Flame Rating: Class 1.
  - 2. Self-extinguishing according to ASTM D 635.

2.2 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Comply with MFMA-4 factory-fabricated components for field assembly.
  - 1. Material: **Galvanized steel**.
  - 2. Channel Width: 1-5/8 inches (41.25 mm).
  - 3. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
  - 4. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.

5. Painted Coatings: Manufacturer's standard painted coating applied according to MFMA-4.
6. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
7. Channel Dimensions: Selected for applicable load criteria.
- B. Nonmetallic Slotted Support Systems: Structural-grade, factory-formed, glass-fiber-resin channels and angles with minimum 13/32-inch- (10-mm-) diameter holes at a maximum of 8 inches (200 mm) o.c., in at least one surface.
  1. Channel Width: 1-5/8 inches (41.25 mm).
  2. Fittings and Accessories: Products provided by channel and angle manufacturer and designed for use with those items.
  3. Fitting and Accessory Materials: Same as those for channels and angles, except metal items may be stainless steel.
  4. Rated Strength: Selected to suit applicable load criteria.
  5. Protect finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.
- C. Conduit and Cable Support Devices: Steel hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for nonarmored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be made of malleable iron.
- E. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M steel plates, shapes, and bars; black and galvanized.
- F. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
  1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened Portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
  2. Mechanical-Expansion Anchors: Insert-wedge-type, [**zinc-coated steel**] [**stainless steel**], for use in hardened portland cement concrete, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
  3. Concrete Inserts: Steel or malleable-iron, slotted support system units are similar to MSS Type 18 units and comply with MFMA-4 or MSS SP-58.
  4. Clamps for Attachment to Steel Structural Elements: MSS SP-58 units are suitable for attached structural element.
  5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
  6. Toggle Bolts: All-steel springhead type.
  7. Hanger Rods: Threaded steel.

## 2.3 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

- A. Description: Welded or bolted structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.
- B. Materials: Comply with requirements in Section 055000 "Metal Fabrications" for steel shapes and plates.

## PART 3 - EXECUTION

### 3.1 APPLICATION

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems unless requirements in this Section are stricter.

- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMTs, IMCs, and RMCs as scheduled in NECA 1, where its Table 1 lists maximum spacings that are less than those stated in NFPA 70. Minimum rod size shall be 1/4 inch (6 mm) in diameter.
  - C. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
    - 1. Secure raceways and cables to these supports with clamps approved for the application by an agency acceptable to the authorities having jurisdiction.
  - D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch (38-mm) and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.
  - E. Provide rooftop conduit supports for all photovoltaic system conduits located on the roof.
- 3.2 SUPPORT INSTALLATION
- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this article.
  - B. Raceway Support Methods: In addition to methods described in NECA 1, EMTs, IMCs, and RMCs may be supported by openings through structure members, according to NFPA 70.
  - C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb (90 kg).
- 3.3 INSTALLATION OF FABRICATED METAL SUPPORTS
- A. Comply with installation requirements in Section 055000 "Metal Fabrications" for site-fabricated metal supports.
  - B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.
  - C. Field Welding: Comply with AWS D1.1/D1.1M.
- 3.4 PAINTING
- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
    - 1. Apply paint by brush or spray to provide minimum dry film thickness of **2.0 mils (0.05 mm)**.
  - B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 05 33 – RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
  - 1. Metal conduits, tubing, and fittings.
  - 2. Boxes, enclosures, and cabinets.
- B. Related Requirements:

1.3 DEFINITIONS

- A. EMT: Electrical metallic tubing.
- B. FMC: Flexible metal conduit.
- C. RNC: Rigid nonmetallic conduit.
- D. IMC: Intermediate metal conduit.

1.4 SUBMITTALS

- A. Provide submittals as required in section 26 00 10, "Submittal Process."
- B. Shop Drawings: For custom enclosures and cabinets. Include plans, elevations, sections, and attachment details.
- C. Qualification Data: For professional engineers.
- D. Source quality-control reports.

PART 2 - PRODUCTS

2.1 METAL CONDUITS, TUBING, AND FITTINGS

- A. Listing and Labeling: Metal conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. GRC: Comply with ANSI C80.1 and UL 6.
- C. ARC: Comply with ANSI C80.5 and UL 6A.
- D. IMC: Comply with ANSI C80.6 and UL 1242.
- E. PVC-Coated Steel Conduit: PVC-coated rigid steel conduit.
  - 1. Comply with NEMA RN 1.
  - 2. Coating Thickness: **0.040 inch (1 mm)**, minimum.
- F. EMT: Comply with ANSI C80.3 and UL 797.
- G. FMC: Comply with UL 1; zinc-coated steel.
- H. LFMC: Flexible steel conduit with PVC jacket and complying with UL 360.
- I. Fittings for Metal Conduit: Comply with NEMA FB 1 and UL 514B.
  - 1. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886 and NFPA 70.
  - 2. Fittings for EMT:
    - a. Material: Steel.
    - b. Type: Compression only.
  - 3. Expansion Fittings: PVC or steel to match conduit type, complying with UL 651, rated for environmental conditions where installed, and including flexible external bonding jumper.
  - 4. Coating for Fittings for PVC-Coated Conduit: Minimum thickness of 0.040 inch (1 mm), with overlapping sleeves protecting threaded joints.

- J. Joint Compound for IMC, GRC, or ARC: Approved, as defined in NFPA 70, by authorities having jurisdiction for use in conduit assemblies, and compounded for use to lubricate and protect threaded conduit joints from corrosion and to enhance their conductivity.

## 2.2 NONMETALLIC CONDUITS, TUBING, AND FITTINGS

- A. Listing and Labeling: Nonmetallic conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. RNC: Type EPC-40-PVC, complying with NEMA TC 2 and UL 651 unless otherwise indicated.
- C. Fittings for RNC: Comply with NEMA TC 3; match to conduit or tubing type and material.
- D. Solvents and Adhesives: As recommended by conduit manufacturer.

## 2.3 BOXES, ENCLOSURES, AND CABINETS

- A. General Requirements for Boxes, Enclosures, and Cabinets: Boxes, enclosures, and cabinets installed in wet locations shall be listed for use in wet locations.
- B. Sheet Metal Outlet and Device Boxes: Comply with NEMA OS 1 and UL 514A.
- C. Device Boxes: Comply with NEMA OS 2 and UL 514C.
- D. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
- E. Cast-Metal Access, Pull, and Junction Boxes: Comply with NEMA FB 1 and UL 1773, cast aluminum with gasketed cover.
- F. Box extensions used to accommodate new building finishes shall be of same material as recessed box.
- G. Device Box Dimensions: 4 inches square by 2-1/8 inches deep (100 mm square by 60 mm deep), 4 inches by 2-1/8 inches by 2-1/8 inches deep (100 mm by 60 mm by 60 mm deep).
- H. Hinged-Cover Enclosures: Comply with UL 50 and NEMA 250, Type 1 with continuous-hinge cover with flush latch unless otherwise indicated.
  - 1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
  - 2. Nonmetallic Enclosures: Plastic.
  - 3. Interior Panels: Steel; all sides finished with manufacturer's standard enamel.

## 2.4 SOURCE QUALITY CONTROL FOR UNDERGROUND ENCLOSURES

- A. Handhole and Pull-Box Prototype Test: Test prototypes of handholes and boxes for compliance with SCTE 77. Strength tests shall be for specified tier ratings of products supplied.
  - 1. Tests of materials shall be performed by an independent testing agency.
  - 2. Strength tests of complete boxes and covers shall be by either an independent testing agency or manufacturer. A qualified registered professional engineer shall certify tests by manufacturer.
  - 3. Testing machine pressure gages shall have current calibration certification complying with ISO 9000 and ISO 10012 and traceable to NIST standards.

## PART 3 - EXECUTION

### 3.1 RACEWAY APPLICATION

- A. Outdoors: Apply raceway products as specified below unless otherwise indicated:
  - 1. Exposed Conduit: IMC.
  - 2. Concealed Conduit, Aboveground: IMC.
  - 3. Underground Conduit: RNC, Type EPC-40-PVC, .
  - 4. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFMC.
  - 5. Boxes and Enclosures, Aboveground: NEMA 250, Type 4.
- B. Indoors: Apply raceway products as specified below unless otherwise indicated:
  - 1. Exposed, Not Subject to Physical Damage: EMT.

2. Exposed, Not Subject to Severe Physical Damage: EMT.
3. Exposed and Subject to Severe Physical Damage: IMC. Raceway locations include the following:
  - a. Loading dock.
  - b. Corridors used for traffic of mechanized carts, forklifts, and pallet-handling units.
  - c. Mechanical rooms.
  - d. Gymnasiums.
4. Concealed in Ceilings and Interior Walls and Partitions: EMT.
5. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
6. Damp or Wet Locations: IMC.
7. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4 stainless steel in institutional and commercial kitchens and damp or wet locations.
8. Corrosive or Harsh environments: PVC coated rigid metal conduit.
- C. Elbows below grade, in or routed through concrete shall be PVC Coated Rigid Metal Conduit.
- D. Minimum Raceway Size: 3/4-inch (21-mm) trade size.
- E. Raceway Fittings: Compatible with raceways and suitable for use and location.
  1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings unless otherwise indicated. Comply with NEMA FB 2.10.
  2. PVC Externally Coated, Rigid Steel Conduits: Use only fittings listed for use with this type of conduit. Patch and seal all joints, nicks, and scrapes in PVC coating after installing conduits and fittings. Use sealant recommended by fitting manufacturer and apply in thickness and number of coats recommended by manufacturer.
  3. EMT: Use compression, steel fittings. Comply with NEMA FB 2.10.
  4. Flexible Conduit: Use only fittings listed for use with flexible conduit. Comply with NEMA FB 2.20.
- F. Install nonferrous conduit or tubing for circuits operating above 60 Hz. Where aluminum raceways are installed for such circuits and pass-through concrete, install in nonmetallic sleeve.
- G. Do not install aluminum conduits, boxes, or fittings in contact with concrete or earth.
- H. Install surface raceways only where indicated on Drawings.
- I. Do not install nonmetallic conduit where ambient temperature exceeds 120 deg F (49 deg C).

### 3.2 INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except where requirements on Drawings or in this article are stricter. Comply with NECA 102 for aluminum conduits. Comply with NFPA 70 limitations for types of raceways allowed in specific occupancies and number of floors.
- B. Keep raceways at least 8 inches (150 mm) away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- C. Complete raceway installation before starting conductor installation.
- D. Comply with requirements in Section 260529 "Hangers and Supports for Electrical Systems" for hangers and supports.
- E. Arrange stub-ups so curved portions of bends are not visible above finished slab.
- F. Install no more than the equivalent of three 90-degree bends in any conduit run except for control wiring conduits, for which fewer bends are allowed. Support within 12 inches (300 mm) of changes in direction.
- G. Conceal conduit and EMT within finished walls, ceilings, and floors unless otherwise indicated. Install conduits parallel or perpendicular to building lines.
- H. Support conduit within 12 inches (300 mm) of enclosures to which attached.

- I. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.
- J. Coat field-cut threads on PVC-coated raceway with a corrosion-preventing conductive compound prior to assembly.
- K. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors including conductors smaller than No. 4 AWG.
- L. Terminate threaded conduits into threaded hubs or with locknuts on inside and outside of boxes or cabinets. Install bushings on conduits up to 1-1/4-inch (35mm) trade size and insulated throat metal bushings on 1-1/2-inch (41-mm) trade size and larger conduits terminated with locknuts. Install insulated throat metal grounding bushings on service conduits.
- M. Install raceways square to the enclosure and terminate at enclosures with locknuts. Install locknuts hand tight plus 1/4 turn more.
- N. Do not rely on locknuts to penetrate nonconductive coatings on enclosures. Remove coatings in the locknut area prior to assembling conduit to enclosure to assure a continuous ground path.
- O. Cut conduit perpendicular to the length. For conduits 2-inch (53-mm) trade size and larger, use roll cutter or a guide to make cut straight and perpendicular to the length.
- P. Install pull wires in empty raceways, whether indicated on plans or not. Use polypropylene or monofilament plastic line with not less than 200-lb (90-kg) tensile strength. Leave at least 12 inches (300 mm) of slack at each end of pull wire. Cap underground raceways designated as spare above grade alongside raceways in use.
- Q. Install raceway sealing fittings at accessible locations according to NFPA 70 and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces. Install raceway sealing fittings according to NFPA 70.
- R. Install devices to seal raceway interiors at accessible locations. Locate seals so no fittings or boxes are between the seal and the following changes of environments. Seal the interior of all raceways at the following points:
  - 1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
  - 2. Where an underground service raceway enters a building or structure.
  - 3. Where otherwise required by NFPA 70.
- S. Expansion-Joint Fittings:
  - 1. Install type and quantity of fittings that accommodate temperature change listed for each of the following locations:
    - a. Outdoor Locations Not Exposed to Direct Sunlight: 125 deg F (70 deg C) temperature change.
    - b. Outdoor Locations Exposed to Direct Sunlight: 155 deg F (86 deg C) temperature change.
    - c. Indoor Spaces Connected with Outdoors without Physical Separation: 125 deg F (70 deg C) temperature change.
    - d. Attics: 135 deg F (75 deg C) temperature change.
  - 2. Install fitting(s) that provide expansion and contraction for at least 0.00041 inch per foot of length of straight run per deg F (0.06 mm per meter of length of straight run per deg C) of temperature change for PVC conduits. Install fitting(s) that provide expansion and contraction for at least 0.000078 inch per foot of length of straight run per deg F (0.0115 mm per meter of length of straight run per deg C) of temperature change for metal conduits.
  - 3. Install expansion fittings at all locations where conduits cross building or structure expansion joints.
  - 4. Install each expansion-joint fitting with position, mounting, and piston setting selected according to manufacturer's written instructions for conditions at specific location at time of installation. Install conduit supports to allow for expansion movement.

- T. Flexible Conduit Connections: Comply with NEMA RV 3. Use a maximum of 72 inches (1830 mm) of flexible conduit for recessed and semirecessed luminaires, equipment subject to vibration, noise transmission, or movement; and for transformers and motors.
    - 1. Use LFMC in damp or wet locations.
  - U. Mount boxes at heights indicated on Drawings. If mounting heights of boxes are not individually indicated, give priority to ADA requirements. Install boxes with height measured to center of box unless otherwise indicated.
  - V. Recessed Boxes in Masonry Walls: Saw-cut opening for box in center of cell of masonry block, and install box flush with surface of wall. Prepare block surfaces to provide a flat surface for a raintight connection between box and cover plate or supported equipment and box.
  - W. Horizontally separate boxes mounted on opposite sides of walls so they are not in the same vertical channel.
  - X. Locate boxes so that cover or plate will not span different building finishes.
  - Y. Support boxes of three gangs or more from more than one side by spanning two framing members or mounting on brackets specifically designed for the purpose.
  - Z. Fasten junction and pull boxes to or support from building structure. Do not support boxes by conduits.
  - AA. Set metal floor boxes level and flush with finished floor surface.
  - BB. Set nonmetallic floor boxes level. Trim after installation to fit flush with finished floor surface.
- 3.3 FIRESTOPPING
- A. Install firestopping at penetrations of fire-rated floor and wall assemblies. Comply with requirements in Section 078413 "Penetration Firestopping."
- 3.4 PROTECTION
- A. Protect coatings, finishes, and cabinets from damage and deterioration.
    - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
    - 2. Repair damage to PVC coatings or paint finishes with matching touchup coating recommended by manufacturer.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 05 53 – IDENTIFICATION FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 RELATED DOCUMENTS**

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

**1.2 SUMMARY**

- A. Section Includes:
  - 1. Identification for raceways.
  - 2. Identification of power and control cables.
  - 3. Identification for conductors.
  - 4. Warning labels and signs.
  - 5. Instruction signs.
  - 6. Equipment identification labels, including arc-flash warning labels.
  - 7. Miscellaneous identification products.

**1.3 SUBMITTALS**

- A. Provide submittals as required in section 26 00 10, "Submittal Process."
- B. Product Data: For each type of product.
  - 1. Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for electrical identification products.

**1.4 COORDINATION**

- A. Coordinate identification names, abbreviations, colors, and other features with requirements in the Contract Documents, Shop Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual, and with those required by codes, standards, and 29 CFR 1910.145. Use consistent designations throughout Project.
- B. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- C. Coordinate installation of identifying devices with location of access panels and doors.
- D. Install identifying devices before installing acoustical ceilings and similar concealment.
- E. When identifying room numbers on labels or directories, coordinate with the Owner's final room numbering system, as the architectural room numbers are generally arbitrary and may not be final.

**PART 2 - PRODUCTS**

**2.1 PERFORMANCE REQUIREMENTS**

- A. Comply with NFPA 70.
- B. Comply with 29 CFR 1910.144 and 29 CFR 1910.145.
- C. Comply with ANSI Z535.4 for safety signs and labels.
- D. Adhesive-attached labeling materials, including label stocks, laminating adhesives, and inks used by label printers, shall comply with UL 969.

**2.2 MATERIALS**

- A. Nameplates: Engraved three-layer laminated plastic, white letters on a black background.
- B. Wire and Cable Markers: Cloth markers, split sleeve or tubing type
- C. Buried Conduit Marker: Continuous printed plastic tape.
- D. Outdoor Equipment Cables: Manufacturer's Standards
  - 1. Weather and sun resistant
  - 2. Vandal resistant

2.3 COLOR AND LEGEND REQUIREMENTS

- A. Raceways and Cables Carrying Circuits at 600 V or Less:
  - 1. Black letters on an orange field.
  - 2. Legend: Indicate voltage and system or service type.
- B. Warning labels and signs shall include, but are not limited to, the following legends:
  - 1. Multiple Power Source Warning: "DANGER - ELECTRICAL SHOCK HAZARD - EQUIPMENT HAS MULTIPLE POWER SOURCES."
  - 2. Workspace Clearance Warning: "WARNING - OSHA REGULATION - AREA IN FRONT OF ELECTRICAL EQUIPMENT MUST BE KEPT CLEAR FOR 36 INCHES (915 MM)."

2.4 LABELS

- A. Vinyl Labels for Raceways Carrying Circuits at 600 V or Less: Preprinted, flexible labels laminated with a clear, weather- and chemical-resistant coating and matching wraparound clear adhesive tape for securing label ends.
- B. Snap-Around Labels for Raceways and Cables Carrying Circuits at 600 V or Less: Slit, pretensioned, flexible, preprinted, color-coded acrylic sleeves, with diameters sized to suit diameters of raceways they identify, and that stay in place by gripping action.
- C. Self-Adhesive Labels:
  - 1. Vinyl, thermal, transfer-printed, 3-mil- (0.08-mm-) thick, multicolor, weather- and UV-resistant, pressure-sensitive adhesive labels, configured for display on front cover, door, or other access to equipment unless otherwise indicated.
    - a. Nominal Size: 3.5-by-5-inch (76-by-127-mm).
  - 2. Marker for Tags: Permanent, waterproof, black ink marker recommended by tag manufacturer.
  - 3. Marker for Tags: Machine-printed, permanent, waterproof, black ink recommended by printer manufacturer.

2.5 BANDS AND TUBES:

- A. Snap-Around, Color-Coding Bands for Raceways and Cables #12 - #3/0: Slit, pretensioned, flexible, solid-colored acrylic sleeves, 2 inches (50 mm) long, with diameters sized to suit diameters of raceways or cables they identify, and that stay in place by gripping action.
  - 1. Brady SCN
- B. Heat-Shrink Preprinted Tubes: Flame-retardant polyolefin tubes with machine-printed identification labels, sized to suit diameters of and shrunk to fit firmly around cables they identify. Full shrink recovery occurs at a maximum of 200 deg F (93 deg C). Comply with UL 224.
  - 1. Brady HSA

2.6 SIGNS

- A. Baked-Enamel Signs:
  - 1. Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for application.
  - 2. 1/4-inch (6.4-mm) grommets in corners for mounting.
  - 3. Nominal Size: 7 by 10 inches (180 by 250 mm).
- B. Metal-Backed Butyrate Signs:
  - 1. Weather-resistant, nonfading, preprinted, cellulose-acetate butyrate signs, with 0.0396-inch (1-mm) galvanized-steel backing and with colors, legend, and size required for application.
  - 2. 1/4-inch (6.4-mm) grommets in corners for mounting.
  - 3. Nominal Size: 10 by 14 inches (250 by 360 mm).
- C. Laminated Acrylic or Melamine Plastic Signs:
  - 1. Engraved legend.

2. Thickness:
  - a. For signs up to 20 sq. inches (129 sq. cm), minimum 1/16-inch- (1.6 mm).
  - b. For signs larger than 20 sq. inches (129 sq. cm), 1/8 inch (3.2 mm) thick.
  - c. Engraved legend with black letters on white face for normal power, white letters on red face for emergency power.
  - d. Punched or drilled for mechanical fasteners.
  - e. Framed with mitered acrylic molding and arranged for attachment at applicable equipment.

## 2.7 EQUIPMENT AND WIRING DEVICE NAMEPLATES

- A. General: White core laminated plastic. White lettering on black background, same style throughout project.
- B. Emergency Equipment Nameplates: White lettering on red background.
- C. Fasteners: Stainless steel self-tapping screws. Use epoxy adhesive only when NEMA enclosure rating is compromised by screws and for wiring device nameplates.
- D. Switchboard, Motor Control Center, Panelboard, Dry-type Transformer and Control Panel Main Nameplate: 5/8" high block letters.
- E. Other Nameplates: 3/8" high block or condensed letters.
- F. Legends:
  1. General. Description as indicated on drawings, i.e., "PANEL EP-1", "XFRM ET-1", "TS-1".
  2. Voltage. Description of operating voltage, i.e., "120 Volts", "120/208 Volts", "208 Volts", "277/480 Volts", or "480 Volts", "Single Phase" or "Three Phase".
  3. Source: Description of source; i.e., "FED FROM PANEL EP-1, CKT. #1".
  4. Available fault current and data calculated.
- G. AIC Rating: Short Circuit current rating, fully rated; i.e., "10,000 Amperes, Fully Rated",

## 2.8 TERMINAL IDENTIFICATIONS

- A. Brady B-500 vinyl cloth pre-printed self-adhesive terminal markers. Legends: 1 through 96, A through Z.

## 2.9 GROUND TERMINAL AND BUS IDENTIFICATION

- A. Type: Green paint or dye, factory applied to terminal and bus.
- B. Self-Adhesive Label Legend: "Ground", "Ground Bus", "Equipment Ground Bus" or "Isolated Ground Bus."

## 2.10 GENERATOR WARNING SIGNS

- A. Construction: Indoor/outdoor type. Plastic or fiber glass, non-corrosive, impervious to weather.
- B. Legend: "Danger" upper legend white block letters on red panel on black panel. "Warning" middle legend, red block letters on white panel, underlined in red. "This machine is automatically controlled" lower middle legend, black condensed block letters on white panel. "It may start at any time" bottom legend, red block letters on white panel.
- C. Manufacturer: Brady, #47161.
- D. Size: 7 inches high x 10 inches wide.

## PART 3 - EXECUTION

### 3.1 PREPARATION

- A. Self-Adhesive Identification Products: Before applying electrical identification products, clean substrates of substances that could impair bond, using materials and methods recommended by manufacturer of identification product.

### 3.2 INSTALLATION

- A. Verify and coordinate identification names, abbreviations, colors, and other features with requirements in other Sections requiring identification applications, Drawings, Shop Drawings, manufacturer's wiring diagrams, and operation and maintenance manual. Use consistent designations throughout Project.

- B. Install identifying devices before installing acoustical ceilings and similar concealment.
- C. Verify identity of each item before installing identification products.
- D. Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment. Install access doors or panels to provide view of identifying devices.
- E. Apply identification devices to surfaces that require finish after completing finish work.
- F. Attach signs and plastic labels that are not self-adhesive type with mechanical fasteners appropriate to the location and substrate.
- G. Painted Identification: Comply with requirements in painting Sections for surface preparation and paint application.
- H. System Identification Color-Coding Bands for Raceways and Cables: Each color-coding band shall completely encircle cable or conduit. Place adjacent bands of two-color markings in contact, side by side. Locate bands at changes in direction, at penetrations of walls and floors, at 50-foot (15-m) maximum intervals in straight runs, and at 25-foot (7.6-m) maximum intervals in congested areas.

### 3.3 IDENTIFICATION SCHEDULE

- A. Accessible Raceways and Metal-Clad Cables, 600 V or Less, for Service, Feeder, and Branch Circuits, More Than 30 A and 120 V to Ground: Identify with self-adhesive vinyl tape applied in bands. Install labels at 30-foot (10-m) maximum intervals.
- B. Accessible Raceways and Cables within Buildings: Identify the covers of each junction and pull box of the following systems with self-adhesive vinyl labels containing the wiring system legend and system voltage. System legends shall be as follows:
  - 1. "EMERGENCY POWER."
  - 2. "POWER."
- C. Power-Circuit Conductor Identification, 600 V or Less: For conductors in vaults, pull and junction boxes, manholes, and handholes, use color-coding conductor tape to identify the phase.
  - 1. Color-Coding for Phase-and Voltage-Level Identification, 600 V or Less: Use colors listed below for ungrounded feeder and branch-circuit conductors.
    - a. Color shall be factory applied.
    - b. Colors for 208/120-V Circuits:
      - 1) Phase A: Black.
      - 2) Phase B: Red.
      - 3) Phase C: Blue.
    - c. Colors for 480/277-V Circuits:
      - 1) Phase A: Brown.
      - 2) Phase B: Orange.
      - 3) Phase C: Yellow.

### 3.4 SPECIAL RACEWAY IDENTIFICATION

- 1. Special Systems. Brady Series 55200, 2" wide, pipe banding tape or colored conduit. All covers for pull boxes shall be painted correlating color.
  - a. Fire alarm: red
  - b. Telephone: blue
  - c. Data/Communications: blue
  - d. Low voltage controls: black
  - e. Sound systems: yellow
  - f. Clock systems: green
- B. Install instructional sign, including the color code for grounded and ungrounded conductors using adhesive-film-type labels.
- C. Control-Circuit Conductor Identification: For conductors and cables in pull and junction boxes, manholes, and handholes, use self-adhesive vinyl labels with the conductor or cable designation, origin, and destination.
- D. Control-Circuit Conductor Termination Identification: For identification at terminations, provide self-adhesive vinyl labels with the conductor designation.

- E. Auxiliary Electrical Systems Conductor Identification: Identify field-installed alarm, control, and signal connections.
  - 1. Identify conductors, cables, and terminals in enclosures and at junctions, terminals, and pull points. Identify by system and circuit designation.
  - 2. Use system of marker-tape designations that is uniform and consistent with system used by manufacturer for factory-installed connections.
  - 3. Coordinate identification with Project Drawings, manufacturer's wiring diagrams, and operation and maintenance manual.
- F. Workspace Indication: Install floor marking tape to show working clearances in the direction of access to live parts. Workspace shall comply with NFPA 70 and 29 CFR 1926.403 unless otherwise indicated. Do not install at flush-mounted panelboards and similar equipment in finished spaces.
- G. Warning Labels for Indoor Cabinets, Boxes, and Enclosures for Power and Lighting: Baked-enamel warning signs.
  - 1. Comply with 29 CFR 1910.145.
  - 2. Identify system voltage with black letters on an orange background.
  - 3. Apply to exterior of door, cover, or other access.
  - 4. For equipment with multiple power or control sources, apply to door or cover of equipment, including, but not limited to, the following:
    - a. Power-transfer switches.
    - b. Controls with external control power connections.
- H. .
- I. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and operation and maintenance manual. Apply labels to disconnect switches and protection equipment, central or master units, control panels, control stations, terminal cabinets, and racks of each system. Systems include power, lighting, control, communication, signal, monitoring, and alarm unless equipment is provided with its own identification.
  - 1. Labeling Instructions:
    - a. Indoor Equipment: Engraved, laminated acrylic or melamine plastic label, punched or drilled for mechanical fasteners. Unless otherwise indicated, provide a single line of text with 1/2-inch- (13-mm-) high letters on 1-1/2-inch- (38-mm-) high label; where two lines of text are required, use labels 2 inches (50 mm) high.
    - b. Outdoor Equipment: Engraved, laminated acrylic or melamine label.
    - c. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.
    - d. Unless labels are provided with self-adhesive means of attachment, fasten them with appropriate mechanical fasteners that do not change the NEMA or NRTL rating of the enclosure.
    - e. Emergency system boxes and enclosures.
    - f. Power-generating units.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 05 93 - ELECTRICAL TESTING**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. The Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to the Work in this Section.

1.2 SCOPE

- A. Provide all equipment, materials, labor, supervision, tools and services necessary for or incidental to the testing and inspecting of each new system and each new item of equipment provided or installed under this Division of the Specifications.
- B. Tests and inspections for each new system and each new item of equipment shall be in accordance with the manufacturer's instructions.
- C. Acceptance Tests shall be performed within twenty-four hours of receipt of equipment and shall prove that electrical equipment is operational within industry and manufacturer's tolerances and is acceptable for installation.
- D. Field tests shall prove that the equipment is installed in accordance with the design drawings and specifications and the manufacturer's instructions.
- E. Upon completion of tests and inspections specified, attach a label to each service device. Labels shall indicate the test date and test company.
- F. Work Included:
  - 1. Wire and cable (600 Volts and below)
  - 2. Automatic transfer switch
  - 3. Generators
  - 4. Grounding
- G. Engage the services of a recognized testing laboratory with more than five (5) years of experience and certified by the National Electrical Testing Association (NETA) for the purpose of performing the inspections and tests specified. The testing laboratory shall perform tests and inspections designated to be performed by the Testing Laboratory (TL). All other Inspectors and Tests may be performed by the Contractor's qualified personnel. The testing laboratory's responsibility shall include the following:
  - 1. Notification of the Engineer prior to the start of testing.
  - 2. Specifying the power requirements for each test site.
  - 3. Providing sufficient protective barriers and warning signs to conduct tests and inspections safely.
  - 4. Reporting any material or workmanship found to be defective during tests and inspections to the Engineer.
  - 5. Implementation of the final settings and adjustments on the electrical equipment in accordance with the values specified in the coordination study.
  - 6. Maintaining written records of tests. Comply with the submittal requirements specified in this section.
  - 7. Upon satisfactory completion of tests and related effort, apply label to tested components indicating results, person responsible and date.
  - 8. Acceptable Testing Laboratories
    - a. Southwest Energy Systems, LLC
    - b. Shermco Industries
    - c. ABB Service Engineering
    - d. General Electric Service Engineering
    - e. Square D Services
- H. Engage the services of the manufacturer's service organization to perform the tests and inspections, as specified.

1.3 DIVISION OF RESPONSIBILITY – CONTRACTOR

- A. Perform routine insulation resistance, continuity, and rotation tests for new distribution and utilization equipment as specified prior to, and in addition to, the tests specified to be performed by the testing laboratory. Responsibility shall include the following:
1. Supply a suitable source of power to the testing laboratory or the manufacturer's representative at each site. Notify the testing laboratory or the manufacturer's representative when equipment becomes available for acceptance tests.
  2. Coordinate the work to expedite the project scheduling.
  3. Provide a complete set of electrical drawings and specifications, and pertinent change orders to the testing laboratory and the manufacturer's representative.
  4. Maintain records of all tests and inspections performed and assemble all information required to comply with the submittal requirements specified in this Section.

1.4 SUBMITTALS

- A. Provide a copy of a draft and final report, which shall contain the following information:
1. An executive summary which identifies any significant problems encountered and corrective actions.
  2. A tabulation of all life safety system test results and certification including field measurements.
  3. A tabulation of all cable test data.
  4. Copies of all system certifications.
- B. The Final and Draft Reports shall be prepared using the following format:

Format:

Size: 8½" x 11"

Paper: White bond, at least 20 lb. weight

Text: Typewritten or printed

Drawings: 11" in height preferable; bind in with text; foldout acceptable; larger drawings acceptable but fold to fit within the Manual and provide a drawing pocket inside rear cover or bind in with text.

Flysheets: Separate each section of the Manual with neatly prepared flysheets briefly describing contents of the ensuing section; flysheets may be in color.

Binding: Use heavy-duty plastic or fiberboard covers with 3-ring binding mechanism concealed inside the manual. All binding is subject to the Owner's Representative's approval.

Measurements: Provide all measurements in U.S. standard units such as feet-and-inches, lbs., and cfm. Where items may be expected to be measured within ten years in accordance with metric formulae, provide additional measurements in the "International System of Units" (SI).

1. Provide front and back covers for each manual, using durable material approved by the Engineer, and clearly identified on or through the cover with at least the following information:
  - a. Electrical Testing Adjusting and Balancing
  - b. Owner's Name
  - c. Project Title
  - d. Space for approval signature of the engineer and approval date

2. Contents: Include at least the following:
    - a. Neatly typewritten index near the front of the Manual, giving immediate information as to location within the manual.
    - b. Such other data as required in pertinent sections of these specifications.
  - C. Submit a copy of a Draft Report to the engineer. Revise the report as required to accommodate the Engineer's comments.
  - D. Submit a copy of the Final Report within 30 calendar days after approval of the Draft Report.
- 1.5 TEST INSTRUMENT CALIBRATION
- A. The testing laboratory shall maintain test instruments, which have been calibrated within rated accuracy. Dated calibration labels shall be visible on the test equipment.
  - B. Instruments shall be calibrated in accordance with the following frequency schedule:
    1. Field instruments – 6 months maximum.
    2. Laboratory instruments – 12 months.
    3. Leased specialty equipment – 12 months.
- 1.6 SAFETY PRACTICES
- A. Safety practices shall include, but are not limited to, the following requirements:
    1. Occupational Safety and Health Act of 1970 – OSHA.
    2. "Accident Prevention Manual for Industrial Operations," as published by the National Safety Council.
    3. Applicable safety operating procedures of the governing authorities.
    4. Division 26 specifications.
  - B. Perform tests with apparatus de-energized, except where otherwise specifically required.
  - C. Power circuits shall have conductors shorted to ground by a hot-line grounded device approved for that purpose.
- 1.7 QUALITY ASSURANCE
- A. Use adequate numbers of skilled workmen thoroughly trained and experienced in necessary crafts and completely familiar with specified requirements and methods needed for proper performance of Work of this Section.
  - B. Without additional cost to Owner, provide labor and materials as required to complete the Work of this Section in accordance with requirements of governmental agencies having jurisdiction, regardless of whether such materials and associated labor are called for elsewhere in these Contract Documents.
  - C. When requested, provide Architect with manufacturer's certificate that the test equipment meet or exceed minimum requirements as specified.

PART 2 - PRODUCTS – (NOT USED)

PART 3 - EXECUTION

- 3.1 GENERAL PROCEDURES – ACCEPTANCE AND FIELD TESTS
- A. Perform each test and inspection until acceptable results are obtained in accordance with the manufacturer's instructions, unless otherwise specified.
  - B. Perform the following tests and inspections for each system and item of equipment as applicable, unless otherwise specified:
    1. Inspect for physical damage and defective materials or installation work. Inspect for proper physical, electrical and mechanical conditions (materials and installation work).

2. Inspect equipment and systems for compliance with requirements of the Drawings and Specifications. Compare equipment nameplate information with the latest one-line diagrams. Verify that connections and terminations are in accordance with the one-line diagrams.
  3. Check tightness of cable connections and bolted bus joints by calibrated torque wrench method. Refer to manufacturer's instructions for proper foot-pound levels. Place a mark on each tightened bolt to ensure completeness.
  - C. Promptly report any discrepancies or unsatisfactory conditions determined by test or inspection.
  - D. Perform insulation resistance tests for each applicable system and item of equipment. Do not perform this test on solid-state devices. Note: In some cases terminated cables cannot be tested unless disconnected from the end devices.
    1. Apply test voltages as follows:

<u>Voltage Rating</u>	<u>Test Voltage</u>
150 – 600 V	1000 V
601 – 5000 V	2500 V
5001 V & higher	5000 V
    2. Investigate values of insulation resistance less than the manufacturers recommended minimum, or less than a value equal to  $kV+1$  in megohms.
  - E. Overpotential tests shall not proceed until resistance tests are satisfactorily performed. Perform overpotential tests for each system and item of equipment as specified.
- 3.2 CABLES (600 VOLTS AND LESS) – FIELD TESTING
- A. Inspect for shield grounding, cable support and termination.
  - B. Check visible cable bends against ICEA and manufacturer's minimum allowable bending radius
  - C. Inspect for fireproofing in common cable areas.
  - D. Where cables are terminated through window type cable trays, make an inspection to verify that neutrals and grounds are properly terminated for normal operation of protective devices.
  - E. Perform insulation resistance tests on each cable with respect to ground and adjacent cables. Record test results.
  - F. Perform continuity tests to confirm proper cable connections.
- 3.3 SWITCHBOARDS – FIELD TESTING
- A. At the completion of the work the switchboard shall be field tested in the presence of the Engineer. Tests shall be conducted by the service organization of the manufacturer.
  - B. Tests shall include the following:
  - C. Operation of each disconnecting means under load.
  - D. Operation of all metering equipment.
  - E. The manufacturer shall observe all cable bracing both incoming and outgoing and certify that same is provided in accordance with the manufacturer's recommendations.
  - F. The ground fault system shall be set by the testing laboratory at the level specified by the approved coordination study. Each system shall be tested by checking coordination between ground fault and phase to ground fault of a 1P-20 ampere lighting branch circuit.
  - G. Bus joints shall be re-torqued in accordance with manufacturer's recommendations. Submit certification.
- 3.4 SOLID STATE MOLDED CASE CIRCUIT BREAKERS – 600 VOLTS AND LESS – FIELD TESTING
- A. Perform insulation resistance tests from each pole-to-ground, from pole-to-pole, and across open contacts of each phase. Test values shall not be less than 50 meg-ohms. Record final test results.

- B. Utilize primary current injection method to verify the following settings are in accordance with the coordination study.
    - 1. Minimum pickup current of trip devices, where possible
    - 2. Long time delay, using 300% pickup current
    - 3. Short time pickup and short time delay
    - 4. Instantaneous pickup current
    - 5. Ground fault pickup current and time delay
  - C. Verify trip unit reset characteristics.
  - D. Activate auxiliary protective devices, such as ground fault and under voltage relays, to insure operation of shunt trip devices.
  - E. Where charging motors are used, electrically operate circuit breaker to verify performance of limit switches.
- 3.5 MOLDED CASE CIRCUIT BREAKERS (600 VOLTS AND LESS) – FIELD TESTING
- A. The testing lab shall check each circuit breaker for proper mounting, conductor size and feeder designation.
  - B. Operate circuit breaker to insure smooth operation.
  - C. Open unsealed breakers and check internal components for tightness, when applicable. The testing lab shall measure contact resistance in micro-ohms for devices with full load ampere. ratings larger than 400 amperes. Investigate deviations greater than 50%, as compared to adjacent poles and similar breakers.
- 3.6 DRY TYPE TRANSFORMERS (PRIMARY RATED 600 VOLTS)
- A. Within five (5) days after delivery to the work site and prior to installation, perform the following field tests and inspections:
    - 1. Compare transformer and accessories nameplate information with the specification and report any discrepancies.
    - 2. Inspect transformer and accessories and report installation or shipping damage, loose material, shipping blocks or contamination. Correct deficiencies.
    - 3. Check operation of access covers. Correct deficiencies.
    - 4. Check air circulation for proper operation. Correct deficiencies.
- 3.7 AUTOMATIC TRANSFER SWITCH
- A. Set the timers and test the start generator function.
  - B. Open the circuit breaker in the main switchboard serving the ATS and verify proper starting and load transfer of the ATS.
- 3.8 INSTRUMENT TRANSFORMERS – FIELD TESTING
- A. The Testing Lab shall perform all work.
  - B. Verify proper operation of grounding and shorting devices.
  - C. Electrically confirm transformer polarity.
  - D. Verify connection at secondary current transformer leads by applying low current to leads and check for current contribution at applicable devices.
  - E. Confirm transformer ratio.
  - F. Verify connection of secondary power transformer and control transformer leads by applying low voltage to leads and check for voltage contribution at applicable devices.
  - G. Check power transformer secondary load with secondary voltage and current measurements to insure that load is less than the wattage of power transformer.
- 3.9 METERS – FIELD TESTING
- The Testing Laboratory shall perform all work.**
- A. Check calibration of meters at five (5) points. Use full-scale instruments having precision not more than 50% of meter being tested. Apply test values, record data and plot curves from 0 to full-scale reading.
    - 1. Zero sequence system is grounded upstream from sensor

2. Ground strap systems are grounded through sensing device
3. Ground connection is made ahead of neutral disconnect link
- B. Verify that control power transformer capacity is adequate for system
- C. Manually operate monitor panels to test sequences for:
  1. Trip test
  2. No trip test
  3. Non-automatic reset
- D. Ensure control circuit has switchable fuse device with current limiting fuses.
- E. Measure system neutral insulation resistance to ensure no shunt ground paths exist. Remove neutral-to-ground disconnect link, and measure neutral insulation resistance, and then replace link. System neutral insulation shall be one (1) meg-ohm or greater. Record test results

### 3.10 GROUNDING SYSTEMS – FIELD TESTING

#### **All work shall be performed by the Testing Laboratory**

- A. Perform ground continuity tests between main ground system and equipment frames, and between main ground system and system neutral and/or derived neutral points. Make test by passing a minimum 10-amp DC current between the ground reference system and the ground point to be tested. Measure voltage drop and calculate resistance by voltage drop method.
- B. Submit in a letter indicating the ohmic resistance of the service grounds and a statement that the grounding system is free of all defects, stray currents, shorts, etc.
- C. Perform fall of potential tests on the main ground electrode system. The main ground electrode system resistance-to-ground shall be no greater than five (5) ohms.
- D. Record final test results.

### 3.11 STARTERS

- A. Motor Controllers:
  1. Submit with certification in tabular form a complete listing of all motors on the project for which motor controllers have been furnished. Include on this listing the nameplate full load amperes of each motor and the size overload heaters installed in each motor controller.
- B. Motors:
  1. Test all motors under load and verify that motor rotation is correct
- C. Chillers:
  1. Verify proper functioning of the wye-delta starter
  2. While the chiller is fully loaded, measure and record volts, amps, power factor of all three phases

### 3.12 SURGE ARRESTORS – FIELD TESTING

#### **The Testing Laboratory shall perform all work.**

- A. Verify integrity of ground and discharge counter connections.
- B. Perform a 60-hertz spark-over test. Record test results.
- C. Perform a radio influence voltage test. Record test results.
- D. Perform an insulation power factor test. Record test results
- E. Perform ground continuity test to ground grid system. Record test results.

### 3.13 LIFE SAFETY SYSTEMS

- A. All wiring must be inspected and tested to ensure that there are no grounds, opens or shorts. The minimum allowable resistance between any two conductors or between conductors and ground is ten (10) megohms as measured with a 500 volt megger after all conduit, conductors, detector bases, etc., have been installed, but before the detector devices are plugged into the bases or end-of-line devices installed.

- B. Perform all electrical and mechanical tests required by the equipment manufacturer's form. A checkout report is to be prepared by the technician and submitted in triplicate, one copy of which will be registered with the equipment manufacturer. The report is to include, but not be limited to:
    - 1. A complete list of equipment installed and wired
    - 2. Indication that all equipment is properly installed and functions and conforms to these specifications
    - 3. Tests of individual zones as applicable
    - 4. Serial numbers, locations by zone and model number for each installed detector
    - 5. Voltage (sensitivity) settings for each ionization detector as measured in place
    - 6. Response time of detector
  - C. Submit a certified report indicating the following:
    - 1. 4 of the FACP
- 3.14 BALLASTS
- A. Submit manufacturer's certification that ballasts and transformers for discharge type lamps comply with the latest C.B.M. specifications which have been issued.
- 3.15 EMERGENCY BATTERY PACKS
- A. Each emergency battery pack shall be shown to operate satisfactorily. This shall be accomplished by the use of the unit mounted test switch as one test. The second test shall be the interruption of power to the unit.
  - B. Quartz standby lamps in H.I.D. luminaires shall be tested to show proper operation by testing as listed above.
- 3.16 CALIBRATION
- A. Calibrate and adjust all components requiring same as directed, in accordance with manufacturer's procedures and recommendations or as required, for the following categories of equipment:
    - 1. Transformer taps
    - 2. Lighting fixtures (lamp positions, reflector positions, etc., as required)
    - 3. Motor starters
    - 4. Generator Controls and synchronization
  - B. Provide overloads in all motor starters, in accordance with motor nameplate data and as recommended by the manufacturer.
- 3.17 RE-TESTING
- A. Correct deficiencies and re-test. Verify by re-tests that specified requirements are met.
  - B. Notify the Architect/Engineer seven (7) days prior to the testing dates. Should the Architect/Engineer elect not to witness a specific test a statement of certification shall be forwarded to the Architect/Engineer for his approval.
  - C. Conduct tests at a time agreeable to the Architect/Engineer. Provide premium labor as necessary.
  - D. Products which are found defective or do not pass such tests shall be removed and replaced. Tests shall be repeated.
  - E. Arrange for and conduct all test and inspections required by the authorities having jurisdiction. Pay all fees for testing and inspection.

**END OF SECTION**

THIS PAGE INTENTIONALLY LEFT BLANK

**SECTION 26 32 13 - ENGINE GENERATORS-DIESEL**

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes packaged engine-generator sets for standby power supply with the following features:
  - 1. Diesel engine.
  - 2. Unit-mounted cooling system.
  - 3. Unit-mounted and remote-mounted control and monitoring.
  - 4. Outdoor enclosure.

1.3 DEFINITIONS

- A. Operational Bandwidth: The total variation from the lowest to highest value of a parameter over the range of conditions indicated, expressed as a percentage of the nominal value of the parameter.
- B. EPS: Emergency power supply.
- C. EPSS: Emergency power supply system.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of product.
  - 1. Manufacturer's Sizing Report.
  - 2. Include rated capacities, operating characteristics, electrical characteristics, and furnished specialties and accessories.
  - 3. Include thermal damage curve for generator.
  - 4. Include time-current characteristic curves for generator protective devices.
  - 5. Include fuel consumption in cubic feet per hour at 0.8 power factor at 0.5, 0.75 and 1.0 times generator capacity.
  - 6. Include air flow requirements for cooling and combustion air in cfm at 0.8 power factor, with air supply temperature of 95, 80, 70, and 50 deg F. Provide drawings showing requirements and limitations for location of air intake and exhausts.
  - 7. Include generator characteristics, including, but not limited to rating, efficiency, reactance, and short-circuit current capability.
- B. Shop Drawings:
  - 1. Include plans and elevations for engine-generator set and other components specified.
  - 2. Include details of equipment assemblies. Indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
  - 3. Identify fluid drain ports and clearance requirements for proper fluid drain.
  - 4. Design calculations for selecting vibration isolators and seismic restraints and for designing vibration isolation bases.
  - 5. Vibration Isolation Base Details: Detail fabrication including anchorages and attachments to structure and to supported equipment. Include base weights.
  - 6. Include diagrams for power, signal, and control wiring. Complete schematic, wiring, and interconnection diagrams showing terminal markings for EPS equipment and functional relationship between all electrical components.

1.5 SUBMITTALS

- A. Provide submittals as required in section 26 00 10, "Submittal Process."

- B. Operation and Maintenance Data: For packaged engine generators to include in emergency, operation, and maintenance manuals.
    - 1. In addition to items specified in Section 017823 "Operation and Maintenance Data," include the following:
      - a. List of tools and replacement items recommended to be stored at Project for ready access. Include part and drawing numbers, current unit prices, and source of supply.
      - b. Operating instructions laminated and mounted adjacent to generator location.
      - c. Training plan.
  - C. Source quality-control reports, including, but not limited to the following:
    - 1. Certified Test Reports: For components and accessories that are equivalent, but not identical, to those tested on prototype unit.
    - 2. Report of factory test on units to be shipped for this Project, showing evidence of compliance with specified requirements.
    - 3. Report of sound generation.
    - 4. Report of exhaust emissions showing compliance with applicable regulations.
    - 5. Certified Torsional Vibration Compatibility: Comply with NFPA 110.
  - D. Field quality-control reports.
  - E. Warranty: For special warranty.
- 1.6 MAINTENANCE MATERIAL SUBMITTALS
- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
    - 1. Fuses: One for every 10 of each type and rating but no fewer than one of each.
    - 2. Indicator Lamps: Two for every six of each type used, but no fewer than two of each.
    - 3. Filters: One set each of lubricating oil, fuel, and combustion-air filters.
    - 4. Tools: Each tool listed by part number in operations and maintenance manual.
- 1.7 QUALITY ASSURANCE
- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved by manufacturer.
  - B. Testing Agency Qualifications: Member company of NETA or an NRTL.
    - 1. Testing Agency's Field Supervisor: Certified by NETA to supervise on-site testing.
- 1.8 WARRANTY
- A. Manufacturer's Warranty: Manufacturer agrees to repair or replace components of packaged engine generators and associated auxiliary components that fail in materials or workmanship within specified warranty period.
    - 1. Warranty Period: 5 years from date of Substantial Completion.

## PART 2 - PRODUCTS

### 2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
  - 1. Onan/Cummins Power Generation; Industrial Business Group.
  - 2. Kohler Co.; Generator Division.
  - 3. All other manufacturers shall be pre-approved prior to bidding.
- B. Source Limitations: Obtain packaged generator sets and auxiliary components through one source from a single manufacturer.

2.2 PERFORMANCE REQUIREMENTS

- A. ASME Compliance: Comply with ASME B15.1.
- B. NFPA Compliance:
  - 1. Comply with NFPA 37.
  - 2. Comply with NFPA 70.
  - 3. Comply with NFPA 99.
  - 4. Comply with NFPA 110 requirements for Level 1 emergency power supply system.
- C. UL Compliance: Comply with UL 2200.
- D. Engine Exhaust Emissions: Comply with EPA Tier 3 requirements and applicable state and local government requirements.
- E. Noise Emission: Comply with applicable state and local government requirements for maximum noise level at adjacent property boundaries due to sound emitted by generator set including engine, engine exhaust, engine cooling-air intake and discharge, and other components of installation.
- F. Environmental Conditions: Engine-generator system shall withstand the following environmental conditions without mechanical or electrical damage or degradation of performance capability:
  - 1. Relative Humidity: Zero to 95 percent.
  - 2. Altitude: Sea level to 1000 feet (300 m).

2.3 ASSEMBLY DESCRIPTION

- A. Factory-assembled and -tested, water-cooled engine, with brushless generator and accessories.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a testing agency acceptable to authorities having jurisdiction, and marked for intended location and application.
- C. EPSS Class: Engine-generator set shall be classified as a Class 8 in accordance with NFPA 110.
- D. Induction Method: Naturally aspirated.
- E. Governor: Adjustable isochronous, with speed sensing.
- F. Emissions: Comply with EPA Tier 3 requirements.
- G. Mounting Frame: Structural steel framework to maintain alignment of mounted components without depending on concrete foundation. Provide lifting attachments sized and spaced to prevent deflection of base during lifting and moving.
  - 1. Rigging Diagram: Inscribed on metal plate permanently attached to mounting frame to indicate location and lifting capacity of each lifting attachment and generator-set center of gravity.
- H. Capacities and Characteristics:
  - 1. Power Output Ratings: Nominal ratings as indicated at 0.8 power factor excluding power required for the continued and repeated operation of the unit and auxiliaries.
  - 2. Output Connections: Three-phase, four wire.
  - 3. Nameplates: For each major system component to identify manufacturer's name and address, and model and serial number of component.
- I. Generator-Set Performance:
  - 1. Steady-State Voltage Operational Bandwidth: 3 percent of rated output voltage from no load to full load.
  - 2. Transient Voltage Performance: Not more than 20 percent variation for 50 percent step-load increase or decrease. Voltage shall recover and remain within the steady-state operating band within three seconds.
  - 3. Steady-State Frequency Operational Bandwidth: 0.5 percent of rated frequency from no load to full load.
  - 4. Steady-State Frequency Stability: When system is operating at any constant load within the rated load, there shall be no random speed variations outside the steady-state operational band and no hunting or surging of speed.

5. Transient Frequency Performance: Less than 5 percent variation for 50 percent step-load increase or decrease. Frequency shall recover and remain within the steady-state operating band within five seconds.
6. Output Waveform: At no load, harmonic content measured line to line or line to neutral shall not exceed 5 percent total and 3 percent for single harmonics. Telephone influence factor, determined according to NEMA MG 1, shall not exceed 50 percent.
7. Sustained Short-Circuit Current: For a three-phase, bolted short circuit at system output terminals, system shall supply a minimum of 250 percent of rated full-load current for not less than 10 seconds and then clear the fault automatically, without damage to generator system components.
8. Start Time: Comply with NFPA 110, Type 10, system requirements.

## 2.4 ENGINE

- A. Fuel: Fuel oil, Grade DF-2.
- B. Rated Engine Speed: 1800 rpm.
- C. Maximum Piston Speed for Four-Cycle Engines: 2250 fpm (11.4 m/s).
- D. Lubrication System: The following items are mounted on engine or skid:
  1. Filter and Strainer: Rated to remove 90 percent of particles 5 micrometers and smaller while passing full flow.
  2. Thermostatic Control Valve: Control flow in system to maintain optimum oil temperature. Unit shall be capable of full flow and is designed to be fail-safe.
  3. Crankcase Drain: Arranged for complete gravity drainage to an easily removable container with no disassembly and without use of pumps, siphons, special tools, or appliances.
- E. Jacket Coolant Heater: Electric-immersion type, factory installed in coolant jacket system. Comply with NFPA 110 requirements for Level 1 equipment for heater capacity.
- F. Cooling System: Closed loop, liquid cooled, with radiator factory mounted on engine-generator-set mounting frame and integral engine-driven coolant pump.
  1. Coolant: Solution of 50 percent ethylene-glycol-based antifreeze and 50 percent water, with anticorrosion additives as recommended by engine manufacturer.
  2. Size of Radiator: Adequate to contain expansion of total system coolant from cold start to 110 percent load condition.
  3. Expansion Tank: Constructed of welded steel plate and rated to withstand maximum closed-loop coolant system pressure for engine used. Equip with gage glass and petcock.
  4. Temperature Control: Self-contained, thermostatic-control valve modulates coolant flow automatically to maintain optimum constant coolant temperature as recommended by engine manufacturer.
  5. Coolant Hose: Flexible assembly with inside surface of nonporous rubber and outer covering of aging-, ultraviolet-, and abrasion-resistant fabric.
    - a. Rating: 50-psig (345-kPa) maximum working pressure with coolant at 180 deg F (82 deg C), and non-collapsible under vacuum.
    - b. End Fittings: Flanges or steel pipe nipples with clamps to suit piping and equipment connections.
- G. Muffler/Silencer: Critical type, sized as recommended by engine manufacturer and selected with exhaust piping system to not exceed engine manufacturer's engine backpressure requirements.
  1. Minimum sound attenuation of 25 dB at 500 Hz.
  2. Sound level measured at a distance of 25 feet (8 m) from exhaust discharge after installation is complete shall be 78 dBA or less.
- H. Air-Intake Filter: Standard-duty, engine-mounted air cleaner with replaceable dry-filter element and "blocked filter" indicator.

- I. Starting System: 24-V electric, with negative ground.
    1. Components: Sized so they are not damaged during a full engine-cranking cycle with ambient temperature at maximum specified in "Performance Requirements" Article.
    2. Cranking Motor: Heavy-duty unit that automatically engages and releases from engine flywheel without binding.
    3. Cranking Cycle: As required by NFPA 110 for system level specified.
    4. Battery: Lead acid, with capacity within ambient temperature range specified in "Performance Requirements" Article to provide specified cranking cycle at least three times without recharging.
    5. Battery Cable: Size as recommended by engine manufacturer for cable length indicated. Include required interconnecting conductors and connection accessories.
    6. Battery Compartment: Factory fabricated of metal with acid-resistant finish and thermal insulation. Thermostatically controlled heater shall be arranged to maintain battery above 10 deg C regardless of external ambient temperature within range specified in "Performance Requirements" Article. Include accessories required to support and fasten batteries in place. Provide ventilation to exhaust battery gases.
    7. Battery Stand: Factory-fabricated, two-tier metal with acid-resistant finish designed to hold the quantity of battery cells required and to maintain the arrangement to minimize lengths of battery interconnections.
    8. Battery-Charging Alternator: Factory mounted on engine with solid-state voltage regulation and 35 A minimum continuous rating.
    9. Battery Charger: Current-limiting, automatic-equalizing and float-charging type designed for lead-acid batteries. Unit shall comply with UL 1236 and include the following features:
      - a. Operation: Equalizing-charging rate of 10 A shall be initiated automatically after battery has lost charge until an adjustable equalizing voltage is achieved at battery terminals. Unit shall then be automatically switched to a lower float-charging mode and shall continue to operate in that mode until battery is discharged again.
      - b. Automatic Temperature Compensation: Adjust float and equalize voltages for variations in ambient temperature from minus 40 deg F (minus 40 deg C) to 140 deg F (plus 60 deg C) to prevent overcharging at high temperatures and undercharging at low temperatures.
      - c. Automatic Voltage Regulation: Maintain constant output voltage regardless of input voltage variations up to plus or minus 10 percent.
      - d. Ammeter and Voltmeter: Flush mounted in door. Meters shall indicate charging rates.
      - e. Safety Functions: Sense abnormally low battery voltage and close contacts providing low battery voltage indication on control and monitoring panel. Sense high battery voltage and loss of ac input or dc output of battery charger. Either condition shall close contacts that provide a battery-charger malfunction indication at system control and monitoring panel.
      - f. Enclosure and Mounting: NEMA 250, Type 1, wall-mounted cabinet.
- 2.5 DIESEL FUEL-OIL SYSTEM (BELLY OR BASE TANK)
- A. Comply with NFPA 30.
  - B. Piping: Fuel-oil piping shall be Schedule 40 black steel, complying with requirements in Section 231113 "Facility Fuel-Oil Piping." Cast iron, aluminum, copper, and galvanizing shall not be used in the fuel-oil system.
  - C. Main Fuel Pump: Mounted on engine to provide primary fuel flow under starting and load conditions.
  - D. Fuel Filtering: Remove water and contaminants larger than 1 micron.
  - E. Relief-Bypass Valve: Automatically regulates pressure in fuel line and returns excess fuel to source.

2.6 CONTROL AND MONITORING

- A. Automatic Starting System Sequence of Operation: When mode-selector switch on the control and monitoring panel is in the automatic position, remote-control contacts in one or more separate automatic transfer switches initiate starting and stopping of generator set. When mode-selector switch is switched to the on position, generator set starts. The off position of same switch initiates generator-set shutdown. When generator set is running, specified system or equipment failures or derangements automatically shut down generator set and initiate alarms.
- B. Provide minimum run time control set for 15 minutes with override only by operation of a remote emergency-stop switch.
- C. Comply with UL 508A.
- D. Configuration: Operating and safety indications, protective devices, basic system controls, and engine gages shall be grouped in a common control and monitoring panel mounted on the generator set. Mounting method shall isolate the control panel from generator-set vibration. Panel shall be powered from the engine-generator set battery.
  - 1. Wall-Mounting Cabinet Construction: Rigid, self-supporting steel unit complying with NEMA ICS 6. Power bus shall be copper. Bus, bus supports, control wiring, and temperature rise shall comply with UL 891.
- E. Indicating Devices : As required by NFPA 110 for Level 1 system, including the following:
  - 1. AC voltmeter.
  - 2. AC ammeter.
  - 3. AC frequency meter.
  - 4. EPS supplying load indicator.
  - 5. Ammeter and voltmeter phase-selector switches.
  - 6. DC voltmeter (alternator battery charging).
  - 7. Engine-coolant temperature gage.
  - 8. Engine lubricating-oil pressure gage.
  - 9. Running-time meter.
  - 10. Current and Potential Transformers: Instrument accuracy class.
- F. Protective Devices and Controls in Local Control Panel: Shutdown devices and common visual alarm indication as required by NFPA 110 for Level 1 system, including the following:
  - 1. Start-stop switch.
  - 2. Overcrank shutdown device.
  - 3. Overspeed shutdown device.
  - 4. Coolant high-temperature shutdown device.
  - 5. Coolant low-level shutdown device.
  - 6. Low lube oil pressure shutdown device.
  - 7. Air shutdown damper shutdown device when used.
  - 8. Overcrank alarm.
  - 9. Overspeed alarm.
  - 10. Coolant high-temperature alarm.
  - 11. Coolant low-temperature alarm.
  - 12. Coolant low-level alarm.
  - 13. Low lube oil pressure alarm.
  - 14. Air shutdown damper alarm when used.
  - 15. Lamp test.
  - 16. Contacts for local and remote common alarm.
  - 17. Coolant high-temperature pre-alarm.
  - 18. Generator-voltage adjusting rheostat.
  - 19. Main fuel tank low-level alarm.
    - a. Low fuel level alarm shall be initiated when the level falls below that required for operation for the duration required in "Fuel Tank Capacity" Paragraph in "Diesel Fuel-Oil System" Article.
  - 20. Run-Off-Auto switch.
  - 21. Control switch not in automatic position alarm.

22. Low-starting air pressure alarm.
  23. Low-starting hydraulic pressure alarm.
  24. Low cranking voltage alarm.
  25. Battery-charger malfunction alarm.
  26. Battery low-voltage alarm.
  27. Battery high-voltage alarm.
  28. Generator overcurrent protective device not closed alarm.
- G. Supporting Items: Include sensors, transducers, terminals, relays, and other devices and include wiring required to support specified items. Locate sensors and other supporting items on engine or generator, unless otherwise indicated.
- H. Remote Alarm Annunciator: Comply with NFPA 99. An LED labeled with proper alarm conditions shall identify each alarm event, and a common audible signal shall sound for each alarm condition. Silencing switch in face of panel shall silence signal without altering visual indication. Connect so that after an alarm is silenced, clearing of initiating condition will reactivate alarm until silencing switch is reset. Cabinet and faceplate are surface- or flush-mounting type to suit mounting conditions indicated.
1. Overcrank alarm.
  2. Coolant low-temperature alarm.
  3. High engine temperature pre-alarm.
  4. High engine temperature alarm.
  5. Low lube oil pressure pre-alarm.
  6. Low lube oil pressure alarm.
  7. Overspeed alarm.
  8. Low fuel pressure alarm.
  9. Low coolant level alarm.
  10. Low cranking voltage alarm.
  11. Contacts for local and remote common alarm.
  12. Audible-alarm silencing switch.
  13. Air shutdown damper when used.
  14. Control switch not in automatic position alarm.
  15. Generator overcurrent protective device not closed.
- I. Supporting Items: Include sensors, transducers, terminals, relays, and other devices and include wiring required to support specified items. Locate sensors and other supporting items on engine or generator, unless otherwise indicated.
- J. Remote Emergency-Stop Switch: Flush; wall mounted, unless otherwise indicated; and labeled. Push button shall be protected from accidental operation.
- 2.7 GENERATOR OVERCURRENT AND FAULT PROTECTION
- A. Overcurrent protective devices for the entire EPSS shall be coordinated to optimize selective tripping when a short circuit occurs. Coordination of protective devices shall consider both utility and EPSS as the voltage source.
1. Overcurrent protective devices for the EPSS shall be accessible only to authorized personnel.
- B. Generator Circuit Breaker: Molded-case, thermal-magnetic type; 100 percent rated; complying with UL 489.
1. Tripping Characteristic: Designed specifically for generator protection.
  2. Trip Rating: Matched to generator output rating.
  3. Shunt Trip: Connected to trip breaker when generator set is shut down by other protective devices.
  4. Mounting: Adjacent to or integrated with control and monitoring panel.
- C. Ground-Fault Indication: Comply with NFPA 70, "Emergency System" signals for ground fault.
1. Indicate ground fault with other generator-set alarm indications.
  2. Trip generator protective device on ground fault.

2.8 GENERATOR, EXCITER, AND VOLTAGE REGULATOR

- A. Comply with NEMA MG 1.
- B. Drive: Generator shaft shall be directly connected to engine shaft. Exciter shall be rotated integrally with generator rotor.
- C. Electrical Insulation: Class H.
- D. Stator-Winding Leads: Brought out to terminal box to permit future reconnection for other voltages if required. Provide 12 lead alternator.
- E. Range: Provide broad range of output voltage by adjusting the excitation level.
- F. Construction shall prevent mechanical, electrical, and thermal damage due to vibration, overspeed up to 125 percent of rating, and heat during operation at 110 percent of rated capacity.
- G. Enclosure: Drip proof.
- H. Instrument Transformers: Mounted within generator enclosure.
- I. Voltage Regulator: Solid-state type, separate from exciter, providing performance as specified and as required by NFPA 110.
  - 1. Adjusting Rheostat on Control and Monitoring Panel: Provide plus or minus 5 percent adjustment of output-voltage operating band.
  - 2. Maintain voltage within 30 percent on one step, full load.
  - 3. Provide anti-hunt provision to stabilize voltage.
  - 4. Maintain frequency within 5 percent and stabilize at rated frequency within 2 seconds.
- J. Strip Heater: Thermostatically controlled unit arranged to maintain stator windings above dew point.
- K. Windings: Two-thirds pitch stator winding and fully linked amortisseur winding.
- L. Sub transient Reactance: 12 percent, maximum.

2.9 OUTDOOR GENERATOR-SET ENCLOSURE (CLUSTER 1 ONLY)

- A. Description: Vandal-resistant, weatherproof steel housing, wind resistant up to 100 mph (160 km/h). Multiple panels shall be lockable and provide adequate access to components requiring maintenance. Panels shall be removable by one person without tools. Instruments and control shall be mounted within enclosure.
- B. Engine Cooling Airflow through Enclosure: Maintain temperature rise of system components within required limits when unit operates at 110 percent of rated load for 2 hours with ambient temperature at top of range specified in system service conditions.
  - 1. Louvers: Fixed-engine, cooling-air inlet and discharge. Storm-proof and drainable louvers prevent entry of rain and snow.
  - 2. Ventilation: Provide temperature-controlled exhaust fan interlocked to prevent operation when engine is running.
- C. Interior Lights with Switch: Factory-wired, vapor-proof fixtures within housing; arranged to illuminate controls and accessible interior. Arrange for external electrical connection.
  - 1. AC lighting system and connection point for operation when remote source is available.
  - 2. DC lighting system for operations when remote source and generator are both unavailable.
- D. Convenience Outlets: Factory wired, GFCI. Arrange for external electrical connection.

2.10 MOTORS

- A. Description: NEMA MG 1, Design B, medium induction random-wound, squirrel cage motor.
- B. Efficiency: Energy efficient, as defined in NEMA MG 1.
- C. Service Factor: 1.15.
- D. Bearings: Re-greaseable, shielded, antifriction ball bearings suitable for radial and thrust loading.
- E. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.

- F. Temperature Rise: Match insulation rating.
  - G. Code Letter Designation:
    - 1. Motors 15 HP and Larger: NEMA starting Code F or Code G.
    - 2. Motors Smaller than 15 HP: Manufacturer's standard starting characteristic.
  - H. Enclosure Material: Cast iron for motor frame sizes 324T and larger; rolled steel for motor frame sizes smaller than 324T.
  - I. Controllers, Electrical Devices, and Wiring: Electrical devices and connections are specified in electrical Sections.
- 2.11 VIBRATION ISOLATION DEVICES
- A. Restrained Spring Isolators: Freestanding, steel, open-spring isolators with seismic restraint.
    - 1. Housing: Steel with resilient vertical-limit stops to prevent spring extension due to wind loads or if weight is removed; factory-drilled baseplate bonded to 1/4-inch-(6-mm-) thick, elastomeric isolator pad attached to baseplate underside; and adjustable equipment mounting and leveling bolt that acts as blocking during installation.
    - 2. Outside Spring Diameter: Not less than 80 percent of compressed height of the spring at rated load.
    - 3. Minimum Additional Travel: 50 percent of required deflection at rated load.
    - 4. Lateral Stiffness: More than 80 percent of rated vertical stiffness.
    - 5. Overload Capacity: Support 200 percent of rated load, fully compressed, without deformation or failure.
    - 6. Minimum Deflection: 1 inch (25 mm).
  - B. Vibration isolation devices shall not be used to accommodate misalignments or to make bends.
- 2.12 FINISHES
- A. Outdoor Enclosures and Components: Manufacturer's standard finish over corrosion-resistant pretreatment and compatible primer.
- 2.13 SOURCE QUALITY CONTROL
- A. Prototype Testing: Factory test engine-generator set using same engine model, constructed of identical or equivalent components and equipped with identical or equivalent accessories.
    - 1. Tests: Comply with NFPA 110, Level 1 Energy Converters and with IEEE 115.
  - B. Project-Specific Equipment Tests: Before shipment, factory test engine-generator set and other system components and accessories manufactured specifically for this Project. Perform tests at rated load and power factor. Include the following tests:
    - 1. Test components and accessories furnished with the installed unit that are not identical to those on tested prototype to demonstrate compatibility and reliability.
    - 2. Test generator, exciter, and voltage regulator as a unit.
    - 3. Full load run.
    - 4. Maximum power.
    - 5. Voltage regulation.
    - 6. Transient and steady-state governing.
    - 7. Single-step load pickup.
    - 8. Safety shutdown.
    - 9. Provide 14 days' advance notice of tests and opportunity for observation of tests by Owner's representative.
    - 10. Report factory test results within 10 days of completion of test.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas, equipment bases, and conditions, with Installer present, for compliance with requirements for installation and other conditions affecting packaged engine-generator performance.
- B. Examine roughing-in for piping systems and electrical connections. Verify actual locations of connections before packaged engine-generator installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

3.3 A. PROVIDE A PORTABLE STANDBY DUTY DIESEL GENERATOR OF EQUAL SIZE TO PROVIDE EMERGENCY POWER DURING THE PROJECT DURATION. MAKE TEMPORARY POWER CONNECTIONS AT THE DOCKING STATION. MAKE PROVISIONS TO START THE TEMPORARY GENERATOR IF ANY OF THE ASSOCIATED ATS'S DETECT THE LOSS OF NORMAL POWER. INSTALLATION

- A. Comply with packaged engine-generator manufacturers' written installation and alignment instructions and with NFPA 110.
- B. Install packaged engine-generator to provide access, without removing connections or accessories, for periodic maintenance.
- C. Install packaged engine-generator restrained spring isolators having a minimum deflection of 1 inch (25 mm) on 4-inch- (100-mm-) high concrete base. Secure enclosure to anchor bolts installed in concrete bases.
- D. Install condensate drain piping to muffler drain outlet full size of drain connection with a shutoff valve, stainless-steel flexible connector, and Schedule 40, black steel pipe with welded joints.
- E. Copper and galvanized steel shall not be used in the fuel-oil piping system.
- F. Electrical Wiring: Install electrical devices furnished by equipment manufacturers but not specified to be factory mounted.

3.4 CONNECTIONS

- A. Piping installation requirements are specified in other Sections. Drawings indicate general arrangement of piping and specialties.
- B. Connect fuel piping to engines with a gate valve and union and flexible connector.
  - 1. Vent gas pressure regulators outside building a minimum of 60 inches (1500 mm) from building openings.
- C. Ground equipment according to Section 260526 "Grounding and Bonding for Electrical Systems."
- D. Connect wiring according to Section 260519 "Low-Voltage Electrical Power Conductors and Cables." Provide a minimum of one 90-degree bend in flexible conduit routed to the generator set from a stationary element.
- E. Balance single-phase loads to obtain a maximum of 10 percent unbalance between any two phases.

3.5 IDENTIFICATION

- A. Identify system components according to Section 230553 "Identification for HVAC Piping and Equipment" and Section 260553 "Identification for Electrical Systems."
- B. Install a sign indicating the generator neutral is bonded to the main service neutral at the main service location.

3.6 FIELD QUALITY CONTROL

A. Tests and Inspections:

1. Perform tests recommended by manufacturer and each visual and mechanical inspection and electrical and mechanical test listed in the first two subparagraphs as specified in NETA Acceptance Testing Specification. Certify compliance with test parameters.
  - a. Visual and Mechanical Inspection
    - 1) Compare equipment nameplate data with drawings and specifications.
    - 2) Inspect physical and mechanical condition.
    - 3) Inspect anchorage, alignment, and grounding.
    - 4) Verify the unit is clean.
  - b. Electrical and Mechanical Tests
    - 1) Perform insulation-resistance tests in accordance with IEEE 43.
      - a) Machines larger than 200 horsepower (150 kilowatts). Test duration shall be 10 minutes. Calculate polarization index.
      - b) Machines 200 horsepower (150 kilowatts) or less. Test duration shall be one minute. Calculate the dielectric-absorption ratio.
    - 2) Test protective relay devices.
    - 3) Verify phase rotation, phasing, and synchronized operation as required by the application.
    - 4) Functionally test engine shutdown for low oil pressure, over-temperature, overspeed, and other protection features as applicable.
    - 5) Conduct performance test in accordance with NFPA 110.
    - 6) Verify correct functioning of the governor and regulator.
2. NFPA 110 Acceptance Tests: Perform tests required by NFPA 110 that are additional to those specified here including, but not limited to, single-step full-load pickup test.
3. Battery Tests: Equalize charging of battery cells according to manufacturer's written instructions. Record individual cell voltages.
  - a. Measure charging voltage and voltages between available battery terminals for full-charging and float-charging conditions. Check electrolyte level and specific gravity under both conditions.
  - b. Test for contact integrity of all connectors. Perform an integrity load test and a capacity load test for the battery.
  - c. Verify acceptance of charge for each element of the battery after discharge.
  - d. Verify that measurements are within manufacturer's specifications.
4. Battery-Charger Tests: Verify specified rates of charge for both equalizing and float-charging conditions.
5. System Integrity Tests: Methodically verify proper installation, connection, and integrity of each element of engine-generator system before and during system operation. Check for air, exhaust, and fluid leaks.
6. Exhaust Emissions Test: Comply with applicable government test criteria.
7. Voltage and Frequency Transient Stability Tests: Use recording oscilloscope to measure voltage and frequency transients for 50 and 100 percent step-load increases and decreases and verify that performance is as specified.

8. Harmonic-Content Tests: Measure harmonic content of output voltage at 25 percent and 100 percent of rated linear load. Verify that harmonic content is within specified limits.
  9. Noise Level Tests: Measure A-weighted level of noise emanating from generator-set installation, including engine exhaust and cooling-air intake and discharge, at four locations 25 feet (7.6 m) from edge of the generator enclosure, and compare measured levels with required values.
- B. Coordinate tests with tests for transfer switches and run them concurrently.
  - C. Test instruments shall have been calibrated within the last 12 months, traceable to NIST Calibration Services, and adequate for making positive observation of test results. Make calibration records available for examination on request.
  - D. Leak Test: After installation, charge exhaust, coolant, and fuel systems and test for leaks. Repair leaks and retest until no leaks exist.
  - E. Operational Test: After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation for generator and associated equipment.
  - F. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.
  - G. Remove and replace malfunctioning units and retest as specified above.
  - H. Retest: Correct deficiencies identified by tests and observations and retest until specified requirements are met.
  - I. Report results of tests and inspections in writing. Record adjustable relay settings and measured insulation resistances, time delays, and other values and observations. Attach a label or tag to each tested component indicating satisfactory completion of tests.
- 3.7 MAINTENANCE SERVICE
- A. Initial Maintenance Service: Beginning at Substantial Completion, provide 12 months' full maintenance by skilled employees of manufacturer's designated service organization. Include quarterly exercising to check for proper starting, load transfer, and running under load. Include routine preventive maintenance as recommended by the manufacturer and adjusting as required for proper operation. Provide parts and supplies, the same as those used in the manufacture and installation of original equipment.

**END OF SECTION**

# CCADF CLUSTER 1 GENERATOR REPLACEMENT

## BID DOCUMENTS




### INDEX OF DRAWINGS

#### COVER SHEET

##### ELECTRICAL

- E0.0 LEGEND AND GENERAL NOTES - ELECTRICAL
- E0.1 ONE LINE DIAGRAM AND SCHEDULES
- E1.1 ENLARGED PLANS - ELECTRICAL
- E2.1 PHOTOS - ELECTRICAL

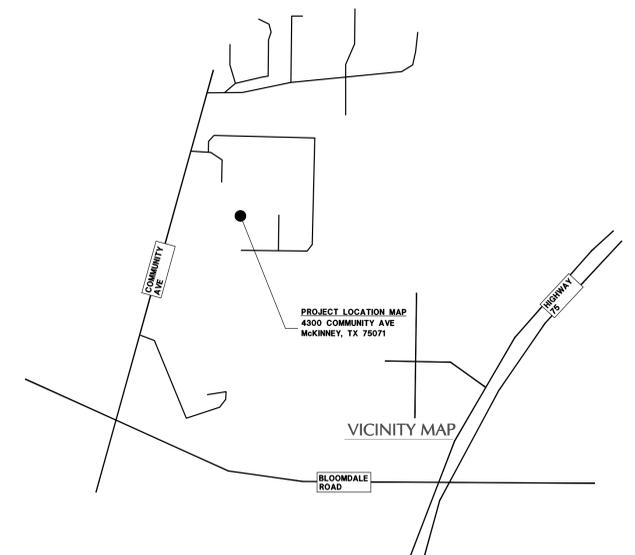

PROJECT LOCATION KEY PLAN

PRIME CONSULTANT



PROJECT NUMBER: 251780

ISSUE DATE:  
SEPTEMBER 17, 2025

Revisions:	DESCRIPTION	DATE
	CONSTRUCTION DOCUMENTS	09/24/2025



### ELECTRICAL ONE LINE SYMBOLS

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- CIRCUIT BREAKER
  - TRANSFORMER
  - MOTOR SYMBOL; THE NUMBER INSIDE INDICATES HP.

### ELECTRICAL EQUIPMENT

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- 208V OR 240V PANELBOARD
  - 480V OR 600V POWER PANELBOARD
  - EQUIPMENT CABINET OR PANEL
  - GROUND BAR
  - MOTOR SYMBOL, FLOOR PLANS
  - AUTOMATIC TRANSFER SWITCH
  - MANUAL TRANSFER SWITCH
  - SURGE PROTECTIVE DEVICE
  - LOW VOLTAGE TRANSFORMER DRAWN TO SCALE
  - BUS DUCT
  - BUS DUCT PLUG
  - ZONE DAMPERS
  - MOTORIZED DAMPERS

### CIRCUITS

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- RACEWAY CONCEALED IN CEILING OR WALL; EXPOSED RACEWAY IS ALLOWED ONLY WHERE NOTED.
  - RACEWAY BELOW SLAB OR UNDERGROUND
  - RACEWAY UP
  - RACEWAY DOWN
  - RACEWAY CONTINUATION
  - RACEWAY STUB-OUT WITH CAP
  - JUNCTION BOX

### ELECTRICAL CONTROLS

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- NON FUSED DISCONNECT SWITCH
  - FUSED DISCONNECT SWITCH; FUSE RATING INDICATED
  - COMBINATION MOTOR STARTER AND FUSED SAFETY SWITCH; FUSE RATING INDICATED
  - MOTOR STARTER
  - MANUAL MOTOR STARTER
  - EMERGENCY POWER OFF
  - TOGGLE SWITCH, MOTOR RATED
  - MOTORIZED SHADE SWITCH
  - TIME CLOCK
  - VARIABLE FREQUENCY DRIVE
  - PUSH BUTTON
  - ELECTRIC DOOR OPENER
  - PARTITION SENSOR

### DRAWING SYMBOLS

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- NUMBER
  - DESCRIPTION
  - SUBTITLE
  - SCALE
  - DETAIL #
  - DETAIL SYMBOL
  - DRAWING NO. TO REFER TO
  - SECTION NUMBER
  - SECTION
  - DRAWING NUMBER WHERE SECTION IS LOCATED

### ELECTRICAL ABBREVIATIONS

(ALL ABBREVIATIONS MAY NOT APPEAR ON DRAWINGS.)

A	AMPERE(S)	CATV	CABLE TELEVISION	EWC	ELECTRICAL WATER COOLER	IES	ILLUMINATING ENGINEERING	MIN	MINIMUM	OH	OVERHEAD	TEMP	TEMPORARY
AC	ALTERNATING CURRENT	CB	CIRCUIT BREAKER	EX	EXISTING	IG	ISOLATED GROUND	MLO	MAIN LUGS ONLY	P	POLE(S)	TU	TEXAS UTILITIES ELECTRIC
ADA	AMERICANS WITH DISABILITIES ACT	CCTV	CLOSED-CIRCUIT TELEVISION	F	FUSE(S)	IMC	INTERMEDIATE METALLIC CONDUIT	mm	MILLIMETER(S)	PA	PUBLIC ADDRESS SYSTEM	TV	TELEVISION
AFF	ABOVE FINISHED FLOOR	CKT	CIRCUIT	FBO	FURNISHED BY OWNER	JBOX	JUNCTION BOX	MMS	MANUAL MOTOR STARTER	PF	POWER FACTOR	TYP	TYPICAL
AFG	ABOVE FINISHED GRADE	CLG	CEILING	FL	FLOOR	MOC	MAXIMUM OVER-CURRENT PROTECTION	PL	PANELBOARD	PL	PILOT LIGHT	UG	UNDERGROUND
AFG	ABOVE FINISHED GRADE	COMM	COMMUNICATIONS	FLA	FULL LOAD AMPERE(S)	KA	KILOAMPERE(S)	PHL	PANELBOARD	PVC	POLYVINYL CHLORIDE	UL	UNDERWRITERS LABORATORIES, INC.
AHU	AIR HANDLING UNIT	CT(S)	CURRENT TRANSFORMER(S)	FLEX	FLEXIBLE	KW	KILOWATT(S)	MTS	MANUAL TRANSFER SWITCH	RC	REMOTE CONTROL	UPS	UNINTERRUPTIBLE POWER SUPPLY
AIC	AMPERE INTERRUPTING CAPACITY (ROOT MEAN SQUARE SYMMETRICAL)	CJ	COPPER	FS	FUSIBLE SAFETY SWITCH OR FUSIBLE SWITCH	KVH	KILOVOLT-HOUR(S)	MVA	MEGAVOLT-AMPERE(S)	RCP	REDUCED CURRENT PLAN	UNO	UNLESS NOTED OTHERWISE
ALT	ALTERNATE	DC	DIRECT CURRENT	G	GROUND	KV	KILOVOLT(S)	GW	MEGAWATT(S)	VA	VOLT-AMPERE(S)	V	VOLTAGE OR VOLT(S)
APPROX	APPROXIMATE OR APPROXIMATELY	DISC	DISCONNECT	GAP	GENERATOR ANNUNCIATOR PANEL	KVAR	KILOVOLT-AMPERE(S) REACTIVE	NC	NORMALLY CLOSED	RGS	RIGID GALVANIZED STEEL	VFD	VARIABLE FREQUENCY DRIVE
ARCH	ARCHITECT	DPST	DOUBLE-POLE, DOUBLE THROW SWITCH	GFI	GROUND FAULT CIRCUIT INTERRUPT	LPS	LOW PRESSURE SODIUM LIGHTING	NEC	NATIONAL ELECTRICAL CODE	RVSS	REDUCED VOLTAGE, SOLID STATE SQUARE FOOT OR FEET	W	WEATHERPROOF
ATS	AUTOMATIC TRANSFER SWITCH	EC	EMPTY CONDUIT OR TUBING	HACR	HEATING AND AIR CONDITIONING RATING	LTG	LIGHTING	NEMA	NATIONAL ELECTRICAL CODE	SPDT	SINGLE-POLE, DOUBLE-THROW SWITCH	WM	WITH
AU	ALUMINUM	EHH	ELECTRICAL HANDHOLE	HD	HIGH INTENSITY DISCHARGE	MAX	MAXIMUM	NF	NON-FUSIBLE SAFETY SWITCH ASSOCIATION	SPST	SINGLE-POLE, SINGLE-THROW SWITCH	WO	WITHOUT
AUX	AUXILIARY	ELEV	ELEVATION	HOA	HAND-OFF-AUTOMATIC	MCA	MINIMUM CONDUCTOR AMPACITY	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION	SS	START-STOP	XFMR	TRANSFORMER
AWG	AMERICAN WIRE GAGE	EMERG	EMERGENCY	HP	HORSEPOWER	MCB	MAIN CIRCUIT BREAKER	NIC	NOT IN CONTRACT	SW	SWITCH	XP	EXPLOSION-PROOF
BFC	BELOW FINISHED CEILING	EMH	ELECTRICAL MANHOLE	HPS	HIGH PRESSURE SODIUM	MCC	MOTOR CONTROL CENTER	NT	NOT IN CONTRACT	SWBD	SWITCHBOARD	TA	TRIP AMPERE(S)
BFG	BELOW FINISHED GRADE	EMT	ELECTRICAL METALLIC TUBING	HVAC	HEATING, VENTILATION AND AIR CONDITIONING	MCP	MOTOR CIRCUIT PROTECTOR	NO	NORMALLY OPEN	TAS	TEXAS ACCESSIBILITY STANDARDS	#	NUMBER
BLDG	BUILDING	E/R	EXISTING TO BE REMOVED AND REINSTALLED AFTER MODIFICATION	HZ	HERTZ	MH	METAL HALIDE	NTS	NOT TO SCALE	TEL	TELEPHONE		
C	CONDUIT OR TUBING					MIC	MICROPHONE						

### TELECOM OUTLETS

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- TELECOMMUNICATION OUTLET; 1-GANG BOX AT 18" AFF WITH 1" CONDUIT TO ABOVE NEAREST ACCESSIBLE CEILING; SUBSCRIPTED NUMBER INDICATES MOUNTING HEIGHT AFF
  - DATA SYSTEM FIBER OPTIC JACK; SINGLE GANG BOX AT 18" AFF WITH 1" CONDUIT TO ABOVE NEAREST ACCESSIBLE CEILING; SUBSCRIPTED NUMBER MOUNTING HEIGHT AFF
  - TELECOMMUNICATION PHONE, VOICE AND DATA JACK; 1-GANG BOX AT 48" AFF WITH 1" CONDUIT TO ABOVE NEAREST ACCESSIBLE CEILING; SUBSCRIPTED NUMBER INDICATES MOUNTING HEIGHT AFF
  - TELECOMMUNICATION OUTLET, MOUNTED IN FLOOR BOX
  - TELECOMMUNICATION OUTLET, CEILING MOUNTED
  - TELECOMMUNICATION OUTLET, MOUNTED IN POLE THRU
  - TELECOMMUNICATION OUTLET, MOUNTED IN POWER POLE
  - WIRELESS ACCESS POINT
  - WIRELESS ACCESS POINT, CEILING MOUNTED
  - CEILING MOUNTED WIRELESS WIFI ANTENNA
  - OCCUPANCY SENSOR "SWITCH PACK" OR "POWER PACK" REFER TO DETAIL 8 ON SHEET E3
  - CONTROLLED DOOR
  - CARD READER
  - OVERHEAD DOOR CONTROLLER
  - SECURITY CAMERA
  - CLOCK SYSTEM SINGLE RECEPTACLE; NEMA 5-15R AT 80" ABOVE FINISHED FLOOR UNO.
  - TELEVISION DATA OUTLET; SINGLE GANG 2.5" DEEP BOX AT 72" AFF, UNLESS NOTED OTHERWISE, (WITH 1-1/4" CONDUIT TO ABOVE NEAREST CEILING).
  - FURNITURE VOICE/DATA WHIP

### RECEPTACLES

- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- CIRCUITS
- EMERGENCY NORMAL
- SINGLE RECEPTACLE, 120V; NEMA 5-20R AT 18" ABOVE FINISHED FLOOR UNO.
  - SINGLE RECEPTACLE, CEILING MOUNTED
  - SINGLE RECEPTACLE, FLOOR MOUNTED
  - DUPLEX RECEPTACLE, 120V; NEMA 5-20R AT 18" ABOVE FINISHED FLOOR UNO.
  - SINGLE RECEPTACLE, FLOOR MOUNTED
  - QUADRUPLEX RECEPTACLE, 120V; NEMA 5-20R AT 18" ABOVE FINISHED FLOOR UNO.
  - QUADRUPLEX RECEPTACLE, CEILING MOUNTED
  - SPLIT WIRED RECEPTACLE, 120V, TOP SWITCHED
  - RECEPTACLE, NEMA #
  - INDICATES CONTROLLED
  - MULTI-SERVICE FLOOR BOX (RECEPTACLES/OUTLETS AS INDICATED)
  - OUTLET, MOUNTED IN POKE THRU (RECEPTACLES/OUTLETS AS INDICATED)
  - OUTLET, MOUNTED ON POWER POLE (RECEPTACLES/OUTLETS AS INDICATED)
  - CEILING CORD DROP, 120V


### ELECTRICAL CONVENTIONS

- (ALL CONVENTIONS MAY NOT APPEAR ON DRAWINGS.)
- GENERAL NOTES APPLY TO ELECTRICAL DRAWING SET.
- DRAWING NOTES APPLY TO DRAWING ON WHICH NOTE APPEARS.
- NOTES BY SYMBOL APPLY TO DRAWING ON WHICH AND WHERE SYMBOL APPEARS.
- WIRE SIZES ARE INDICATED BY AMERICAN WIRE GAGE OR CIRCULAR MILS.
- LB-3.5 — PANELBOARD, SWITCHBOARD OR MOTOR CONTROL CENTER CIRCUIT DESIGNATION
- — — CENTER LINE

### TYPICAL LIGHTING NOTATIONS SHOWN ON LIGHTING PLAN:



### TYPICAL POWER NOTATIONS SHOWN ON POWER PLAN:



### WIRING METHOD NOTES:

- DO NOT COMBINE NEUTRALS AND GROUNDS OF SEPARATE BRANCH CIRCUITS.
- WIRE SHALL BE COPPER THWN - SOLID FOR SIZES 12, 10, 8; STRANDED FOR SIZES 6 AND LARGER.

### RECEPTACLES TYPES


- (ALL SYMBOLS MAY NOT APPEAR ON DRAWINGS.)
- DUPLEX RECEPTACLE, 120V; NEMA 5-20R AT 18" ABOVE FINISHED FLOOR UNO. SEE BELOW FOR LIST OF SUBSCRIPTS FOR #:
  - AC = MOUNTED ABOVE 3" ABOVE COUNTER BACKSLASH
  - D = DEDICATED CIRCUIT
  - G = GROUND-FAULT CIRCUIT INTERRUPTER
  - IG = ISOLATED GROUND RECEPTACLE
  - S = DETENTION PLATE, CIRCUITS ASSOCIATED WITH DEVICE SHALL BE CONNECTED TO A GFCI BREAKER
  - SU = SURGE PROTECTOR
  - T = TAMPER PROTECTOR
  - TV = TV RECEPTACLE
  - U = INTEGRAL USB PORT(S)
  - WP = GROUND-FAULT CIRCUIT INTERRUPTER W/ WEATHERPROOF COVERPLATE
  - n = RECEPTACLE MOUNTED n INCHES ABOVE FINISHED FLOOR OR GRADE
  - RECEPTACLE 208 VOLT
  - SPECIAL-PURPOSE RECEPTACLE; SEE SPECIAL-PURPOSE RECEPTACLE, CONNECTION AND FLOOR BOX SCHEDULED ON DRAWING
  - HARDWIRED CONNECTION OR PROVISION FOR CONNECTION; SEE SPECIAL-PURPOSE RECEPTACLE, CONNECTION AND FLOOR BOX SCHEDULED ON DRAWING
  - MULTIOUTLET ASSEMBLY
  - FLOOR-MOUNTED DUPLEX RECEPTACLE AND DATA CONNECTION
  - FURNITURE POWER WHIP

### GENERAL NOTES

- (ALL CONVENTIONS MAY NOT APPEAR ON DRAWINGS.)
- THE ELECTRICAL CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS FROM AUTHORITY HAVING JURISDICTION AND PAY ALL ASSOCIATED FEES.
  - LOCATE JUNCTION AND PULL BOXES AS REQUIRED TO ALLOW ACCESS AFTER EQUIPMENT AND APPURTENANCES ARE INSTALLED. COORDINATE LOCATIONS AND ELEVATIONS OF ELECTRICAL DEVICES WITH DRAWINGS AND OTHER TRADES PRIOR TO INSTALLATION.
  - PROTECT PERMANENT BUILDING FIXTURES FROM DAMAGE DURING CONSTRUCTION PERIOD. PROVIDE PLYWOOD OR SIMILAR MATERIAL UNDER EQUIPMENT OR MATERIALS STORED ON FLOORS AND IN AREAS WHERE CONSTRUCTION MAY DAMAGE FINISHES. SURFACES OR FINISHES DAMAGED DURING CONSTRUCTION SHALL BE REPLACED AT THE COST OF THE CONTRACTOR.
  - BRANCH CIRCUITS OVER 75 FEET (25 METERS) IN LENGTH (TOTAL ONE WAY) FROM THE PANEL, THE ELECTRICAL CONTRACTOR SHALL CALCULATE THE VOLTAGE DROP AND PROVIDE AN APPROPRIATE CONDUCTOR SIZE TO ACHIEVE NO MORE THAN 3% MAXIMUM ALLOWABLE VOLTAGE DROP.
  - DO NOT SCALE THE DRAWINGS. BECAUSE OF THE SCALE OF THE DRAWINGS, IT IS NOT POSSIBLE TO INDICATE ALL OFFSETS, FITTINGS OR OTHER SIMILAR ITEMS WHICH MAY BE REQUIRED TO MAKE A COMPLETE OPERATING SYSTEM. CAREFULLY INVESTIGATE CONDITION AFFECTING WORK AND INSTALL WORK IN SUCH A MANNER THAT INTERFERENCES BETWEEN PIPES, CONDUIT, DUCT, EQUIPMENT, ARCHITECTURAL AND STRUCTURAL FEATURES SHALL BE AVOIDED.
  - PROVIDE 'SEAL-OFFS' WHEN CONDUIT PASSES THROUGH AREAS OF DIFFERENT AMBIENT TEMPERATURES AND/OR HAZARDOUS AREAS.
  - IF MORE THAN THREE CURRENT-CARRYING CONDUCTORS ARE ROUTED IN THE SAME CONDUIT, DERATING SHALL BE TAKEN INTO ACCOUNT. INCREASING THE CONDUCTOR AMPACITY (BY INCREASING WIRE SIZE) TO COMPENSATE AS FOLLOWS:
- | NO. OF CONDUCTORS | AMPACITY INCREASE |
|-------------------|-------------------|
| 4 THRU 6          | 125%              |
| 7 THRU 9          | 145%              |
| 10 THRU 20 (MAX)  | 200%              |
- THE CONDUIT SIZE (CAPACITY) SHALL ALSO BE INCREASED TO CONFORM TO NEC, CHAPTER 9.
- ALL EQUIPMENT TO BE CONSIDERED 'AS-EQUAL' MUST BE SUBMITTED TO THE ENGINEER FOR APPROVAL NO LATER THAN ONE (1) WEEK PRIOR TO BID DATE.
  - IT IS THE CONTRACTORS RESPONSIBILITY TO COORDINATE WITH ALL TRADES FOR SUBSTITUTED EQUIPMENT FROM THIS DESIGN. UNCOORDINATED CHANGES THAT OCCUR FROM A SUBSTITUTION WILL BE THE CONTRACTOR'S RESPONSIBILITY TO ABSORB THE COST AND NOT PASS ONTO THE OWNER.
  - PROVIDE PROTECTION IN FIRE RATED WALL MEMBRANE PENETRATIONS. PROTECTION SHALL WRAP THE OUTSIDE OF THE BOX OR ENCLOSURE TO MAINTAIN WALL FIRE RATING. DO NOT USE PENETRATION PROTECTION ON THE INTERIOR OF BOX/ENCLOSURE OR COVER PLATE TYPE PROTECTION. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
  - LISTED OR LABELED EQUIPMENT SHALL BE INSTALLED AND USED IN ACCORDANCE WITH ANY INSTRUCTION INCLUDED IN THE LISTING OR LABELING. (NEC 110.3.B).

### PROJECT APPLICABLE CODES

ALL MECHANICAL EQUIPMENT AND INSTALLATIONS SHALL CONFORM WITH THE REQUIREMENTS OF THE 2023 NATIONAL ELECTRIC CODE, THE 2021 INTERNATIONAL MECHANICAL CODE, THE 2021 INTERNATIONAL ENERGY CONSERVATION CODE, THE 2021 INTERNATIONAL BUILDING CODE, STATE AND LOCAL AMENDMENTS, NATIONAL FIRE PROTECTION ASSOCIATION UNDERWRITERS LABORATORIES (OR ETL) AND ALL APPLICABLE LOCAL CODES AND ORDINANCES AND ANY APPLICABLE OWNER STANDARDS.

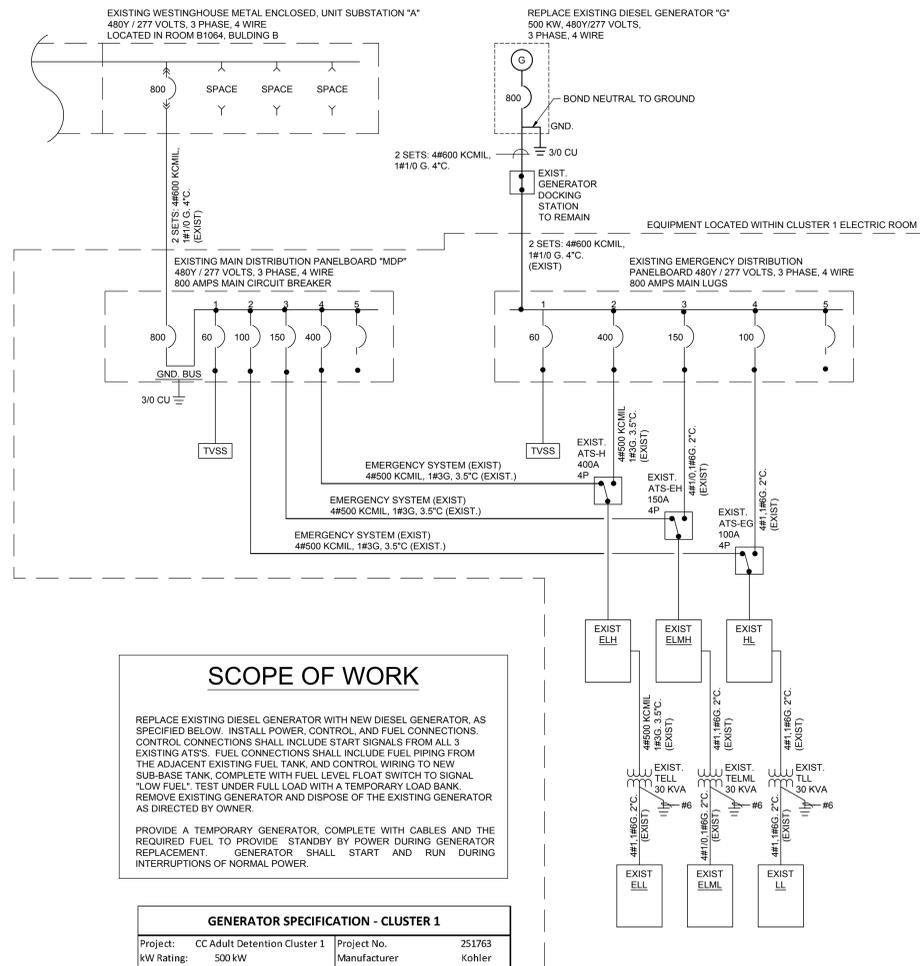

**SCOPE OF WORK**

REPLACE EXISTING DIESEL GENERATOR WITH NEW DIESEL GENERATOR, AS SPECIFIED BELOW. INSTALL POWER, CONTROL, AND FUEL CONNECTIONS. CONTROL CONNECTIONS SHALL INCLUDE START SIGNALS FROM ALL 3 EXISTING ATSS. FUEL CONNECTIONS SHALL INCLUDE FUEL PIPING FROM THE ADJACENT EXISTING FUEL TANK, AND CONTROL WIRING TO NEW SUB-BASE TANK. COMPLETE WITH FUEL LEVEL FLOAT SWITCH TO SIGNAL "LOW FUEL". TEST UNDER FULL LOAD WITH A TEMPORARY LOAD BANK. REMOVE EXISTING GENERATOR AND DISPOSE OF THE EXISTING GENERATOR AS DIRECTED BY OWNER.

PROVIDE A TEMPORARY GENERATOR, COMPLETE WITH CABLES AND THE REQUIRED FUEL TO PROVIDE STANDBY BY POWER DURING GENERATOR REPLACEMENT. GENERATOR SHALL START AND RUN DURING INTERRUPTIONS OF NORMAL POWER.

GENERATOR SPECIFICATION - CLUSTER 1		
Project:	CC Adult Detention Cluster 1	Project No. 251783
kW Rating:	500 kW	Manufacturer Kohler
Voltage:	480Y/277 V, 3 ph, 4 w.	Generator Model No. 500REQ2VC
Fuel:	Diesel	Alternator Model No. 7M4046
Run Time:	24 hours	ATS: N/A
Tank:	UL142 Dual wall subbase tank	Control Wiring: 4-wire
Enclosure:	Weather Proof	Output breaker 800 AMP
Start/Transfer Time:	60 Sec.	Load Sequence Steps 1
Cooling:	Air Cooled	Max. Start kW 565
Service:	Standby	Max. Start kVA 2200
Maximum Voltage Dip:	15%	

**01 ONE LINE DIAGRAM - ADF CLUSTER 1**  
SCALE: NTS

Texas Registered Firm No. F-7489  
500 North Central Expressway, Suite 310  
Ft. Worth, TX 76102  
Email: mlabrecq@mdeng.com  
Phone: 817-335-1100  
Project Number: 251780



**Collin County Adult Detention  
Facility Cluster 1 Generator**

4300 Community Ave. McKinney, Texas 75071


Revisions:	DESCRIPTION
DATE	CONSTRUCTION DOCUMENTS
09/24/2025	



ONE LINE  
DIAGRAMS AND  
SCHEDULES

Project No.  
**251780**

Sheet No.  
**E0.1**

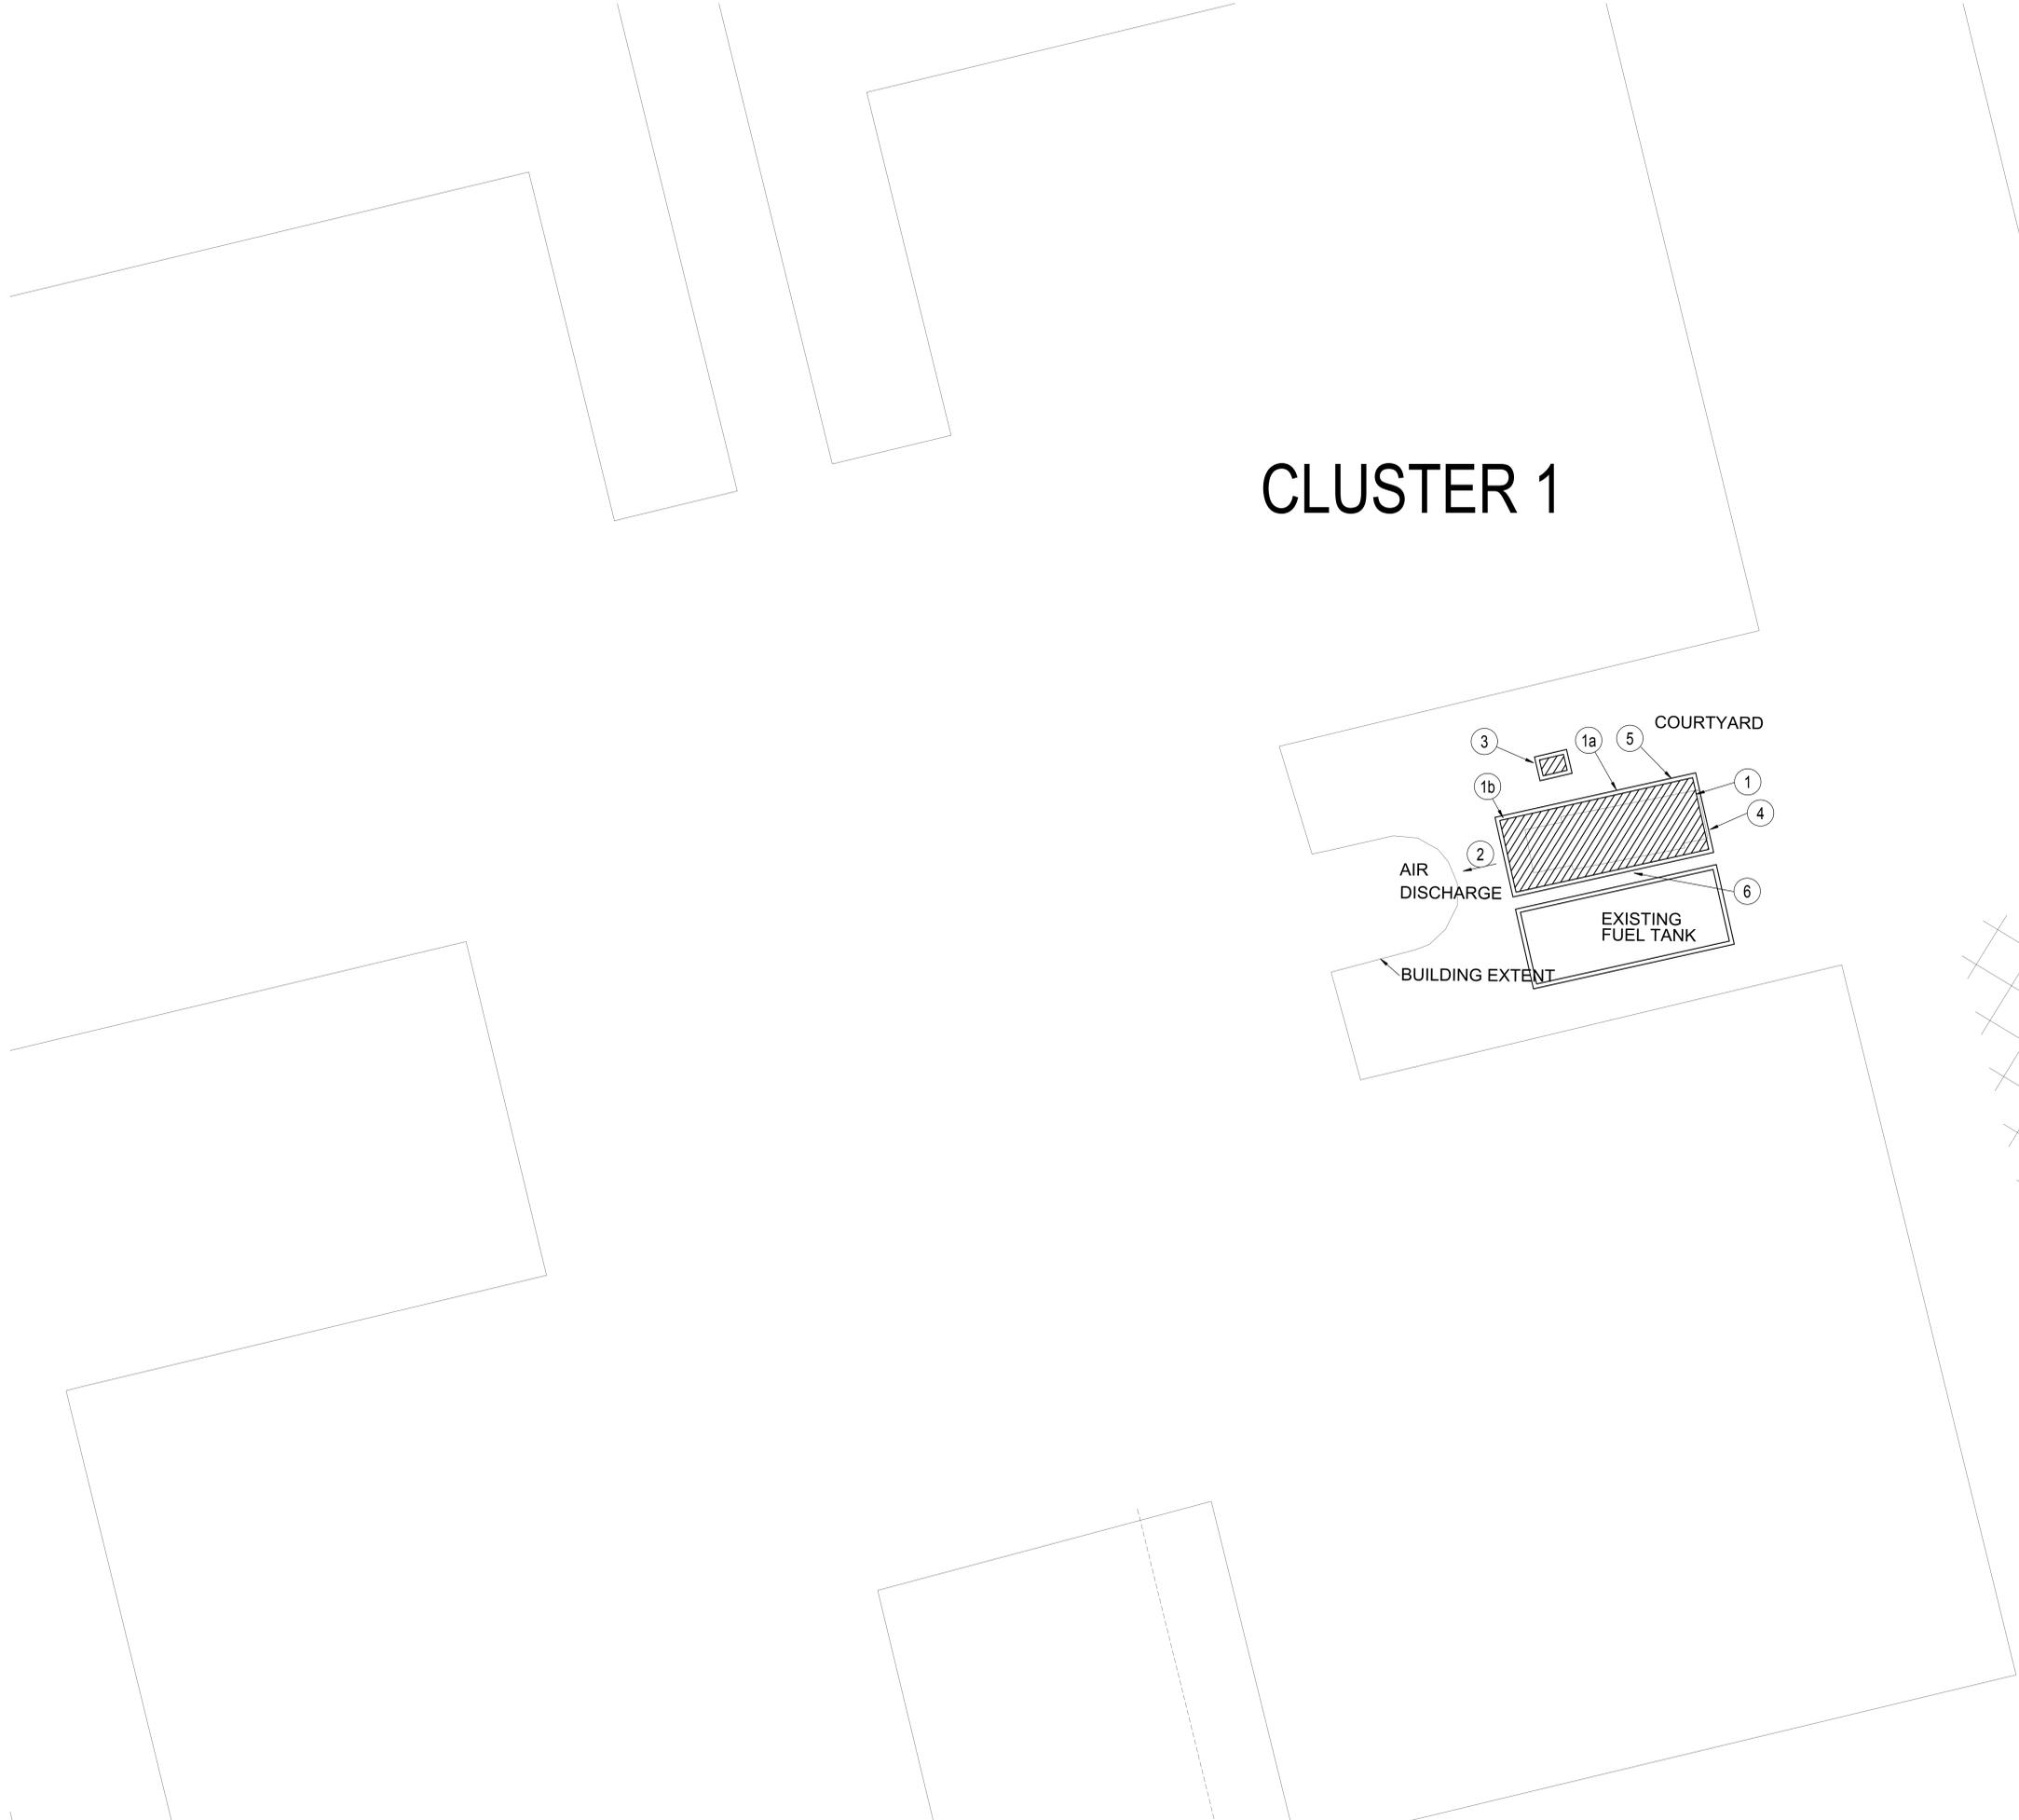

# CLUSTER 1

## GENERAL NOTES

- A. REFER TO DRAWING E0.0 FOR ELECTRICAL LEGEND, ABBREVIATIONS AND GENERAL NOTES - ELECTRICAL.
- B. ELECTRICAL CONTRACTOR SHALL VERIFY WITH CONSTRUCTION MANAGER THAT A SURVEY HAS BEEN CONDUCTED AND ALL UNDERGROUND UTILITIES HAVE BEEN IDENTIFIED.
- C. UTILITIES SHOWN ON THESE DRAWINGS ARE FOR REFERENCE ONLY. ELECTRICAL CONTRACTOR SHALL COORDINATE EXACT LOCATION OF ALL EXISTING UTILITIES AND ROUTING OF ALL NEW UNDERGROUND UTILITIES WITH RESPECTIVE TRADES (PLUMBING, CIVIL, ETC.), PRIOR TO DIGGING. MINIMIZE DIGGING BY SHARING TRENCHES WHENEVER POSSIBLE.
- D. COORDINATE SERVICE SHUT-DOWNS WITH ALL TRADES INVOLVED ON SITE AND OBTAIN WRITTEN AUTHORIZATION FROM OWNER 72 HOURS PRIOR TO ANY ELECTRICAL WORK.

## NOTES BY SYMBOL "O"

1. THE EXISTING GENERATOR SHALL BE REMOVED AND DISPOSED OF IN ACCORDANCE WITH THE OWNER'S INSTRUCTIONS. REMOVE THE FOLLOWING ITEMS FROM THE GENERATOR AND INSTALL THEM ON THE NEW GENERATOR:
  - a. POWER AND SIGNAL CABLES TO THE ALTERNATOR, CONTROL PANEL, POWER TO FUEL PUMP, BATTERY CHARGER AND BLOCK HEATER.
  - b. FUEL LINES, FUEL PUMP, FLOAT VALVE, AND VENT STACKS
2. ORIENT NEW GENERATOR ON THE EXISTING GENERATOR PAD AS SHOWN.
3. LOCATION OF EXISTING GENERATOR DOCKING STATION TO REMAIN. MAKE POWER AND SIGNAL CONNECTIONS HERE.
4. DEVIATION FROM THE BASIS OF DESIGN WILL REQUIRE THE CONTRACTOR TO ENLARGE THE GENERATOR PAD TO ACCOMMODATE THE NEW GENERATOR, AT NO ADDITIONAL COST TO THE OWNER.
5. CONNECT EXISTING GENERATOR FEEDERS, RETAINED FOR GENERATOR REMOVAL, TO NEW GENERATOR. REFER TO ONE-LINE DIAGRAM E0.1.
6. CONNECT EXISTING FUEL TANK FUEL LINES, RETAINED FOR GENERATOR REMOVAL, TO NEW GENERATOR. REFER TO ONE-LINE DIAGRAM E0.1.

Texas Registered Firm No. F-7489  
 500 North Central Expressway, Suite 310  
 Irving, Texas 75038  
 Email: mlabrecq@mdeng.com  
 Project Number: 251780



Collin County Adult Detention  
 Facility Cluster 1 Generator

4300 Community Ave. McKinney, Texas 75071


Revisions:	DATE	DESCRIPTION
	09/24/2025	CONSTRUCTION DOCUMENTS



ENLARGED  
 PLANS -  
 ELECTRICAL

Project No.  
**251780**

Sheet No.  
**E1.1**



**01** ENLARGED PLAN - ADF CLUSTER 1  
 SCALE: 1/4" = 1'-0"



EXISTING GENERATOR AND DOCKING STATION



EXISTING GENERATOR ELECTRICAL



EXISTING GENERATOR OVERVIEW



EXISTING GENERATOR CONTROLS



EXISTING GENERATOR FUEL CONNECTIONS




EXISTING GENERATOR CONTROL PANEL




EXISTING GENERATOR FUEL CONNECTION

01 CLUSTER 1 - PHOTOS  
SCALE: NTS



Texas Registered Firm No. F-7489  
500 North Central Expressway, Suite 310  
Ft. Worth, TX 76102  
Email: mdrup@mdeng.com  
Project Number: 251780



Collin County Adult Detention  
Facility Cluster 1 Generator

4300 Community Ave. McKinney, Texas 75071

Revisions:	DESCRIPTION
DATE	CONSTRUCTION DOCUMENTS
09/24/2025	



PHOTOS -  
ELECTRICAL

Project No.  
**251780**

Sheet No.  
**E2.1**